


NATIONAL ELECTRIC TRANSMISSION CONGESTION STUDY


DECEMBER 2009



U.S. Department of Energy

NATIONAL ELECTRIC TRANSMISSION CONGESTION STUDY

DECEMBER 2009



U.S. Department of Energy

Note to Readers

As the Department of Energy (DOE) stated when it announced the beginning of its work on this study in May 2006, the 2009 Congestion Study focused on the identification of existing electric transmission-level congestion based on publicly available historic information and data related to transmission congestion. The information and data used by DOE in conducting the analysis in this study was that which was available through May 2009. As a result the study does not address the possible impacts of the recent recession on congestion, or any other recent events, reports, or other developments affecting congestion.

Consistent with the requirements of the Energy Policy Act of 2005, the Department invites public comment on this study. A 60-day comment period will begin shortly, with the publication of a notice of the availability of the study and the comment period in the *Federal Register*. DOE will post the opening and closing dates of the comment period on www.congestion09.anl.gov, which is a public website the Department maintains for congestion-related activities and materials. All comments received will be posted on this website.

Commenters may address any aspect of this study they consider appropriate. The Department intends to update, or issue an addendum to, this study in which it may consider the effect of the recession on congestion identified in the study, comments received on this version of the study, and the implications of additional data or information that has become available since May 2009. The Department invites commenters to direct it to data, publications, or other information that they believe relevant to this additional analysis.

Contents

Executive Summary	vii
Acronyms and Abbreviations	xvii
1. Overview	1
1.1. Legislative Requirements for This Study	1
1.2. Outline of This Study	2
2. 2009 National Electric Transmission Congestion Study—Study Approach and Methods	5
2.1. Study Process	5
2.2. Information Collection and Public Consultation	5
2.3. Transmission Congestion, Congestion Metrics, and Cautions	6
2.4. Historical Data and Analysis	8
2.5. Future Conditions and Congestion Across the Grid	10
2.6. Assumptions Made in the Study	10
3. Renewable Energy Development and Transmission Availability	11
3.1. Background	11
3.2. Potential Sources of Significant Renewable Energy Constrained by Lack of Adequate Transmission Capacity	13
3.3. 2009 Conditional Constraint Area	22
3.4. Reasons for the Failure to Develop Adequate Transmission for Renewables	24
3.5. Legal Challenges Delaying Transmission for Renewable Energy	25
4. Transmission Congestion in the Eastern Interconnection	29
4.1. Introduction	29
4.2. Congestion Metrics Overview	29
4.3. Historical Congestion in the Eastern Interconnection	32
4.4. Mid-Atlantic Critical Congestion Area	38
4.5. New England Congestion Area of Concern	52
4.6. Congestion in the Midwest	58
4.7. Congestion in the Southeast	60
4.8. Nuclear Power Development and the Need for New Transmission	64
4.9. Coal Development and the Need for New Transmission	65
4.10. Congestion Areas in the Eastern Interconnection	66
5. Transmission Congestion in the Western Interconnection	67
5.1. Introduction	67
5.2. Recent Historical Congestion in the Western Interconnection	67
5.3. Projected Congestion in the Western Interconnection	71
5.4. Southern California Critical Congestion Area	73
5.5. San Francisco Peninsula Congestion Area of Concern	87
5.6. Seattle-Portland Congestion Area of Concern	90
5.7. Phoenix-Tucson Congestion Area of Concern	93
5.8. 2009 Western Congestion Areas	97

Contents (continued)

6. Public Comments, Next Steps Regarding Transmission Planning, and Achieving Transmission Adequacy **101**

6.1. Request for Comments on This Study 101

6.2. Next Steps Regarding Transmission Analysis and Planning 101

6.3. Achieving Adequate Transmission Capacity 102

Glossary **105**

Appendixes

A. List of Entities Submitting Comments to DOE Website as Input to the 2009 National Electric Transmission Congestion Study 113

B. Organizations Participating in Congestion Study Workshops and Workshop Agendas 115

C. Documents and Data Reviewed for the 2009 National Electric Transmission Congestion Study 127

List of Tables

2-1. Publicly Available 2007 Data and Metrics on Transmission Utilization, Eastern and Western Interconnections 9

4-1. 2007 Transmission Congestion Data Provided to OATI for Study of the Eastern Interconnection 33

4-2. Transmission Loading Relief in the U.S. Portion of the Eastern Interconnection 2007 Data 36

4-3. PJM Congestion Cost Summary by Control Zone, Calendar Year 2008 48

4-4. New Transmission Projects Brought In-Service in New England, 2005-2009 55

5-1. Most Heavily Loaded Transmission Paths in the West Sorted by Alternative Ranking Methods, 2007 Data 70

5-2. Proposed Transmission Projects in the Western Interconnection 75

List of Figures

ES-1. 2009 Type I and Type II Conditional Constraint Areas ix

ES-2. Mid-Atlantic Critical Congestion Area, 2009 xi

ES-3. 2009 Congestion Areas in the Western Interconnection xiii

3-1. 2006 Conditional Congestion Areas 12

3-2. SWAT Renewable Energy Zones and Current and Potential Transmission System 15

3-3. WREZ Renewable Energy Zones: WREZ Initiative Hub Map 16

3-4. Domestic Wind Resources Map 17

3-5. Wind Power Development in the United States, 2008 18

3-6. MW Wind in Regional Interconnection Queues 19

3-7. National Solar Radiation Map, May 2007 Data 20

3-8. Projected Concentrating Solar Power Capacity by Region in 2050 21

3-9. U.S. Geothermal Resource Map 22

3-10. 2009 Type I and Type II Conditional Constraint Areas 23

4-1. Eastern Critical Congestion Area and Congestion Area of Concern Identified in the 2006 National Electric Transmission Congestion Study 29

4-2. Net Firm Reservations for All Eastern Zones, 2007 35

4-3. Net Non-Firm Reservations for All Eastern Zones, 2007 35

4-4. Areas in the Eastern Interconnection Served/Not Served by Organized Wholesale Markets 37

List of Figures (continued)

- 4-5. Combined MISO-PJM-NYISO Binding Constraints Metric: Annual Mean Shadow Prices 38
- 4-6. Generation Added in New York State, 1999–Early 2009. 43
- 4-7. New Transmission Built in New York Area. 44
- 4-8. Bulk Power Flows in New York State 45
- 4-9. Frequency of Real-Time Congestion on Major Interfaces 2002-2007 46
- 4-10. Major Points of Congestion in PJM, 2007 47
- 4-11. Approved New Backbone Transmission in PJM 49
- 4-12. PJM Merchant Transmission Queue (as of 1/31/09) 51
- 4-13. Sustained Price Differentials Across the Mid-Atlantic Region 52
- 4-14. Significant Price Divergence Between Zones in NYISO—Daily Average of NYISO
Day-Ahead Prices, All Hours 52
- 4-15. Growth of Demand Resources in New England, 2003-2008 53
- 4-16. Map of New and Recent Transmission Projects in New England 56
- 4-17. Average Real-time Prices in New England 57
- 4-18. Average Nodal Locational Market Prices in New England, Fourth Quarter, 2008 57
- 4-19. Average Locational Marginal Prices Across New England Zones,
Calculated as Differences from the Hub, for 2004-2008 57
- 4-20. Entergy Region Transmission Upgrades Under Study, 2009 63
- 4-21. Proposed New Nuclear Power Plants 65
- 4-22. Congestion Area in the Eastern Interconnection, 2009 66

- 5-1. Western Congestion Areas Identified in the *2006 National Electric Transmission Congestion Study* 67
- 5-2. WECC Transmission Paths. 69
- 5-3. Most Heavily Used Transmission Paths in WECC, 2007. 70
- 5-4. Path Utilization Levels Vary But Have Not Increased: Path Utilization Trend, 1998-2007 71
- 5-5. Map of Principal Transmission Paths in the Western Interconnection. 72
- 5-6. Location of Renewable Resources by Region for TEPPC 15% Renewables Case 74
- 5-7. Proposed Major Transmission Projects in WECC 78
- 5-8. Transmission Linking Arizona and Nevada to Southern California and Planned Upgrades 84
- 5-9. Major Congested Interties and Congestion Costs in California 85
- 5-10. Key Points of Intra-Zonal Congestion in California. 86
- 5-11. Electric System of the Greater San Francisco Bay Area 88
- 5-12. TransBay Cable Route 89
- 5-13. Major Regional Transmission Projects Proposed in the Pacific Northwest 92
- 5-14. Planned Extra High Voltage Transmission Facilities for the Phoenix and Tucson Area 96
- 5-15. Major Transmission Projects Under Study that will Affect Arizona Transmission Congestion 97
- 5-16. Western Interconnection Congestion Areas, 2009 98

Executive Summary

In the Energy Policy Act of 2005 (EPAct), Congress directed the U.S. Department of Energy (DOE) to conduct a study every three years on electric transmission congestion and constraints within the Eastern and Western Interconnections. The American Reinvestment and Recovery Act of 2009 (Recovery Act) further directed the Secretary to include in the 2009 Congestion Study an analysis of significant potential sources of renewable energy that are constrained by lack of adequate transmission capacity. Based on this study, and comments concerning it from states and other stakeholders, the Secretary of Energy may designate any geographic area experiencing electric transmission capacity constraints or congestion as a national interest electric transmission corridor (National Corridor).

In August 2006, the Department published its first National Electric Transmission Congestion Study. In 2007, based on the findings of that study and after considering the comments of stakeholders, the Secretary designated two National Corridors, one in the Mid-Atlantic area and one covering Southern California and part of western Arizona.

This document identifies areas that are transmission-constrained, but as in 2006, this study does not make recommendations concerning existing or new National Corridor designations. The Department may or may not take additional steps concerning National Corridors at some future time.

Transmission Congestion

Congestion occurs on electric transmission facilities when actual or scheduled flows of electricity across a line or piece of equipment are restricted below desired levels. These restrictions may be imposed either by the physical or electrical capacity of the line, or by operational restrictions created and enforced to protect the security and reliability of the grid. The term “transmission constraint” can refer to a piece of equipment that restricts power flows, to an operational limit imposed to protect reliability,

or to a lack of adequate transmission capacity to deliver potential sources of generation without violating reliability requirements. Because power purchasers typically try to buy the least expensive energy available, when transmission constraints limit the amount of energy that can be delivered into the desired load center or exported from a generation-rich area, these constraints (and the associated congestion) impose real economic costs upon energy consumers. In the instances where transmission constraints are so severe that they limit energy deliverability relative to consumers’ electricity demand, such constraints can compromise grid reliability.

The 2009 study documents (to the extent publicly available data permit) where electricity congestion and transmission constraints occur across the eastern and western portions of the United States’ bulk power system. Congestion varies over time and location as a function of many factors, including energy use and production patterns across the grid and changes in the availability of specific assets (such as power plants or transmission lines) over time. This analysis indicates general patterns of congestion—broad areas where the transmission congestion reflects imbalances between electric supply and demand that create significant costs, perhaps including adverse impacts on reliability.

Transmission congestion and the existence and impacts of transmission constraints can be measured according to three broad sets of metrics—high levels of transmission usage, the economic costs and electricity prices that result from transmission constraints, and, occasionally, the reliability consequences of transmission limits. These metrics and the results of their application are discussed in detail in Chapters 2, 4 and 5.

The 2009 study identifies regions of the country that are experiencing congestion, but refrains from addressing the issue of whether transmission expansion would be the most appropriate solution. In

some cases, transmission expansion might simply move a constraint from one point on the grid to another without materially changing the overall costs of congestion. In other cases, the cost of building new facilities to remedy congestion over all affected lines may exceed the cost of the congestion itself, and, therefore, remedying the congestion would not be economic. In still other cases, alternatives other than transmission, such as increased local generation (including distributed generation), energy efficiency, energy storage and demand response may be more economic than transmission expansion in relieving congestion.

Thus, a finding that a transmission path or flowgate is frequently congested should lead to further study of the costs and impacts of that congestion, and to a careful regional study of a broad range of potential remedies to larger reliability and economic problems. Although congestion is a reflection of legitimate reliability or economic concerns, not all transmission congestion can or should be reduced or “solved.”

Study Approach and Input

Chapter 2 presents the 2009 study’s approach and methods. The 2009 study differs methodologically from the previous study in that in 2006 the Department worked with analysts and consultants to develop independent projections of future congestion in the Eastern and Western Interconnections. In planning for the 2009 study, the Department determined that it would not conduct or sponsor congestion projections specifically for the 2009 study, but would draw instead upon the many studies prepared by others through independent, credible planning entities and processes.

The Department conducted extensive public outreach and consultation relating to the 2009 study. Department staff reached out to stakeholders within state governors’ offices, public utility regulators, electric utilities and grid operators, electricity producers, demand-side resource providers, environmental organizations, and the general public to invite input on transmission congestion and constraints, and their consequences. Department staff conducted seven regional and technical public

workshops to collect information. The Department reviewed comments submitted in connection with the 2006 congestion study about the conduct of future studies, and reviewed more than 40 comments filed as inputs to the 2009 study. Department staff met or spoke with all stakeholders requesting such contact. All of these views have been considered carefully in preparing the analyses that follow.

For the 2009 study, the Department revisited each of the congestion areas identified in 2006 and reassessed the 2006 study’s conclusions for each area in light of currently available information on present conditions and expected high-probability developments. The Department reviewed more than 325 documents, independent studies, and analyses containing relevant information, as well as analyses of both historical and projected grid conditions; all of those reference materials are listed in Appendix C.

Renewable Resource Development, Transmission Availability, and the Concept of a Conditional Constraint Area

The Recovery Act expanded the scope of the 2009 Congestion Study by requiring the Department to include an analysis of the significant potential sources of renewable energy that are constrained in accessing appropriate market areas by lack of adequate transmission capacity, and explain why adequate transmission capacity has not been developed. Chapter 3 addresses these issues after reviewing the areas with the greatest potential for wind, solar and geothermal resource development as identified by the National Renewable Energy Laboratory (NREL).

In this study, the Department defines and identifies two types of Conditional Congestion Areas, Type I and Type II. A Type I Conditional Congestion Area is an area where large quantities of renewable resources could be developed economically using existing technology with known cost and performance characteristics—if transmission were available to serve them. Because many of the nation’s rich on-shore renewable resources are located in adjacent or overlapping areas, the Department has determined


that it is appropriate to identify a single very large Type I area, rather than to call out technology-specific congestion areas (as was done in the 2006 study). By contrast, a Type II Conditional Congestion Area is an area with renewable resource potential that is not yet technologically mature but shows significant promise due to its quality, size, and location. If such resources become technologically mature (through additional R&D and sufficient experience with commercial-scale projects) they could then be limited chiefly by transmission availability, and if so the affected area would qualify for Type I status. A very large onshore Type I area and several offshore Type II areas are shown in Figure ES-1.

It is important to recognize that the economics of renewable resource development can vary widely from region to region, and that the characteristics of the resources are very location-specific. In many cases transmission access makes the difference between an economic and uneconomic project or development area; such economic and geographic granularity must also consider the cost of the transmission to access the resource, and cannot be determined or conveyed accurately in a national-scale study. Several states and regional organizations are

conducting highly detailed analyses to identify preferred locations for development of renewable energy resources and their associated electric transmission needs—including efforts by the Western Governors’ Association (WGA), Midwest Governors’ Association, Southwest Area Transmission (SWAT) Forum, California, Arizona, and several other states. The Department recommends that resource development economic and policy decisions should be guided by these efforts. The Department also notes that there appears to be a wealth of commercially viable renewable resources outside the Type I Conditional Constraint Area; identification of the Area is not meant to suggest that it is not appropriate to develop additional transmission to serve new renewable (and other) resources elsewhere in the nation.

The Recovery Act also directed the Department to analyze the extent to which legal challenges filed at the State and Federal level are delaying the construction of transmission necessary to access renewable energy. Review of numerous transmission projects, including those intended to serve primarily renewable resources, suggests that most large-scale transmission projects are subject to legal challenge,

Figure ES-1. 2009 Type I and Type II Conditional Constraint Areas

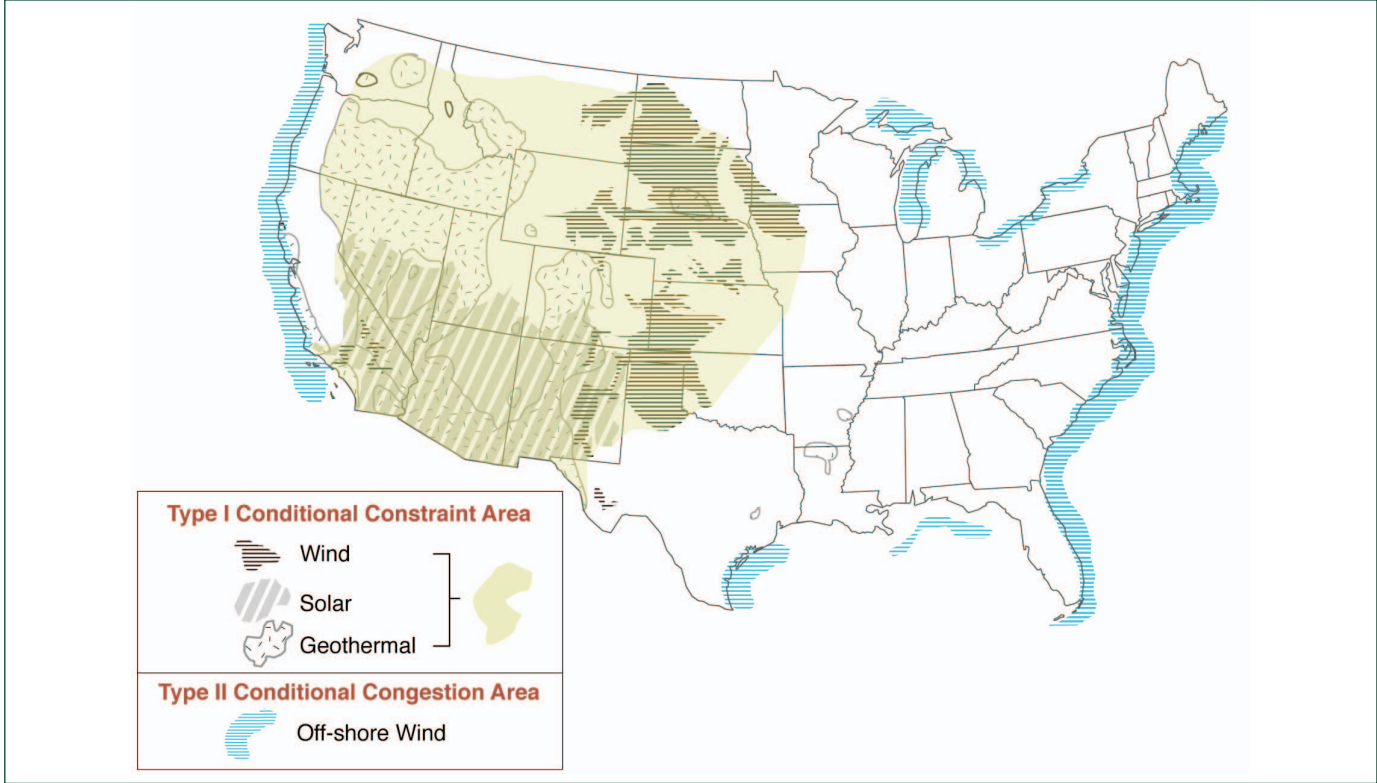

regardless of any relationship to renewable resources; the Department concludes that while renewable-associated transmission projects face many challenges, they do not appear to suffer from legal challenge or delay to a greater or lesser extent than other transmission projects.

Transmission Congestion in the Eastern Interconnection

Because transmission congestion occurs when the flow of electricity from one point to another is limited below desired levels, transmission congestion can be evidenced in at least three ways—as heavy electrical usage of the equipment, as price differentials or economic cost differentials between different parts of the grid, and in extreme conditions, as a reliability problem that results from the inability to deliver enough electricity to meet consumers' electricity demand. Each of these measures can be expressed in quantitative metrics, discussed below, but the amounts of publicly available data to quantify and evaluate congestion are limited.

The Department hired a consulting firm to conduct a first-ever assessment of publicly available data on historical transmission congestion in the Eastern Interconnection.¹ The study was based solely on data for 2007. Information on actual electricity flows and on some aspects of scheduled flows in the Eastern Interconnection is not publicly available. Accordingly, the study collected and assessed information on three core elements that affect how transmission is managed—and how congestion can be measured with publicly available data—in the Eastern Interconnection: transmission reservations, transmission schedules, and real-time operations. The available data on 2007 historical transmission confirm the findings of the 2006 study with respect to the principal transmission congestion locations in the East. However, the Department concludes that the Eastern data—and more broadly, information on electric transmission usage generally in the U.S.—need significant improvement in scope and quality.

Reviewing the Congestion Areas identified in 2006, the Department concluded that the Mid-Atlantic

Critical Congestion Area (extending from mid-state New York down to mid-Virginia) continues to experience high levels of transmission congestion. The region is making significant progress in reducing loads and improving reliability through the use of aggressive energy efficiency and demand response programs, and has added new generation since 2006. However, little new transmission has been built in the region in the past three years, although many new backbone and expansion projects are nearing construction; therefore it is likely to be several years before current congestion levels ease. This will lead to continued price differentials across the region and could compromise continued reliability in the Washington, Baltimore, New Jersey and New York City areas over the coming years. In addition, as long as New York's electric reliability and economics depend to a significant degree on electricity imports through New Jersey, Pennsylvania and neighboring states, tensions will remain over how to balance the needs and costs across the region. The Department finds that the Mid-Atlantic area continues to exhibit major transmission congestion problems and should continue to be identified as a Critical Congestion Area. This identification—as is the case with the others that follow in this document—is based on consideration of the totality of the various kinds of information presented, rather than on whether specific congestion metrics have been met or exceeded.

In 2006 the Department identified New England as a Congestion Area of Concern due to high electricity price differentials across the region and congestion-related reliability problems in Boston, southwest Connecticut, and other sub-areas. Over the past three years, however, transmission congestion within New England has fallen significantly. This is due to years of sustained effort and achievement on several fronts—new utility-scale and distributed, small-scale supply resources have come on-line, primarily in the locations where they were most needed and valuable; aggressive demand response programs have made load reduction into a geographically targeted resource that can be used to reduce peak loads and mitigate the effects of temporal transmission constraints; and energy efficiency is

¹Open Access Technology International (OATI) (2009). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, at <http://www.congestion09.anl.gov/>.

reducing total loads. Further, the area has a strong queue of new generation projects, as well as a diverse set of new reliability- and economics-oriented transmission projects completed or sitting in its interconnection and transmission system study queues. These developments have eased the significant reliability and economic differentials affecting the Boston metropolitan area and southwest Connecticut.

Although New England still faces a potential resource shortfall under extreme load conditions over the next few years, most of the significant transmission constraints have been eliminated by the region’s multi-faceted approach. The region has shown that it can permit, site, finance, cost-allocate and build new generation and transmission, while encouraging new demand-side resources as well. New England faces some near-term reliability challenges, but is working aggressively to address them. For these reasons, the Department no longer identifies New England as a Congestion Area of Concern.

The Department also reviewed transmission congestion and grid conditions across the rest of the Eastern Interconnection and concludes that although there are numerous locations where transmission constraints cause economic congestion and occasional operational reliability problems, at present there are no other large areas that would justify formal identification as a congestion area.

Figure ES-2 shows the Mid-Atlantic Critical Congestion Area, the only congestion area identified by the Department in the Eastern Interconnection in 2009.


Transmission Congestion in the Western Interconnection

For 2009, the Department examined congestion and constraints in the Western Interconnection in general and reviewed the status of the areas it identified in its 2006 study. The Transmission Expansion Planning and Policy Committee (TEPPC) of the Western Electricity Coordinating Council (WECC) conducted both historical analysis of 2007 transmission data and forecasts of transmission needs for 2018. The TEPPC work found that although electricity flows vary from season to season and year to year as a function of changes in electricity demand,

fuel costs and availability, new generation additions and losses, and other factors, the patterns reflected in this one-year snapshot still correspond generally to the broad patterns of past historical congestion. In fact, viewed with the same congestion metrics used in the 2006 Congestion Study, the grid congestion patterns for the 2007 data are consistent with the results of TEPPC’s analysis of 2004 data (which was reported in the 2006 study).

The Western grid differs from the Eastern grid in that the Western grid system covers larger distances with a higher proportion of transmission lines linking distant generation sources to large, concentrated load centers. This means that Western system electricity data are more geographically aggregated and less granular—across physical geography and

Figure ES-2. Mid-Atlantic Critical Congestion Area, 2009

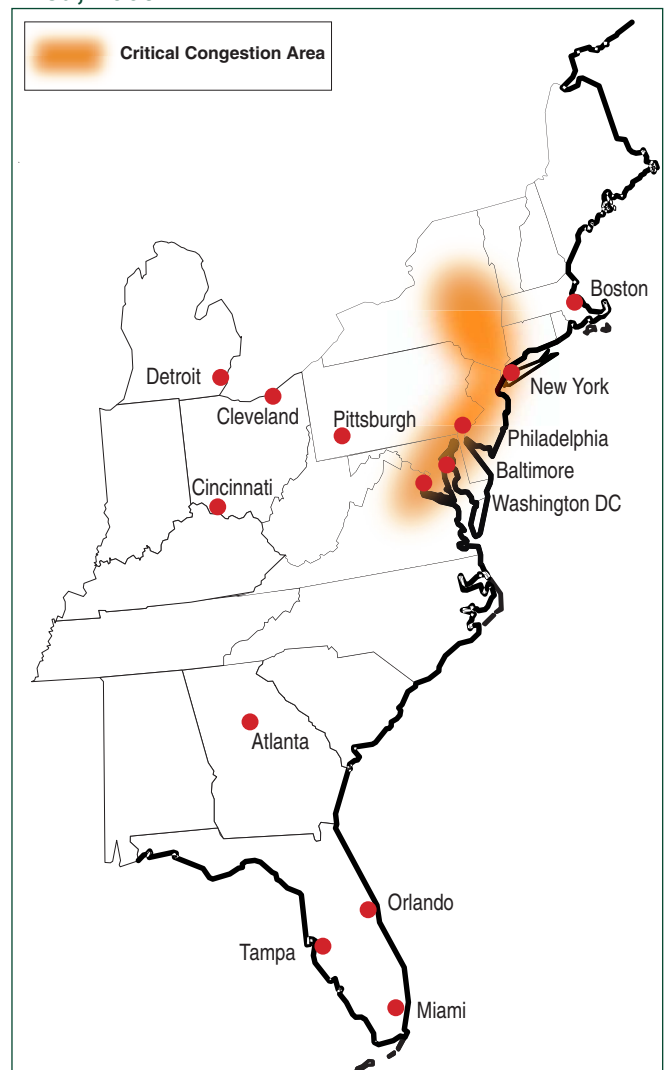

transmission assets and paths—than in the East. Another difference between West and East is that the West is dominated by vertically integrated utilities, with no centrally organized wholesale electric markets outside California; therefore, there are no data about the historic costs of congestion or electricity prices to measure the economic dimensions and consequences of transmission congestion in the (non-California) West.

The West has developed a strong, transparent regional transmission planning and analysis process over the past several years. This process is now yielding a wealth of proposals to build new backbone transmission across the interconnection, with at least 51 major projects being considered from British Columbia and Alberta down to southern California. Many of these projects are intended to enable concentrations of new renewable generation capacity in regions including southern California, Montana, Wyoming, Washington, and Oregon to deliver their output to coastal and southern load centers.

The Department's 2006 study identified Southern California (spanning the metropolitan areas of Los Angeles and San Diego) as a Critical Congestion Area, given the area's persistent transmission congestion problems, large population, and important economic role within the nation. Factors influencing the identification as a Critical Congestion Area included the area's growing electric demand, heavy dependence upon electricity imports, and difficulty in building new power plants and transmission lines.

In the 2009 study, the Department concludes that although the state of California has shown national leadership in moderating electric load growth and increasing distributed generation, the Southern California region remains challenged. New transmission and generation in Southern California have barely kept pace with load growth over the past few years. Although many promising generation and transmission projects are now in the planning or regulatory approval stages, experience shows that few such projects become operational on schedule in California. Slow development of new generation and transmission facilities could compromise near-term grid reliability in Southern California,

despite growing demand response and smart grid capabilities. For these reasons, the Department concludes that Southern California remains congested, and that it should retain its status as a Critical Congestion Area.

In 2006 the Department identified the San Francisco Bay Area as a Congestion Area of Concern because of the reliability challenge posed by serving the area between San Jose and San Francisco with a single set of lines across the San Francisco Peninsula. The area had high local generation costs due to local high-cost reliability-must-run requirements, and little in-area generation. Instead—then and now—the San Francisco City and Peninsula depend upon import capabilities and the level of electricity demand and generation dispatch in the East Bay and South Bay.

A combination of supply and demand relief measures will be needed to reduce congestion and maintain reliability on the San Francisco Peninsula, but only a few of the needed measures will be completed over the near term. Until there is a clearer picture of how and when all the needed supply and demand-side elements will materialize, and materially improve conditions on the San Francisco Peninsula, the Department will continue to identify the San Francisco Peninsula as a Congestion Area of Concern.

The 2006 study identified the area from Seattle south to Portland as a Congestion Area of Concern with both reliability and economic implications. This reflected both high loading in winter and summer and increasing wind generation to the east, combined with new generation that had been built within the congestion path. Current development of rich wind resources to the east of the area is exacerbating the congestion problems over the near term, despite aggressive operational mitigation efforts by the local grid operator.

Several major backbone transmission projects are now being evaluated for the area; their completion would probably solve most of the Seattle-Portland congestion problems. Such completion, however, appears several years away. Until then, the Department will continue to identify the area as a Congestion Area of Concern.

Last, the 2006 study identified the Phoenix-Tucson region as a Congestion Area of Concern because this metropolitan region was experiencing explosive population and load growth with significant transmission loading and congestion. Numerous new transmission and generation projects have been given regulatory approval, however, and are now coming into service in the region, with the result that the existing and planned transmission systems appear adequate to meet the local energy reliability needs of the area for much of the coming decade. Although not all of the transmission and demand-side projects that will resolve current congestion problems have been completed, the recent history of transmission development in Arizona indicates that projects developed through the state's Biennial Transmission Assessment process receive swift regulatory approval and are built on schedule with limited complications or uncertainty due to permitting, routing or cost recovery. Therefore, the Department considers it likely that most of these projects will become operational by their scheduled dates in 2009 and 2010. Based on the progress in addressing congestion issues, the Department no longer identifies the Phoenix-Tucson area as a Congestion Area of Concern.

Figure ES-3 shows the 2009 Transmission Congestion Areas for the Western Interconnection.

A wealth of new backbone transmission is being considered for development in the Western Interconnection. This new transmission will affect western congestion patterns, as will efforts to develop new renewable resources to meet state renewable portfolio requirements and increased energy efficiency to meet resource and carbon emissions management goals. The Department will continue monitoring these developments, and the paths and congestion areas identified above, to determine whether levels of congestion and usage are becoming better or worse as load, generation and transmission infrastructure change over time.

Public Comments, Next Steps and Recommendations

The Department invites public comments on all aspects of this study. The comment period will be for 60 days, beginning with the day a notice of the availability of the study for public comment is

published in the *Federal Register*. As soon as the closing date has been determined, the Department will post the closing date on its Congestion Study web site, congestion09@anl.gov. Comments must be submitted in writing to the Department no later than 5:00 p.m. EST on the closing date, if possible by e-mail to congestion09@anl.gov.


Comments may also be submitted by conventional mail to this address:

Comments on DOE 2009 Transmission
Congestion Study
c/o Adriana Kocornik-Mina
Office of Electricity Delivery and Energy
Reliability (OE)
U.S. Department of Energy
1000 Independence Avenue SW
Washington DC 20585

All comments received will be made publicly available on the website DOE has created for this study, www.congestion09.anl.gov. The Department will consider all comments received and take them into account in making decisions based in part on the findings of this study.

Several important activities and analyses are pending or already under way that are likely to show

Figure ES-3. 2009 Congestion Areas in the Western Interconnection

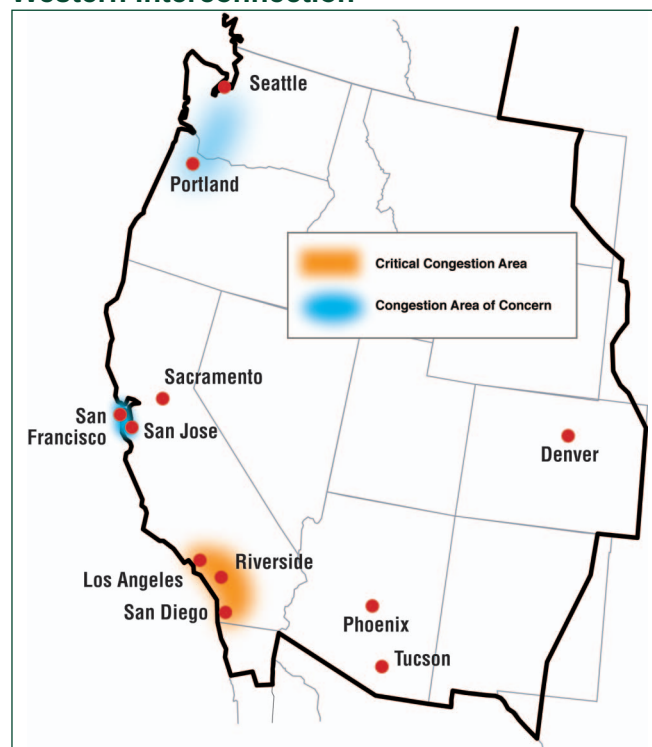

more clearly where the case for building additional transmission capacity is especially strong. The Recovery Act provided funds with which the Department intends to support these activities and analyses. These include:

1. *Stronger and more inclusive regional and inter-connection-level transmission analysis and planning.* The Department believes that analytical entities in each of the Nation's interconnections should develop a broad portfolio of possible electricity supply futures, and identify their associated transmission requirements. These analyses will address, for example, the extent to which energy efficiency programs can reduce or forestall the need for additional transmission capacity, the merits of developing high-potential renewables in remote areas, as well as the merits of developing other renewable resources closer to load centers.

After these analyses have been developed and made available for public review, transmission experts from the electricity industry, the states, federal agencies, and other stakeholder groups will collaborate in the development of interconnection-level transmission plans. Thus, to the extent feasible these plans will identify a coherent core set of transmission projects regarded by a diverse group of experts as needed under a wide range of futures.

2. *Designation by states of geographic zones with concentrated, high-quality renewable resource potential, or other physical attributes especially relevant to reducing overall carbon emissions at reasonable cost.* See, for example, *Western Renewable Energy Zones—Phase 1 Report*,² which identifies renewable resource “hubs.” These hubs are the approximate centers of high-value resources areas that have also been screened to avoid park lands, wilderness areas, wetlands, military lands, steeply sloped areas, etc. DOE has announced that it seeks proposals from eastern state-based organizations to undertake similar analyses in the eastern United States. Identification of zones of particular interest for the development of additional low-carbon electric generating capacity will

be very important as input to the long-term planning processes described in the preceding paragraph.

3. *Regional or sub-regional renewable integration studies.* The output from wind and solar generation sources is inherently variable, at least over shorter periods of time. Therefore, in a given region, transmission planners must determine how higher levels of renewable generation could be used in combination with other generation sources, demand-side resources, and storage facilities while maintaining grid reliability. Completion of these integration studies, along with careful transmission planning, is essential to enable planners to make informed decisions about how to integrate large amounts of new renewable generation effectively, economically and reliably.

Determining what will constitute future transmission “adequacy,” however, is no simple matter. It is becoming technically feasible to drive transmission systems harder and obtain more services from them, without endangering reliability—provided certain critical conditions are met. These include:

1. The availability of detailed, near-real-time information about second-to-second changes in the operational state of the bulk power supply systems.
2. The availability of effective control devices that will respond extremely quickly to correct or avert potentially hazardous operating conditions.
3. The availability of appropriately trained workforces that will be able to design, build, operate, and maintain such complex systems.

The Department has plans to address these challenges, again through funds provided by the Recovery Act.

Given the rising importance of electric infrastructure planning, however, there is a clear need to facilitate better and more transparent planning and policy decisions by improving the quality and availability of data concerning the use of existing transmission facilities. More systematic and

²Western Governors' Association (WGA) and U.S. Department of Energy (DOE) (2009). “Western Renewable Energy Zones – Phase 1 Report,” at <http://www.westgov.org/wga/initiatives/wrez/>.

consistent data are needed on several transmission subjects, such as:

1. The prices and quantities of short- and long-term transactions in wholesale electricity markets.
2. Scheduled and actual flows on the bulk power system. At present, Open Access Same-Time Information System (OASIS) data are scattered across many websites, are neither edited nor archived, and not presented in a consistent format.

Clearer direction from the Federal Energy Regulatory Commission (FERC) on how such data are to be presented would be very helpful. Special attention is required to depict more clearly the flows across inter-regional seams.

3. The economic value of curtailed transactions.

The Department looks forward to being able to draw upon both improved data and the results of a wide range of relevant studies in its 2012 Congestion Study.

Acronyms and Abbreviations

AC	Alternating Current	GW	GigaWatt (1 billion or 10 ⁹ watts)
ACC	Arizona Corporation Commission	HAWG	WECC's Historical Analysis Working Group
ACEEE	American Council for an Energy Efficient Economy	HVDC	High Voltage Direct Current
AEP	American Electric Power	ICTE Staff	Entergy's Transmission Manager
AFC	Available Flowgate Capacity	IDC	Interchange Distribution Calculator
AP	Allegheny Power	IEPR	Integrated Energy Policy Report
APS	Arizona Public Service	ISO	Independent System Operator
ATC	Available Transfer Capability	ISO-NE	Independent System Operator – New England
AWEA	American Wind Energy Association	LADWP	Los Angeles Department of Water and Power
BGE	Baltimore Gas & Electric	LAGN	Louisiana Generating, LLC
BLM	Bureau of Land Management	LBNL	Lawrence Berkeley National Laboratory
BPA	Bonneville Power Administration	LGEE	Louisville Gas and Electric Energy
BRA	Base Residual Auction	LMP	Locational Marginal Price
BTA	Biennial Transmission Assessment	LMPPCs	Congestion component of Locational Marginal Prices
CAISO	California Independent System Operator	MAPP	Midcontinent Area Power Pool
CapX	Capacity Expansion	MAPP	Mid-Atlantic Power Pathway
CEC	California Energy Commission	MISO	Midwest Independent System Operator
CPUC	California Public Utility Commission	MW	MegaWatt (one million or 10 ⁶ watts)
CSP	Concentrating Solar Power	MWh	MegaWatt-hours (1 million or 10 ⁶ watt-hours)
DC	Direct Current	NARUC	National Association of Regulatory Utility Commissioners
DG	Distributed Generation	National Corridor	National interest electric transmission corridor
DOE	U.S. Department of Energy	NERC	North American Electric Reliability Corporation
EI	Edison Electric Institute	NPCC	Northeast Power Coordinating Council
EIA	Energy Information Administration	NREL	National Renewable Energy Laboratory
EPAct	Energy Policy Act of 2005	NYISO	New York Independent System Operator
ERCOT	Electric Reliability Council of Texas	NYRI	New York Regional Interconnect
EWITS	Eastern Wind Integration and Transmission Study	OASIS	Open Access Same-Time Information System
FCM	Forward Capacity Market		
FERC	Federal Energy Regulatory Commission		
FPA	Federal Power Act		
FRCC	Florida Reliability Coordinating Council		
GHG	Greenhouse Gas		

OATI	Open Access Technology International	SDG&E	San Diego Gas & Electric
PATH	Potomac-Appalachian Transmission Highline	SPP	Southwest Power Pool
PEPCO	Potomac Electric Power Company	SWAT	Southwest Area Transmission
PG&E	Pacific Gas & Electric	TEP	Tucson Electric Power
PJM	PJM Regional Transmission Organization	TEPPC	WECC's Transmission Expansion Planning and Policy Committee
PSEG	Public Service Enterprise Group	The Department	U.S. Department of Energy
Recovery Act	American Reinvestment and Recovery Act of 2009	TrAIL	Trans-Allegheny Interstate Line
RETI	California Renewable Energy Transmission Initiative	TCC	Transmission Congestion Contracts
RMR	Reliability-Must-Run	TLR	Transmission Loading Relief
RPS	Renewable Portfolio Standards	TVA	Tennessee Valley Authority
RRO	Regional Reliability Organization	WECC	Western Electricity Coordinating Council
RTEP	PJM's Regional Transmission Expansion Plan	WGA	Western Governors' Association
RTO	Regional Transmission Operator	WIRAB	Western Interconnection Regional Advisory Board
SCE	Southern California Edison	WOTAB	West of the Atchafalaya Basin
SERC	Southeast Reliability Corporation	WREZ	Western Renewable Energy Zone
		WUMS	Wisconsin Upper Michigan System

1. Overview

Congestion occurs on electric transmission facilities when actual or scheduled flows of electricity across a line or piece of equipment are restricted below desired levels. These restrictions may be imposed either by the physical or electrical capacity of the line, or by operational restrictions created and enforced to protect the security and reliability of the grid. The term “transmission constraint” may refer either to a piece of equipment that restricts power flows, an operational limit imposed to protect reliability, or to a lack of adequate transmission capacity to deliver potential sources of generation without violating reliability requirements. Because power purchasers typically try to buy the least expensive energy available, when transmission constraints limit the amount of energy that can be delivered into the desired load center, these constraints (and the associated congestion) will impose real economic costs upon energy consumers. In the instances where transmission constraints are so severe that they limit energy deliverability relative to consumers’ electricity demands, grid reliability can be compromised.

This study shows (to the extent publicly available data permit) where electricity congestion and transmission constraints occur across the eastern and western portions of the United States’ bulk power system. Congestion varies over time and location as a function of many factors, including energy use and production patterns across the grid, and changes in the availability of specific assets (such as power plants or transmission lines) over time. This analysis indicates general patterns of congestion—broad areas where the transmission congestion reflects imbalances between electric supply and demand that create significant costs, perhaps including adverse impacts on reliability.

The costs of congestion may be measured in terms of economics or reliability, as discussed below for

Critical Congestion Areas and Congestion Areas of Concern. But transmission congestion—up to and including a complete lack of transmission—can also limit development of new resource areas, as experienced over the past decade for renewable resources; in these cases, the congestion cost is a failure to achieve consumers’ desires and government policy goals. Such areas may be identified below as part of a Conditional Constraint Area.

1.1. Legislative Requirements for This Study

The Energy Policy Act of 2005 (EPAAct) added section 216(a) to the Federal Power Act (FPA), directing the Secretary of Energy to conduct a study of electric transmission congestion by August 2006, and every three years thereafter. The FPA section 216(a) congestion study for 2009 identifies transmission congestion and constraints in the Eastern and Western Interconnections; the Electric Reliability Council of Texas (ERCOT) is statutorily excluded from it. Based on the study, and comments from states and other stakeholders, the Secretary shall issue a report, which may designate any geographic area experiencing electricity transmission capacity constraints or congestion that adversely affects consumers as a national interest electric transmission corridor (National Corridor). In determining whether to designate a National Corridor the Secretary may consider the effects of congestion on the area’s economic vitality and development, on its fuel diversity, and on energy independence, national energy policy and national security.³ Designation of an area as a National Corridor is one of several preconditions required for possible exercise by the Federal Energy Regulatory Commission (FERC) of “backstop” authority to approve the siting of transmission facilities in that area.

³Federal Power Act, section 216(h), 16 U.S.C. 824p(h).

In August 2006, the U.S. Department of Energy (DOE) issued the *2006 National Electric Transmission Congestion Study*.⁴ That study identified two Critical Congestion Areas (the Mid-Atlantic, extending from New York down into Virginia, and Southern California), four Congestion Areas of Concern (Seattle-Portland, the San Francisco Bay Area, Phoenix-Tucson, and New England), and several Conditional Congestion Areas where significant congestion would result if large amounts of new renewable, coal or nuclear generation were developed without simultaneous development of associated transmission capacity (Montana-Wyoming, Dakotas-Minnesota, Kansas-Oklahoma, Illinois-Indiana-Upper Appalachia, and the Southeast). It explained the rationale for identifying these areas, including both historic and projected data about electricity production and use.

Based on the findings of the 2006 study, and subsequent study and input, the Department issued a report and order designating two National Corridors in October 2007.⁵

The present document identifies areas that are transmission-constrained, but it does not make recommendations concerning existing or new National Corridor designations. The Department may or may not take additional steps concerning National Corridors at some future time.

This study fulfills the requirements of FPA section 216(a). It also fulfills new analytical requirements added by Section 409 of the American Recovery and Reinvestment Act (Recovery Act), which stipulated that the 2009 Congestion Study is to include:

- 1) An analysis of the significant potential sources of renewable energy that are constrained in accessing appropriate market areas by lack of adequate transmission capacity;
- 2) An analysis of the reasons for failure to develop the adequate transmission capacity;

- 3) Recommendations for achieving adequate transmission capacity;
- 4) An analysis of the extent to which legal challenges filed at the State and Federal level are delaying the construction of transmission necessary to access renewable energy; and
- 5) An explanation of assumptions and projections made in the study, including
 - a) Assumptions and projections relating to energy efficiency improvements in each load center;
 - b) Assumptions and projections regarding the location and type of projected new generation capacity; and
 - c) Assumptions and projections regarding projected deployment of distributed generation infrastructure.

1.2. Outline of This Study

This study revisits the Congestion Areas identified in the 2006 study to assess whether they remain congested in light of recent trends and actions concerning energy use and infrastructure development. As directed by the Recovery Act, it also looks in depth at the potential for domestic renewable energy development and where additional transmission capacity is needed to enable such development. As in the 2006 study, this study addresses the Eastern and Western Interconnections but it does not include ERCOT (per statutory direction).

Chapter 2 presents the study's approach and methods.

Chapter 3 addresses the issues related to renewable energy development and transmission availability, including Recovery Act requirements, and identifies Type I and Type II Conditional Constraint Areas.

Chapter 4 reviews congestion and constraints in the Eastern Interconnection. It also looks at the Congestion Areas identified in the 2006 study and

⁴The *2006 National Electric Transmission Congestion Study* can be accessed at http://www.oe.energy.gov/DocumentsandMedia/Congestion_Study_2006-9MB.pdf.

⁵The Department's *National Electric Transmission Congestion Report and Order* designating the Mid-Atlantic Area National Interest Electric Transmission Corridor (Docket No. 2007-OE-01) and the Southwest Area National Interest Electric Transmission Corridor (Docket No. 2007-OE-02) can be accessed at http://nietc.anl.gov/documents/docs/FR_Notice_of_5_Oct_07.pdf.

reevaluates the level of congestion in each area. Similarly, Chapter 5 examines congestion and constraints in the Western Interconnection and updates the status of the areas identified in 2006.

Chapter 6 provides information about how to file comments on the study and discusses some of the Department's concerns and plans regarding the achievement of future transmission adequacy.

2. 2009 National Electric Transmission Congestion Study— Study Approach and Methods

2.1. Study Process

Like the 2006 *National Electric Transmission Congestion Study*, the 2009 study looks at a variety of historic and projected information about transmission congestion across the nation’s two major electric grids. Also like the 2006 study, the 2009 study examines congestion using a number of metrics, including—for existing lines—information on line usage, transaction service denials, and electricity price differentials between locations within a single market area.

The 2009 study differs methodologically from the previous study in that in 2006 the Department worked with analysts and consultants to develop independent projections of congestion in the Eastern and Western Interconnections. The 2006 projections were used to provide context to three additional information sources for each region—indicators of congestion derived from historic data on the use of existing lines, independent reports of existing congestion issues prepared by industry or stakeholder commentators about the regions studied, and independent projections of future conditions in the regions prepared by industry members and stakeholders (for purposes other than the Department’s use). In planning for the 2009 study, the Department determined that it would not conduct or sponsor congestion projections specifically for the 2009 study, but would draw instead upon the many studies prepared by others through independent, credible planning entities and processes.

2.2. Information Collection and Public Consultation

As in the 2006 study, the Department conducted an extensive public outreach and consultation process.

This process began in 2006, following publication of the 2006 study, with a request for public comment on the 2006 study and suggestions of additional topics that should be addressed in the 2009 study.

In 2008, the Department issued a request for information and documents that it should take notice of in preparing the 2009 study. This request was sent to the governors’ offices in the 48 contiguous states, to the chairs of the 48 contiguous states’ utility regulatory commissions, to members of the electric industry through their trade associations, and to electric reliability entities.⁶ The Department received a total of 41 responses directing attention to numerous documents. The respondents are listed in Appendix A, and the actual responses have been posted on DOE’s website for the study.⁷

The Department conducted six public regional workshops and one public technical conference to seek stakeholder information and views for the study. These meetings were announced through notices in the *Federal Register*, letters to many stakeholders, and requests to many specific stakeholders to participate as speakers. The meeting dates and locations were:

- Regional Workshops:
 - San Francisco, CA (June 11, 2008)
 - Oklahoma City, OK (June 18, 2008)
 - Hartford, CT (July 9, 2008)
 - Atlanta, GA (July 29, 2008)
 - Las Vegas, NV (August 6, 2008)
 - Chicago, IL (September 17, 2008)

⁶The Edison Electric Institute, National Rural Electric Cooperative Association, American Public Power Association, Electric Power Supply Association, National Association of Regulatory Utility Commissioners, and the Working Group for Investment in Reliable and Economic Electric Systems.

⁷See <http://congestion09.anl.gov/index.cfm>.

- Technical Conference:
 - Chicago, IL (March 25-26, 2009)

Detailed information about these meetings was posted on-line beforehand, and each meeting was broadcast in real-time using webcasting capabilities for those who could not attend the meeting in person. Transcripts and presentations from each meeting were posted afterward.⁸ The agendas and a list of the organizations participating in these meetings are shown in Appendix B.

Department staff also invited direct consultation about transmission congestion and the 2006 and 2009 studies, and met with stakeholders and members of the public to hear their views.

2.3. Transmission Congestion, Congestion Metrics, and Cautions

Transmission congestion occurs when actual or scheduled flows of electricity on a transmission line or across a piece of transmission equipment are restricted below the level that grid users desire (for instance, to bring low-cost electricity into a load center or move electricity out from a generation point to customers). The Transmission Expansion Planning and Policy Committee (TEPPC) of the Western Electricity Coordinating Council (WECC) says, for example, that “Path congestion implies that capacity is not available when needed by the market or to serve native load.”⁹ Those restrictions could be caused by limited physical or electrical capacity of the line, or by operational restrictions created to protect grid reliability. The term “transmission constraint” may refer to either a piece of equipment that creates a physical limit to the amount of electricity that can flow across it, an operational limit imposed to protect reliability, or to a lack of adequate transmission capacity to serve potential sources of generation without violating reliability requirements.

When congestion limits flows between two points, a dispatcher may have to redispatch generation (usually at higher cost) on the side of the constraint where additional generation is needed to ensure that sufficient electricity is available to meet loads; if the dispatcher is unable to redispatch sufficient generation, he or she may have to curtail delivery to certain loads to maintain the system’s overall operational balance and reliability.

Because transmission congestion occurs when insufficient electricity can flow from one point to another, transmission congestion can be evidenced in at least three ways—as electrical usage of the equipment up to or near its safe limits, as price differentials or economic cost differentials between different parts of the grid, and in extreme conditions, as a reliability problem that results from the inability to deliver enough electricity to meet customer’s electricity demands. Each of these measures can be expressed in quantitative metrics, discussed below. However, as Chapters 4 and 5 will discuss, there are limited amounts of publicly available data to quantify and evaluate congestion.

Transmission Usage Metrics

This study evaluates historical congestion using congestion metrics similar to those developed for the 2006 study. Specifically, these metrics quantify the percentage of time when the electricity flow across a particular path or flowgate¹⁰ exceeded 75%, 90% or 99% of its operating transfer capability. These metrics quantify how heavily the path or flowgate is loaded (i.e., 99% loading means the line is essentially operating at full capacity); this can affect both the physical and economic dimensions of congestion.

Specific transmission usage measures can reflect differing aspects of usage, and yield differing results:

⁸Transcripts and presentations for these meetings can be found at <http://www.congestion09.anl.gov/pubschedule/index.cfm> and <http://congestion09.anl.gov/techws/index.cfm>.

⁹TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council’s Transmission Expansion Planning Policy Committee, Part 3—Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov/>, p. 27.

¹⁰In the Western Interconnection, a “path” often refers to several transmission lines that are closely related; in the East, no such paths have been formally identified, but the important constraints have been identified as “flowgates.”

- Actual electricity flows are a direct measure of the level of utilization.
- Net schedules are a measure of expected utilization developed shortly before the time of actual utilization, based on contractual commitments to deliver electricity.
- Curtailments are measures of changes to scheduled utilization that are made during the course of real-time operations.
- Requests for transmission service are a measure of reservations for future utilization, made in advance of and often as a pre-requisite for, scheduling contractual commitments to deliver electricity.

If sufficient high-quality data exist for various transmission paths or flowgates, the transmission data can be sorted and ranked according to considerations including directional flows or schedules, seasonal usage, heavy and lightly loaded hours.

The fact that a line is heavily loaded does not necessarily mean that it is congested, since congestion is defined to mean an inability to serve all transmission users' requests. Often, there is no supporting information available on transmission requests that could not be fulfilled and there is no information on transmission requests that were not made because it was known in advance that the request could not be fulfilled. Similarly, heavy line loading does not necessarily represent a reliability problem. North American Electric Reliability Corporation (NERC) rules place strict limits on line loadings to ensure that lines can be operated to these limits reliably at all times, so a heavily loaded line is still operating within pre-established safe operating limits. Finally, continuous heavy loading of certain lines within these limits (especially radial lines designed to transport the output of dedicated power plants), may neither reflect congestion nor pose a threat to reliability if there is no additional generation seeking to transport power over these lines.

Transmission Reliability Metrics

In operational terms, a principal indicator of transmission reliability problems is the inability to deliver enough electricity to loads to keep supply and demand in balance in real time; this is a particular

problem for areas that constitute "load pockets," where energy demand can approach and occasionally exceed the combined capability of in-area generation plus transmission-enabled energy imports. In planning terms, transmission reliability reflects whether transmission assets can be operated within safe system operating limits and reliability standards, as determined by NERC- and FERC-approved requirements. For the purposes of this study, these reliability limits are assumed to determine the operational limits of the transmission system; in other words, the reliability-related operating limit for a flowgate sets its maximum allowed use, and desired use above that flow level constitutes congestion.

For this study, a transmission loading relief (TLR) event is the relevant reliability metric indicating that transmission congestion exists. As explained in Chapter 4, a transmission operator calls a TLR when flow over one or more flowgates threatens to violate operating limits; the TLR requires limiting flows and transactions on one or more lines to avoid the potential violation. TLRs are often associated with specific grid events such as storms and equipment maintenance events that can render particular generation and transmission assets unavailable and change the pattern of electricity flows across the grid. Chapter 4 reviews the distribution of TLR events in the Eastern Interconnection.

Economic Congestion Metrics

The PJM Regional Transmission Organization (PJM) Market Monitor explains that:

Congestion occurs when available, least-cost energy cannot be delivered to all loads for a period because transmission facilities are not adequate to deliver that energy to some loads. When the least-cost available energy cannot be delivered to load in a transmission-constrained area, higher cost units in the constrained area must be dispatched to meet that load. The result is that the price of energy in the constrained area is higher than in the unconstrained area because of the combination of transmission limitations and the cost of local generation Congestion reflects the underlying characteristics of the power system

including the nature and capability of transmission facilities and the cost and geographical distribution of generation facilities. Congestion is neither good nor bad but is a direct measure of the extent to which there are differences in the cost of generation that cannot be equalized because of transmission constraints.¹¹

Several metrics are useful for describing and quantifying economic congestion. These can be calculated from actual transactions within areas that operate centrally-organized spot electric markets (the Northeast, Midwest and California) or derived from simulations using production cost models:

- Shadow prices represent the value of a one-MW increase in flow across a transmission path as a function of a change in the path's capacity.
- Nodal prices (called locational marginal prices or LMPs within organized wholesale electric markets) represent the change in the price of electricity at a particular location as a function of an incremental change in load or generation; the existence of significant variations between LMP levels within an area indicates the impact of transmission congestion between the nodes.
- Congestion rent for a particular point (flowgate or path) on the grid equals the shadow price times the path's total flow or limit; this indicates the increased cost that customers or the system as a whole are paying due to the existence of the transmission constraint (absent hedging mechanisms such as Financial Transmission Rights).

Because economic measures of actual congestion are only available within regions that operate centrally organized wholesale electric markets, they are discussed principally in Chapter 4 for the Eastern Interconnection, and in Chapter 5 with respect to Southern California.

Cautions—What Should Be Done About Congestion?

This study identifies regions of the country that are experiencing congestion. Even if a transmission

path is congested, however, this does not necessarily mean that transmission expansion is warranted to reduce congestion or its impacts for an affected region. In some cases, transmission expansion could shift the constraint from one point on the grid to another without materially changing the overall costs of congestion. In other cases, the cost to build new facilities to remedy congestion more comprehensively over all affected lines may exceed the cost of the congestion itself; therefore, remedying the congestion would not be economic. In still other cases, alternatives other than transmission, such as increased local generation (including distributed generation), energy efficiency, energy storage and demand response may be more economic than transmission expansion in relieving congestion.

Thus, finding that a path or flowgate is congested should lead to further study of the costs and impacts of that congestion, as well as a careful regional study of a broad range of potential remedies to larger reliability and economic problems. Although congestion is a reflection of legitimate reliability or economic concerns, not all transmission congestion can or should be reduced or “solved.” The purpose of this study is to identify congestion, not make determinations on whether or how it should be mitigated.

2.4. Historical Data and Analysis

One of the important inputs to the Department's assessment of electric transmission congestion in the Eastern and Western Interconnections in this study is historical information on the actual utilization of the transmission system in calendar year 2007. Independent technical analyses of historical transmission system utilization were conducted for each Interconnection. Through the Lawrence Berkeley National Laboratory (LBNL), the Department funded Open Access Technology International (OATI) to study the Eastern Interconnection. Similarly, it funded TEPPC to perform the Western Interconnection analysis. The OATI findings for 2007 historical congestion in the Eastern Interconnection

¹¹Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), at http://www.monitoringanalytics.com/reports/PJM_State_of_the_Market/2008.shtml, p. 50.

are discussed below and in Chapter 4; the TEPPC findings for 2007 historical congestion in the Western Interconnection are reviewed below and in Chapter 5. Market structures and reliability management practices vary from region to region, affecting how each region manages grid operations and measures transmission congestion. Table 2-1 shows in summary form the wide disparities in data availability across the nation with respect to transmission congestion metrics.

Eastern Interconnection Historical Data and Analysis

The Department contracted with OATI to conduct a first-ever assessment of publicly available historical data on transmission congestion in the Eastern Interconnection.¹² The study was based solely on

data for 2007. Information on actual electricity flows and on some aspects of scheduled flows in the Eastern Interconnection is not publicly available. Accordingly, OATI collected and assessed information on three core transmission procedural elements that affect how transmission is managed—and how congestion can be measured with publicly available data—in the Eastern Interconnection: transmission reservations, transmission schedules, and real-time operations. Distinct metrics were calculated for each of the three procedures, as explained in Chapter 4.

Western Interconnection Historical Data and Analysis

The Department also supported work by TEPPC to analyze historical congestion on the Western grid,

Table 2-1. Publicly Available 2007 Data and Metrics on Transmission Utilization, Eastern and Western Interconnections

	WECC	ISO-NE	NYISO	PJM	MISO	MAPP	SPP	SERC (VACAR, TVA, Southern, Entergy)	FRCC
Operational and Reliability Metrics									
Transmission Reservations	No	No	No	Yes	Yes	Yes	Yes	Yes	Yes
Transmission Schedules	Yes 2007 data for 23 major paths only	Yes	Yes	No	No	No	No	No	No
Actual Flows (U75, U90, U99)	Yes 2007 data for 23 major paths only	No	No	No	No	No	No	No	No
Transmission Loading Relief Actions	No TLRs are not used in WECC	No (Resolved through market re-dispatch)	No (Resolved through market re-dispatch)	Yes	Yes	Yes	Yes	Yes	Yes
Economic Metrics									
Market Organization	No organized spot market outside California; only economic data from WECC modeled forecasts	Organized spot markets	Organized spot market	Organized spot market	Organized spot market	No organized spot market	Organized spot market (day-of only)	No organized spot market	No organized spot market
Locational Marginal Prices	No	Yes	Yes	Yes	Yes	No	Yes (for second half of 2007)	No	No
Shadow Prices for Binding Constraints	No	Yes	Yes	Yes	Yes	No	No	No	No

¹²Open Access Technology International (OATI) (2009). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, at <http://www.congestion09.anl.gov/>.

using data for the period November 1, 2006 through October 31, 2007.¹³ TEPPC has long-standing agreements with WECC members that allow it to collect and analyze information on actual electricity flows in addition to public information on transmission schedules. Accordingly, metrics calculated from this information can quantify transmission utilization as the percentage of time when the electricity flow across a particular path exceeds 75%, 90% or 99% of its operating transfer capability. This is the same data source and analytical approach used in the 2006 study to gauge historical congestion in the Western Interconnection.

Although electricity flows vary from season to season and year to year as a function of electricity demands, fuel costs and availability, new generation additions and losses, and other factors, the patterns reflected in this one-year snapshot correspond generally to broader patterns of past historical congestion. In fact, viewed with the same congestion metrics used in the 2006 study, the grid congestion patterns for the 2007 data are consistent with the results of TEPPC’s analysis of 2004 data, as reported in the 2006 study. The TEPPC analysis is reported in WECC’s “2008 TEPPC Annual Report, Part 3.”¹⁴

2.5. Future Conditions and Congestion Across the Grid

As noted in Chapter 1, for the 2009 study the Department did not conduct independent analysis of future grid conditions to forecast transmission congestion. Instead, the Department reviewed an extensive body of studies and analyses on current and future market and reliability conditions conducted by other entities—state agencies, independent system operators (ISOs) and regional transmission organizations (RTOs), NERC, regional reliability organizations (RROs), regional market monitors, trade

associations, and consulting firms. Many of these materials were provided to the Department by stakeholders and public commenters.¹⁵

For the 2009 study, the Department revisited each of the congestion areas identified in the 2006 study and reassessed the 2006 conclusions in light of currently available information on present conditions and expected, high-probability new facilities or congestion-reducing programs. Each of these congestion area reassessments entailed detailed review of the various studies and information sources discussed above; the sources reviewed for this study are listed in Appendix C, which includes more than 325 entries.

2.6. Assumptions Made in the Study

The Recovery Act requires the Department to explain the “assumptions and projections made in the Study, including—(A) assumptions and projections relating to energy efficiency improvements in each load center; (B) assumptions and projections regarding the location and type of projected new generation capacity; and (C) assumptions and projections regarding projected deployment of distributed generation infrastructure.”¹⁶

As explained above, the Department did not conduct independent modeling analyses or forecasts of future transmission congestion in either interconnection, but examined a variety of analyses and studies for each region of the nation. These studies developed by others reflect differing goals, analytical methods, data sources, and underlying assumptions and projections. The Department has not attempted a systematic review to identify and explain the assumptions and projections used in these studies.

¹³ TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council’s Transmission Expansion Planning Policy Committee, Part 3—Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov/>.

¹⁴ *Ibid.*

¹⁵ These materials are posted at <http://www.congestion09.anl.gov/>.

¹⁶ 111th US Congress (2009). *American Recovery and Reinvestment Act (ARRA) of 2009, Section 409*, at http://frwebgate.access.gpo.gov/cgi-bin/getdoc.cgi?dbname=111_cong_bills&docid=f:h1enr.pdf.

3. Renewable Energy Development and Transmission Availability

The Recovery Act directed the Department of Energy to include the following elements in the *2009 National Electric Transmission Congestion Study*:

- (1) An analysis of the significant potential sources of renewable energy that are constrained in accessing appropriate market areas by lack of adequate transmission capacity;
- (2) An analysis of the reasons for failure to develop the adequate transmission capacity;
- (3) Recommendations for achieving adequate transmission capacity; and
- (4) An analysis of the extent to which legal challenges filed at the State and Federal level are delaying the construction of transmission necessary to access renewable energy.¹⁷

These issues are addressed in this chapter, which identifies a large Conditional Constraint Area relating to renewable energy.

3.1. Background

3.1.1. Conditional Congestion Areas Identified in the 2006 Study

The Department's *2006 National Electric Transmission Congestion Study* presented the concept of a Conditional Congestion Area, described as an "area where . . . significant congestion would result if large amounts of new generation resources were to be developed without simultaneous development of associated transmission capacity [T]hese areas are potential locations for large-scale development of . . . generation capacity to serve distant load centers."¹⁸ The 2006 study identified the areas shown in Figure 3.1 as Conditional Congestion

Areas, and commented that "DOE believes that affirmative government and industry decisions will be needed in the next few years to begin development of some of these generation resources and the associated transmission facilities."¹⁹

The 2006 study included Conditional Congestion Areas for fossil and nuclear resource development. The current study does not identify resource-specific Conditional Congestion Areas, as explained later in this chapter.

In the 2006 study, the Department further commented:

Timely development of integrated generation and transmission projects in these areas will occur only if states, regional organizations, Federal agencies, and companies collaborate to bring these facilities into existence

. . . [A] combination of broad regional planning and more detailed local planning are essential to develop a set of preferred transmission, generation and demand-side solutions—to meet regionally-perceived needs, and to build adequate regional support and consensus around those solutions. The likelihood of successful outcomes, with or without designation of National Corridors, will be enhanced if the parties involved in the regional planning also address cost allocation and cost recovery for desired solutions.²⁰

3.1.2. Recent Developments

Much has happened to advance development of renewable energy resources and related transmission since the 2006 study was issued, including:

¹⁷ 111th US Congress (2009). *American Recovery and Reinvestment Act (ARRA) of 2009, Section 409*, at http://frwebgate.access.gpo.gov/cgi-bin/getdoc.cgi?dbname=111_cong_bills&docid=f:h1enr.pdf.


¹⁸ U.S. Department of Energy (DOE) (2006a). *National Electric Transmission Congestion Study*, at http://www.oe.energy.gov/DocumentsandMedia/Congestion_Study_2006-9MB.pdf, p. ix.

¹⁹ *Ibid.*

²⁰ *Ibid.*, p. 40.

- A greater commitment to inclusive, transparent, and systematic regional planning across the nation, spurred by the issuance of Order 890 by FERC.
- Advances in the commercial availability and competitiveness of wind and solar technologies, leading to the interconnection of over 15,000 MW of new wind generation and 3,668 MW of solar thermal and photovoltaic plants across the country during 2006, 2007 and 2008.²¹
- Adoption of Renewable Portfolio Standards requiring substantial and increasing amounts of renewable energy purchases in 34 states and the District of Columbia.²²
- Increases in the cost and price volatility of oil, coal and natural gas,²³ which made renewable energy sources more desirable as a price hedge and as a domestic contributor to national energy security.

Figure 3-1. 2006 Conditional Congestion Areas

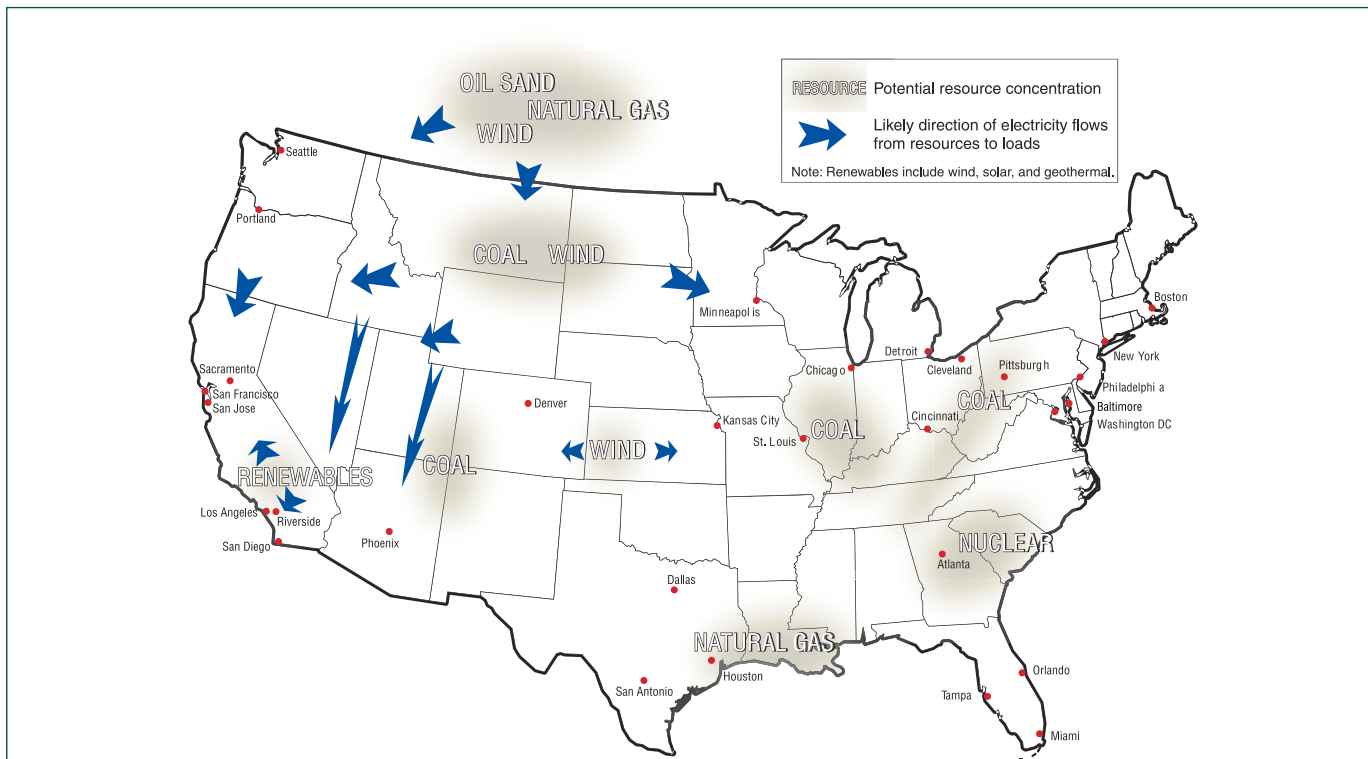

Source: U.S. Department of Energy (DOE) (2006a). *National Electric Transmission Congestion Study*, at http://www.oe.energy.gov/DocumentsandMedia/Congestion_Study_2006-9MB.pdf, p. ix.

²¹ Wind data from Energy Information Administration (EIA) (2007a). “Form EIA-860 Database Annual Electric Generator Report,” at <http://www.eia.doe.gov/cneaf/electricity/page/eia860.html>, Table 4; and American Wind Energy Association (AWEA) (2008). *Annual Wind Industry Report, Year Ending 2008*, at <http://www.awea.org/publications/reports/AWEA-Annual-Wind-Report-2009.pdf>; solar data from Solar Energy Industries Association (SEIA) (2009). *U.S. Solar Industry Year in Review 2008*, at http://www.seia.org/galleries/pdf/2008_Year_in_Review-small.pdf, p. 2.

²² Database of State Incentives for Renewables & Efficiency (DSIRE) (2009). *Rules, Regulations and Policies for Renewable Energy*, at <http://www.dsireusa.org/summarytables/rrpre.cfm>.

²³ Energy prices in general have been notably more volatile since 2005, as noted in sources including the *Wall Street Journal* (Gordon Brown and Nicolas Sarkozy, “Oil Prices Need Government Supervision,” July 8, 2009: “For two years the price of oil has been dangerously volatile, seemingly defying the accepted rules of economics”); the *New York Times* (Jad Mouawad, “Swings in Price of Oil Hobble Forecasting,” July 5, 2009: “Volatility in the oil markets in the last year has reached levels not recorded since the energy shocks of the late 1970s and early 1980s . . .”); and the Center for American Progress (Amanda Logan and Christian Weller, “Signals on the Fritz: Energy Price Volatility Impedes Investment by Creating Uncertainty,” June 2009: “Energy prices in general and gasoline prices in particular have gone from red hot to stone cold to red hot again in the span of a few months in recent years.”) These observations are validated by the price histories of natural gas and oil from sources such as the Bureau of Labor Statistics, International Monetary Fund and TFC Commodity Charts.

- A greater national concern with the possible impacts of climate change and global warming, with uncertainty about carbon and greenhouse mitigation strategies making non-polluting renewable generation sources more attractive relative to fossil-fueled sources.
- Greater recognition of the value of renewable generation (particularly wind) for rural economic development and job creation in the renewable sector.
- Numerous studies examining the potential for and value of renewable development in different regions, spanning detailed transmission planning, as in the case of the Midwest Independent System Operator (MISO) and ERCOT; and broad analyses and policy recommendations, such as the DOE–American Wind Energy Association (AWEA)–National Renewable Energy Laboratory (NREL) study, *20 Percent Wind by 2020*, and popularized recommendations by T. Boone Pickens and former Vice President Al Gore.

The combined impact of these developments has been to create a significantly more favorable environment for the development of new renewable energy resources, and associated infrastructure requirements, including additional transmission capacity. These changes have also stimulated interest in clarifying federal energy policy through legislation in several key areas, including climate change, carbon regulation, and regulatory matters pertaining to the development of new transmission capacity.

Utility investment in new transmission has increased significantly over the past five years, and much of that new investment has interconnected new wind and solar resources. The Edison Electric Institute (EEI) reports that its members’ total recent and planned investment in transmission to support renewable resource integration (for renewable projects exceeding \$20 million per project) exceeds \$21 billion as of early 2009.²⁴ However, EEI points

out that there are challenges in building transmission for renewables—“While fossil resources have some flexibility to site in close proximity to the existing transmission grid, siting of renewable resources is largely dictated by nature, due to the location of the resource and the inability to transport the fuel source.”²⁵ EEI further cautions:

[G]iven the nature of power flows and grid design on alternating current (AC) transmission systems, a transmission project cannot be dedicated to a specific renewable resource project or limited to transmitting renewable energy Most [transmission] projects . . . are multi-faceted; that is, they are not in development solely to integrate renewable resources. In most cases, transmission projects address an array of purposes and deliver a number of benefits, such as congestion relief, enhanced regional reliability, and reduced system losses.²⁶

The Department will issue grants in 2009 under the Recovery Act to improve the information base planners need and establish long-term self-sustaining infrastructure for interconnection-wide planning in the Eastern, Western, and ERCOT interconnections.

3.2. Potential Sources of Significant Renewable Energy Constrained by Lack of Adequate Transmission Capacity

The Recovery Act stipulated that this study should identify significant potential domestic sources of renewable energy that are constrained by lack of adequate transmission capacity. In responding to this assignment, the Department has drawn upon existing analyses to identify those geographic areas with high renewable resource potential, technology by technology, and offers commentary on their likely development path and the status of their transmission requirements.

²⁴Edison Electric Institute (2009). *Transmission Projects Supporting Renewable Resources*, at http://www.eei.org/ourissues/Electricity/Transmission/Documents/TransprojRenew_web.pdf, p. iv.

²⁵*Ibid*, p. iii.

²⁶*Ibid*, pp. iii-iv.

As described more fully below, the need for project interconnection and the lack of adequate transmission capacity are frequently a major obstacle to the development of large scale renewable energy projects. While some progress has been made, much more work is needed to address the challenges to new transmission projects to support a build-out of renewable energy. Major obstacles preventing prompt build-out of transmission capacity include: (i) need for more systematic regional and inter-regional analyses and planning of future transmission requirements; (ii) complications relating to appropriate cost allocation for new transmission capacity; (iii) complications relating to permitting across multiple jurisdictions, combined with the recent judicial curtailment of FERC's existing backstop siting authority;²⁷ and (iv) shortcomings in the queuing processes used to interconnect renewable energy electricity generation to the electric grid and the related construction of new transmission facilities. For many potential renewables projects, the issues of whether such transmission capacity will ever become available, and if so when, are at least as important as the likely cost of the transmission facilities and how the cost will be allocated. If it is necessary to wait five to fifteen years while new transmission is being planned, routed, reviewed by regulators, cost-allocated, and built, such delay and uncertainty can pose a more serious threat to project success than the actual cost of the transmission.²⁸ It will be necessary to address these challenges on an urgent basis to help facilitate the integration of greater renewable resources into the electricity supply.

A number of additional analyses are now under way to identify and geographically delineate renewable energy zones that contain significant amounts of high-quality renewable resources that could be commercially developed today or in the near future.

These analyses require detailed information to determine the quality of the renewable resource and the level of generation commercially likely given suitable transmission infrastructure; they are also using environmental suitability analyses and detailed geographic tools to exclude areas that by law, regulation or terrain are precluded from development. These analyses and other efforts include:

- The Western Renewable Energy Zone (WREZ) analysis, sponsored jointly by the Western Governors' Association (WGA) and the Department. This work was begun in 2008²⁹ and is discussed further below.
- The California Renewable Energy Transmission Initiative (RETI), begun in 2007, is identifying areas where renewable energy can be developed in the most cost-effective and environmentally benign manner, and the transmission corridors needed to access those areas.³⁰ Phase 1 of the RETI process estimated the amount of renewable energy that California would need to meet its future energy goals and conducted environmental and economic assessments of high-quality in-state renewable resource areas to identify the major electric transmission projects needed to access the renewable energy and deliver it to consumers.³¹ Phase 2 is developing a conceptual transmission plan to serve the renewable energy zones and Phase 3 will develop detailed plans for transmission service.³²
- Working with the MISO, the Midwest Governors have supported the *Regional Generation Outlet Study* and wind development scenarios in the *2008 Midwest Transmission Expansion Plan*. MISO recently worked with the Southwest Power Pool (SPP), Tennessee Valley Authority (TVA), and PJM to conduct the *2008-09 Joint*

²⁷In *Piedmont Environmental v. Federal Energy Regulatory Commission*, 558 F.3d 304 (4th Cir. 2009), the Court significantly limited FERC's authority to site transmission lines in National Corridors designated by the Department of Energy.

²⁸A recent study by LBNL found that, based on a review of transmission planning studies, the median projected cost of transmission to access wind generation is about \$300/kW, which is about 15% of the cost of building a new wind generating unit. Mills, A., R. Wiser, and K. Porter (2009), *The Cost of Transmission for Wind Energy: A Review of Transmission Planning Studies*. Lawrence Berkeley National Laboratory report LBNL-1417E, at <http://eetd.lbl.gov/EA/EMP/re-pubs.html>.

²⁹See <http://www.westgov.org/wga/initiatives/wrez/>.

³⁰See <http://www.energy.ca.gov/reti/index.html>.

³¹California Renewable Energy Transmission Initiative (RETI) (2009). *Renewable Energy Transmission Initiative (RETI), Phase IB, Final Report*, RETI-1000-2008-003-F, at <http://www.energy.ca.gov/2008publications/RETI-1000-2008-003/RETI-1000-2008-003-F.PDF>.

³²See additional RETI information at <http://www.energy.ca.gov/reti/documents/index.html>.

Coordinated System Plan to explore the transmission requirements associated with 5% and 20% wind development scenarios for the Eastern Interconnection.

- Individual states, including Texas, Arizona, Colorado, Utah, Michigan, Oregon and Hawaii, are also conducting or have completed analyses to identify specific renewable energy zones suitable for commercial renewable generation development with dedicated transmission facilities.

One example of such analysis is a work product from the Southwest Area Transmission (SWAT) Renewable Transmission Task Force, which has been studying Arizona, New Mexico, Nevada and Southern California. As Figure 3-2 shows, this regional task force has identified potential renewable generation locations by technology, mapped them

against land ownership, and identified current and conceptual electric transmission elements that could deliver this new generation to load centers in the study area.

The WREZ analysis is similar in purpose but covers a much larger area. In June 2009, the WGA and the DOE announced the preliminary identification of WREZs, as “areas . . . that feature the potential for large scale development of renewable resources in areas with low environmental impacts, subject to resource-specific permitting processes.”³³ The WREZ project has also created a modeling tool to estimate the delivered cost of renewables from specific source areas to load centers, including the costs of generation and transmission. The minimum size of a WREZ resource area is 1,500 MW for wind and solar energy within a 100-mile radius of the

Figure 3-2. SWAT Renewable Energy Zones and Current and Potential Transmission System



Source: Kondziolka, R. (2009). “Western Interconnection Subregional Planning and Development,” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm/>, slide 17.

³³ Western Governors’ Association (WGA) and U.S. Department of Energy (DOE) (2009). “Western Renewable Energy Zones – Phase 1 Report,” at <http://www.westgov.org/wga/initiatives/wrez/>, p. 2.


center. The screening process excludes lands where energy development is prohibited, such as national parks, or is unsuitable for other reasons. The WREZ areas are shown in Figure 3-3. The estimated total generation capacity located within the U.S. WREZ areas is about 163,000 GW of capacity, with potential annual energy production of about 450,000 GWh per year,³⁴ or about 11% of total U.S. generation in 2008.

The WREZ report also identifies renewable resources outside WREZ areas, which are

commercially viable renewable sources that may not need access to high-voltage transmission and may be dispersed and close to load; these can include biomass, landfill gas, small hydro, and a variety of decentralized renewables.³⁵

Outside Texas and the Southwest, few of these renewable energy zone analyses are complete. The next stage in the WREZ project, for example, is to facilitate the matching of wholesale electricity buyers with prospective developers of renewable generation; until this is done, it will not be clear

Figure 3-3. WREZ Renewable Energy Zones: WREZ Initiative Hub Map

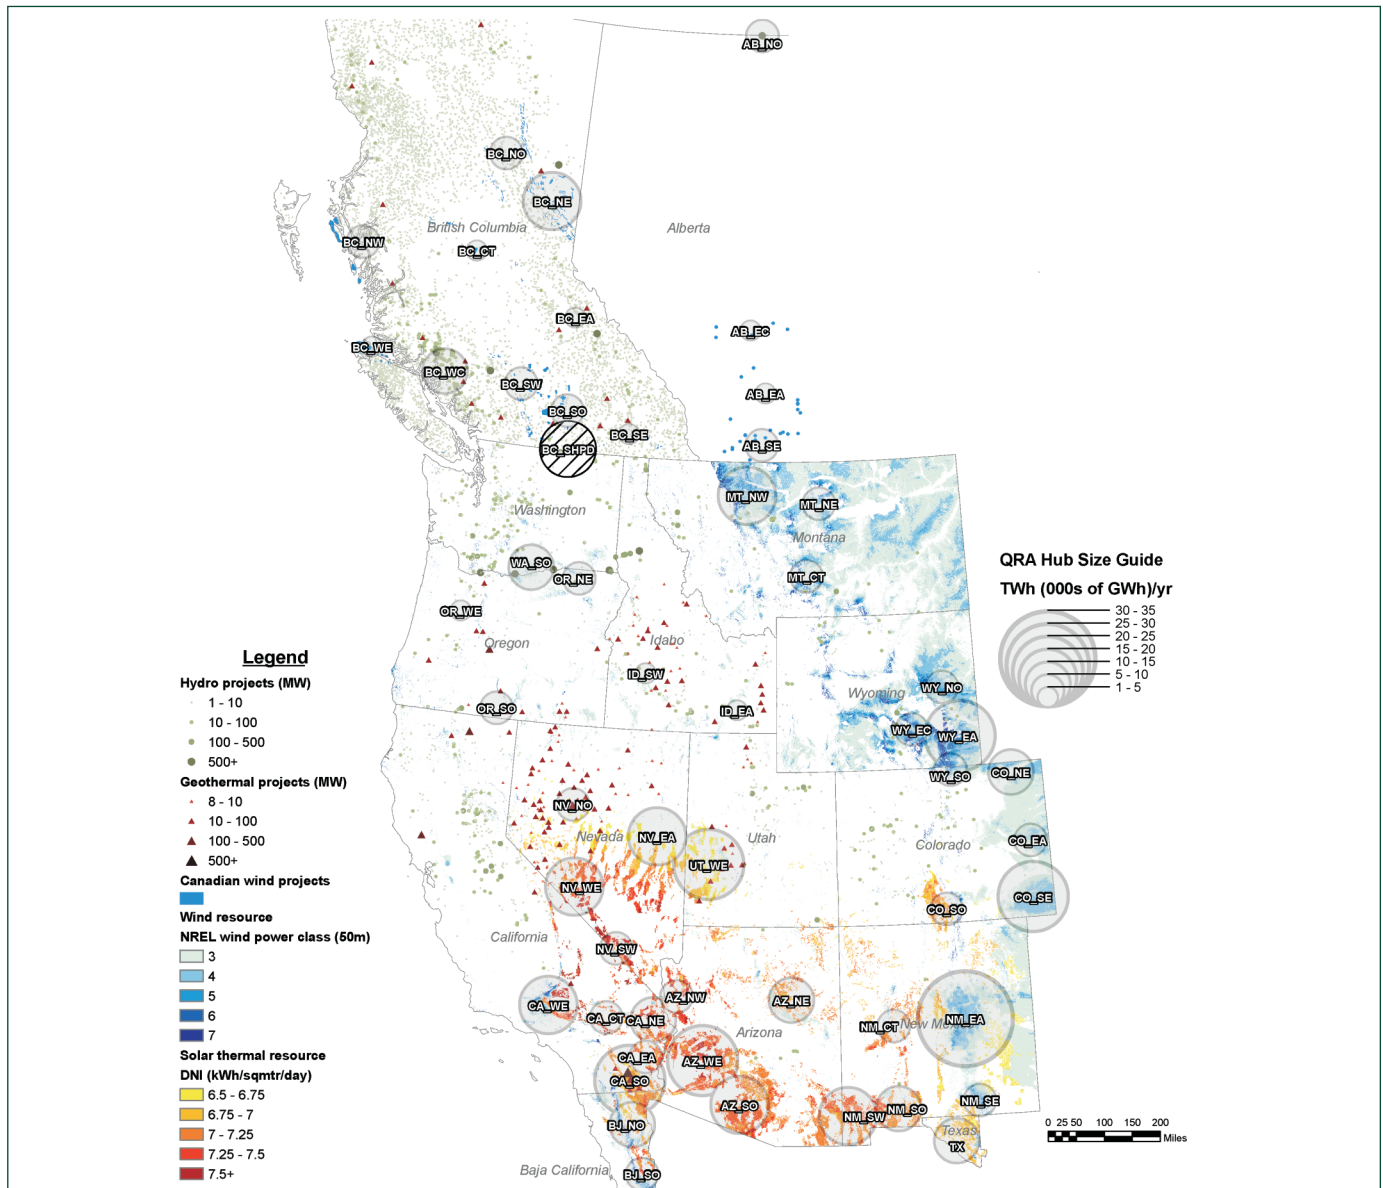

Source: Western Governors' Association (WGA) and U.S. Department of Energy (DOE) (2009). "Western Renewable Energy Zones – Phase 1 Report," at <http://www.westgov.org/wga/initiatives/wrez/>, p. 12.

³⁴ *Ibid.*, pp. 23-24.

³⁵ *Ibid.*, p. 17.

where new transmission capacity is needed. In the absence of more detailed information, this congestion study looks broadly at wide areas with rich renewable resource bases to identify geographic areas where renewable energy could be developed if it were served by sufficient transmission infrastructure. These areas will be identified in Section 3.3 below.

The rest of this section reviews the geographic locations of the nation’s principal renewable generation resources, including wind, solar photovoltaic, solar thermal and concentrating solar, geothermal, and biomass.

3.2.1. Wind Generation Resource Locations


The 2006 *National Electric Transmission Congestion Study* identified promising areas in the Dakotas

and Minnesota, Wyoming and Montana, and Kansas and Nebraska as areas where there are many proposals to develop commercial wind generation but insufficient transmission to support such generation development. However, the Recovery Act calls for an analysis of where there are significant potential renewable energy resources that could be developed given new transmission construction, not where there is strong development interest.

Figure 3-4 shows the location of significant on-shore and off-shore wind resources in the United States.

While the 2006 study identified areas with good terrestrial (on-shore) wind development potential, Figure 3-4 shows that much of the nation’s greatest wind resource potential lies off-shore. To date some off-shore wind generation projects have been

Figure 3-4. Domestic Wind Resources Map

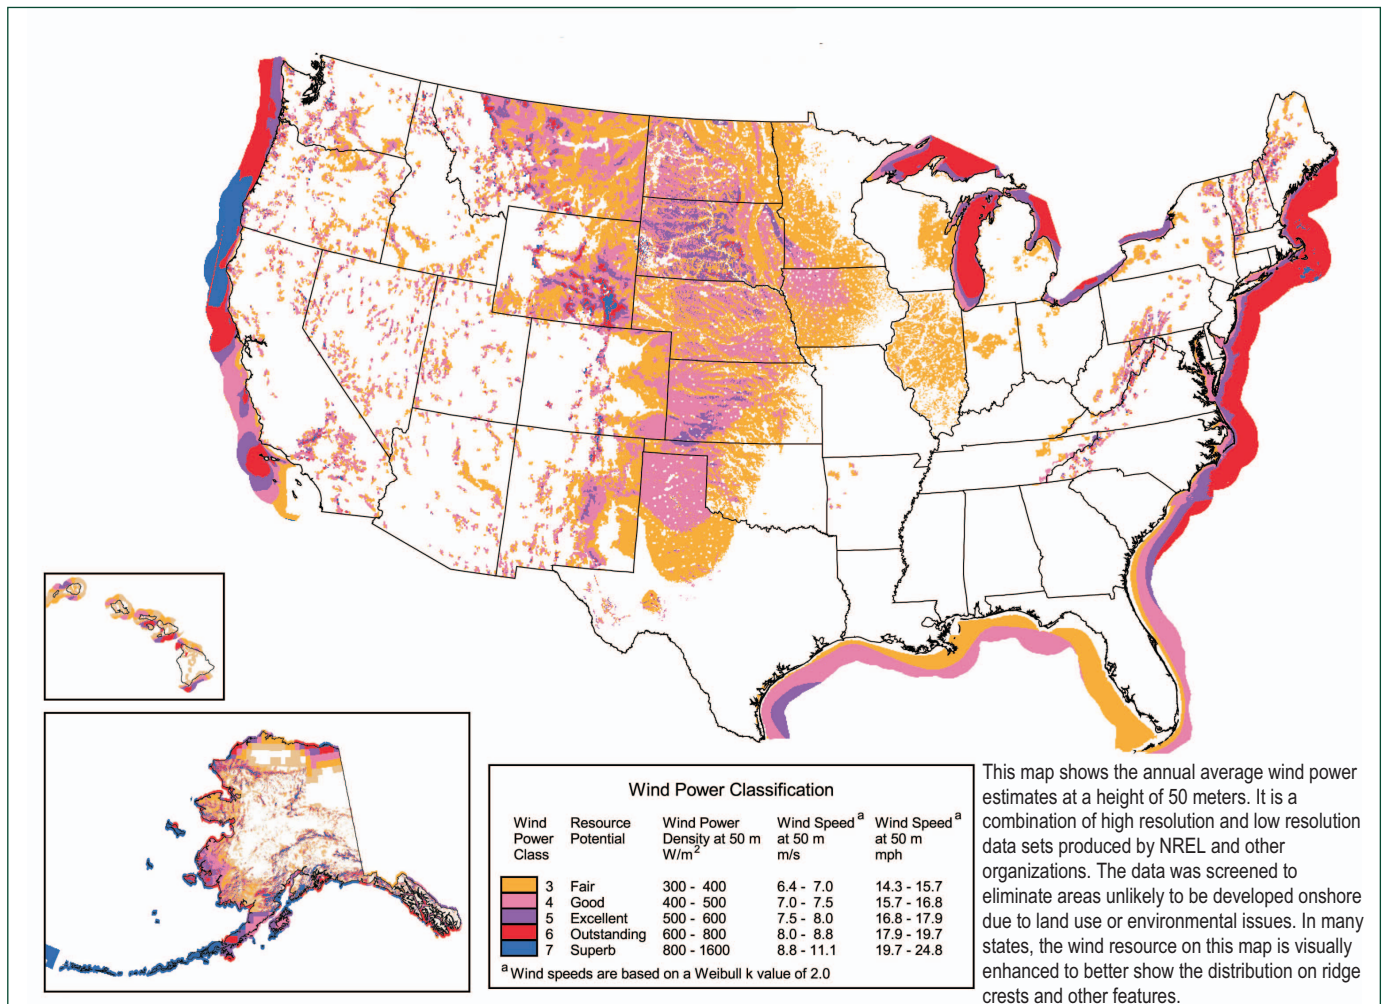

Source: National Renewable Energy Laboratory (NREL) (2009). “United States Wind Resource Map,” at http://www.windpoweringamerica.gov/pdfs/wind_maps/us_windmap.pdf.


proposed (off the coasts of Rhode Island, New Jersey, Delaware, Massachusetts, New York, Ohio, Georgia and Texas), but as yet none have been built in these waters. The challenges to off-shore wind development include public opposition, regulatory uncertainties, higher costs and greater uncertainties associated with building and operating generation and transmission in a harsh off-shore environment, and fluctuating prices for competing fuels that can affect project economics.

Figure 3-5 shows where significant wind development has already occurred in the nation (as of 2008). The match between actual wind development and strong wind resources has occurred primarily where there has been adequate transmission capacity to interconnect the new wind generators and deliver their electricity to loads, or in areas in which there is a willingness to build new

transmission capacity quickly without charging the full cost to new wind producers (as in ERCOT and California). Where there is high wind resource potential but little new wind development, those gaps occur principally because there is neither adequate transmission capacity to deliver wind generation, nor an expeditious way to build new transmission for that purpose. However, in the past few years utilities have proposed and regulators have approved a significant quantity of new transmission to connect new wind projects to loads. These transmission projects will enable significant amounts of new wind generation development in the next few years.

In 2008, 8,545 MW of new net wind generation capacity was brought on line, bringing total domestic wind capacity to 25,369 MW.³⁶ But 300,000 more MW wind capacity was waiting in interconnection

Figure 3-5. Wind Power Development in the United States, 2008 (Megawatts Installed by State)

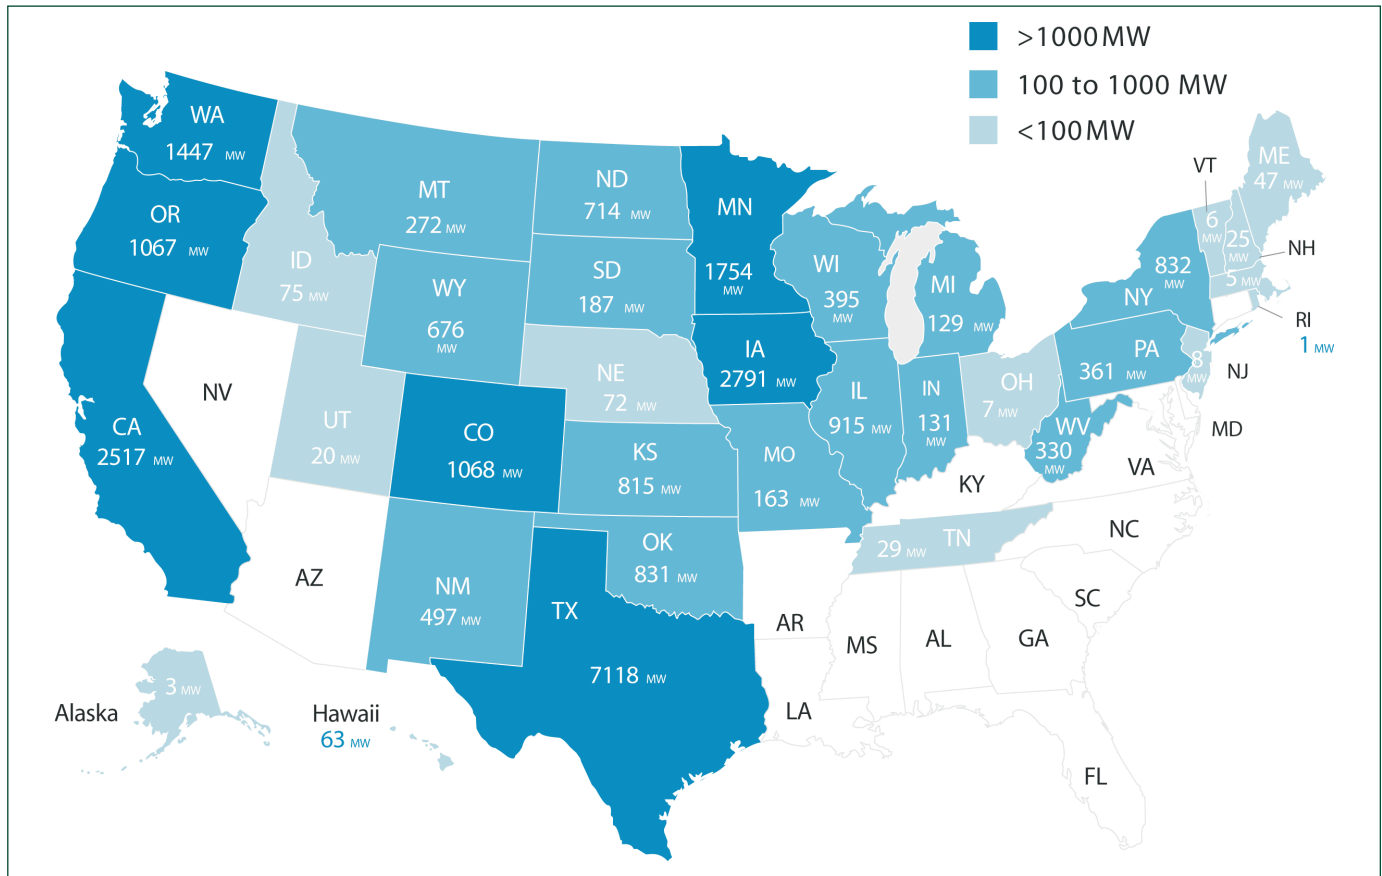

Source: American Wind Energy Association (AWEA) (2008). *Annual Wind Industry Report, Year Ending 2008*, at <http://www.awea.org/publications/reports/AWEA-Annual-Wind-Report-2009.pdf>, p. 9.

³⁶ American Wind Energy Association (AWEA) (2008). *Annual Wind Industry Report, Year Ending 2008*, p. 4.


queues across the nation at the end of 2008, as shown in Figure 3-6. As the American Wind Energy Association comments, “The proposed wind projects in these queues have applied for interconnection to the grid, but most of these wind plants cannot be built because there is insufficient transmission capacity to carry the electricity they would produce. While not all of these wind projects will ultimately be built, it is still clear that wind power development is outpacing the expansion and modernization of our electric grid.”³⁷

Several important policy developments have facilitated wind interconnection. In February 2007, FERC issued Order 890, which improved the ability of wind generation to access transmission by adopting cost-based energy imbalance calculation methods, requiring transmission providers to develop redispatch and conditional firm service methods, and requiring all transmission providers to participate in local and regional transmission planning processes. Later that year, FERC approved a new transmission cost allocation method proposed

by the California Independent System Operator (CAISO) for location-constrained resources (such as Tehachapi wind generation).

Development of an initial group of off-shore wind projects in the U.S. could begin soon. U.S. Interior Secretary Ken Salazar indicates that the Department of Interior expects “as many as a dozen proposals for offshore wind-energy projects in the coming months under a new federal program to expedite construction of renewable energy projects on federal land and in coastal waters.”³⁸ It further expects “federal permit applications to be submitted for 10 to 12 projects over the next few months, . . . each capable of generating at least 350 MW of electricity”³⁹ and estimates that wind energy on the U.S. outer continental shelf has the potential to generate 900,000 MW of power.⁴⁰ Officials in many eastern states are interested in developing off-shore wind close to metropolitan load centers, as an alternative or supplement to long-distance transmission from Midwestern and Canadian wind resource areas.

Figure 3-6. MW Wind in Regional Interconnection Queues

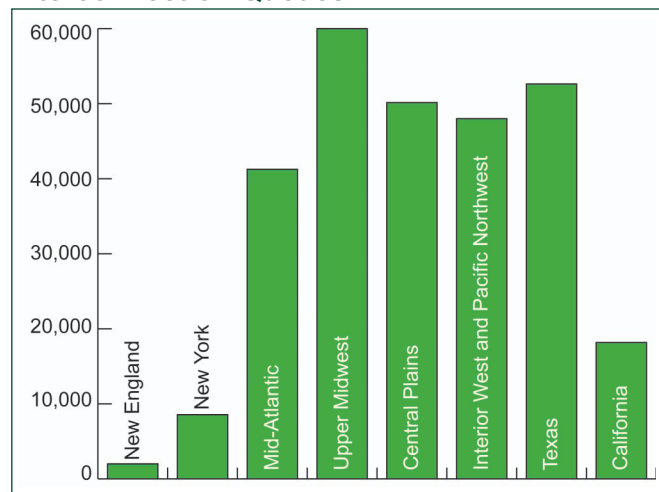

Source: American Wind Energy Association (AWEA) (2008). *Annual Wind Industry Report, Year Ending 2008*, at <http://www.awea.org/publications/reports/AWEA-Annual-Wind-Report-2009.pdf>, p. 5.

³⁷ *Ibid.*, p. 5.

³⁸ Tita, B. (2009). “Interior Secretary Salazar Expecting Surge in Offshore Wind Farms.” *Wall Street Journal*.

³⁹ *Ibid.*

⁴⁰ *Ibid.*

⁴¹ U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Solar Energy Technologies Program (2009). “Solar America Initiative,” at http://www1.eere.energy.gov/solar/solar_america/. Since distributed solar photovoltaics are small-scale generation sources that tend to be located at customer load centers, as with rooftop photovoltaic units, they do not require electric transmission and will not be discussed further in this study.

3.2.2. Solar Photovoltaic Resource Locations

The nation’s best solar resources are found in the southwestern United States, as illustrated in Figure 3-7; these areas are where most utility-scale (one megawatt and larger plants) photovoltaic generation is expected to develop. However, as photovoltaic technologies improve and costs fall while incentives spread, distributed small-scale photovoltaics are being installed in many areas of the nation, with photovoltaic initiatives as far north as Wisconsin, Michigan, Massachusetts, Oregon and New York.⁴¹

Most of the utility-scale solar photovoltaic projects that are now installed, under development, or proposed are located in the desert southwest, including the 550 MW Topaz Solar Farm and the 250 MW California Valley Solar Ranch in southern California.

3.2.3. Concentrating Solar Power and Solar Thermal Resources


Concentrating solar power (CSP) plants require large tracts of land with good solar resources; the Department estimates that a 250-MW plant with 6 hours of storage would require nearly 3 square miles of land.⁴² A model developed at NREL for concentrating solar plants using the parabolic trough Rankine cycle technology estimates that given land availability, storage costs, and solar availability, as much as 55 GW of CSP technology could be developed in the southern regions of California, Arizona and New Mexico, as shown in Figure 3-8 below. Current development of CSP projects is occurring in these regions, facilitated by utility power purchase contracts. The Solar Energy Industries Association indicates that dozens of

concentrating solar plants, representing thousands of MW of capacity, are moving toward installation, mostly in the deserts of California, Nevada, and Arizona, and in Florida.⁴³

3.2.4. Geothermal Resource Potential

Electricity is produced from geothermal energy by tapping hot underground rock, water, or steam through deep wells and using heated fluids or steam to drive turbines. Geothermal resources include hot water and rock at relatively shallow levels or miles below the surface, and can even include molten magma. In some cases geothermally heated fluids are piped directly to end-use facilities (e.g., district heating of community buildings, greenhouses, domestic or process hot water) rather than used to raise steam in boilers. The best domestic geothermal

Figure 3-7. National Solar Radiation Map, May 2007 Data

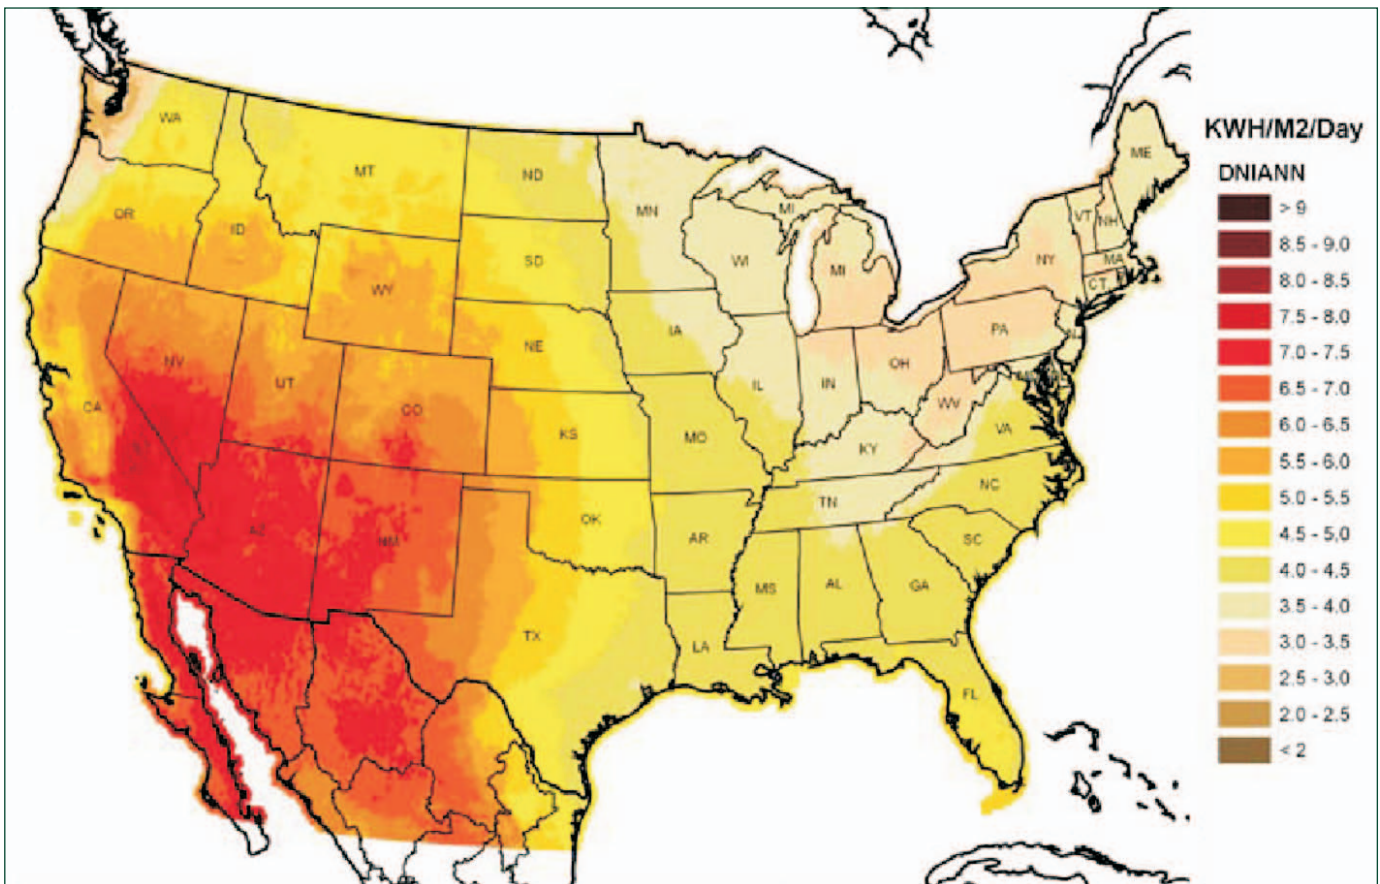

Source: Renne, D. (2008). "2008 Solar Annual Review Meeting, Solar Resource Characterization." National Renewable Energy Laboratory, at http://www1.eere.energy.gov/solar/review_meeting/pdfs/prm2008_renne_nrel.pdf, slide 4.

⁴²U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Solar Energy Technologies Program (2008). "Concentrating Solar Power." National Renewable Energy Laboratory, at <http://www1.eere.energy.gov/solar/pdfs/43685.pdf>, p. 2.

⁴³Solar Energy Industries Association (SEIA) (2009). *U.S. Solar Industry Year in Review 2008*, at http://www.seia.org/galleries/pdf/2008_Year_in_Review-small.pdf, pp. 6-7.

resources are located in the western states (as shown in Figure 3-9), Alaska and Hawaii.

A new analysis by the Department indicates that 126 geothermal projects are now in consideration or under development that could add 3,600 to 5,600 MW of new geothermal electric generation capacity over the next few years.⁴⁴ The Department cites two studies that suggest that geothermal energy could contribute as much as 100,000 to 517,800 MW to domestic electric supply, and that “geothermal energy, once restricted to naturally occurring hydrothermal fields in remote areas, could someday be operating in more locations and in greater proximity to large end-use markets.”⁴⁵

3.2.5. Biomass Resources

Unlike wind, solar, geothermal and hydro resources, biomass is diverse and less location-constrained than other renewable resources. Biomass-based renewables use agricultural feedstocks—wood wastes, agricultural wastes, dedicated crops and landfill or wastewater methane—as a fuel for direct combustion, gasified for combustion, or in a biochemical conversion to make a distilled fuel such as diesel or ethanol.

Because biomass can be widely grown and transported (whether as an input feedstock or as a converted end product), it is not essential for

Figure 3-8. Projected Concentrating Solar Power Capacity (MW) by Region in 2050



Source: Blair, N. (no date). “Concentrating Solar Deployment Systems (CSDS)—A New Model for Estimating U.S. Concentrating Solar Power Potential.” National Renewable Energy Laboratory, at http://www1.eere.energy.gov/solar/review_meeting/pdfs/p_55_blair_nrel.pdf, p.2.

⁴⁴U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Geothermal Technologies Program (2009). *National Geothermal Action Plan: Preliminary Draft*, p. 16.

⁴⁵*Ibid*, p. 2.

biomass-fueled electricity generation to occur at the point of fuel creation, nor does it necessarily require dedicated transmission, as is the case with wind, solar or geothermal generation. Further, because biomass resources that could be used as fuel for electric generation are located in many areas across much of the nation, there do not appear to be concentrated areas that are more obviously suitable for biomass development than others. Therefore, biomass resources will not be discussed further in this study.


3.3. 2009 Conditional Constraint Areas

In this study, the Department defines and identifies two types of Conditional Congestion Areas, Type I and Type II. A Type I area is one where it appears that the development of significant additional

generation—using existing technology with known cost and performance characteristics—is limited primarily by the availability of transmission capacity. By contrast, a Type II area is one with renewable resource potential that is not yet technologically mature but shows significant promise due to its quality, size, and location. If such resources become technologically mature (through additional R&D and experience with commercial-scale projects that would make their cost and performance parameters predictable), they might then be limited chiefly by transmission availability. If so, the affected area would then qualify for Type I status.

This study identifies a large Type I Conditional Constraint Area (Figure 3-10) where construction of major new transmission projects would enable development of thousands of MW of new renewable generation. Parts of this area have large

Figure 3-9. U.S. Geothermal Resource Map

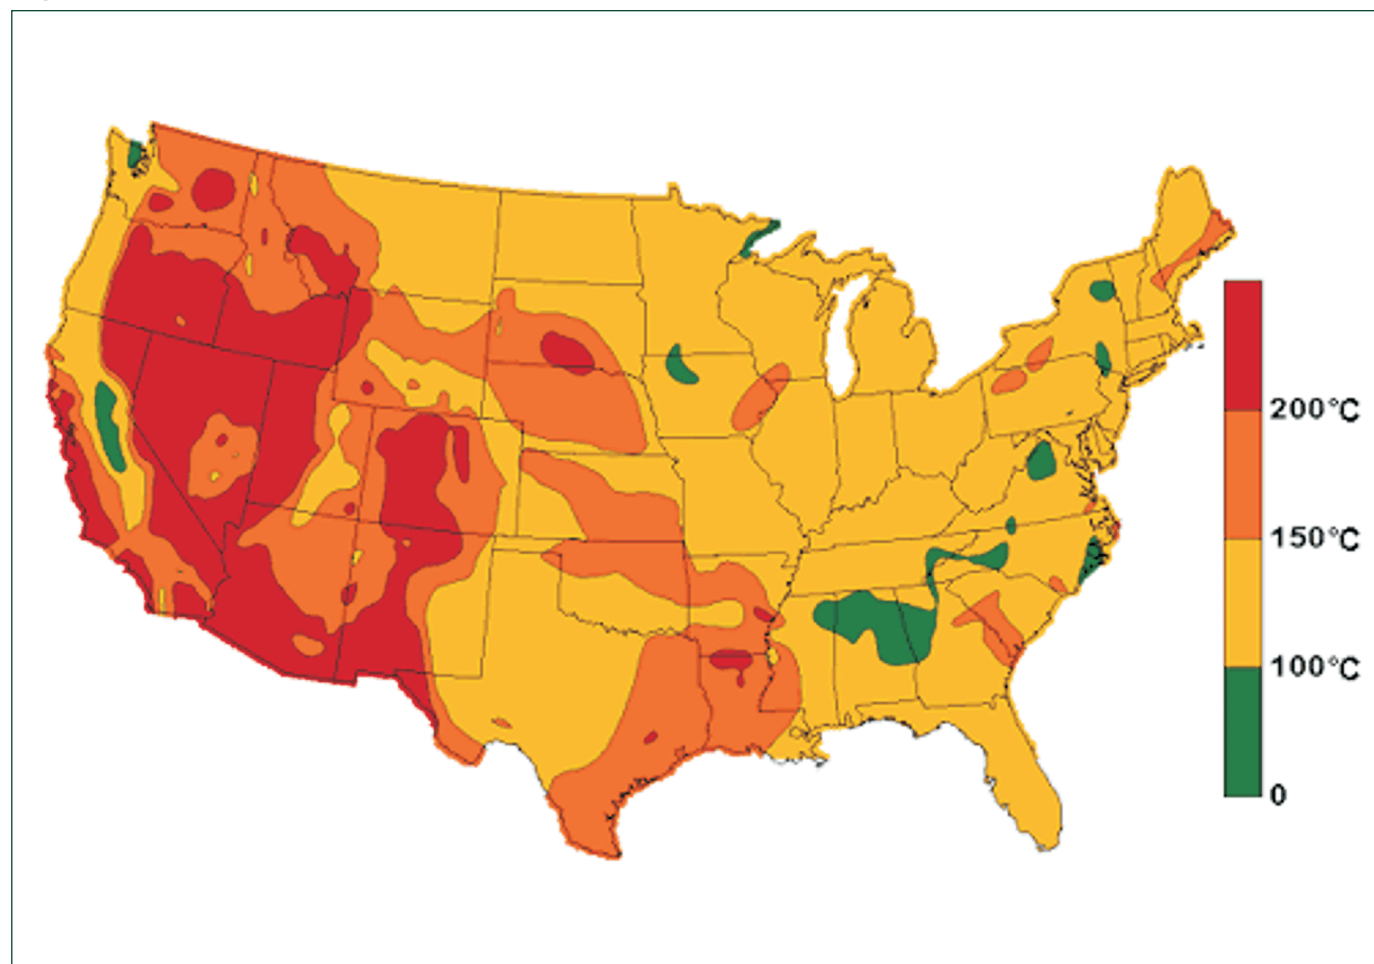

Source: U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Geothermal Technologies Program (2006). "U.S. Geothermal Resource Map," at <http://www1.eere.energy.gov/geothermal/geomap.html>.


numbers of generation proposals sitting in transmission access queues, where they have been delayed for years because the existing transmission network is not sufficient to deliver additional electricity from these points to load centers. Even though not all of the generation projects sitting in these queues will be economically competitive, and not all of them will be successfully completed (much less survive the transmission queue), the fact that these areas' queues are so large demonstrates the appropriateness of including the areas within the Type I Conditional Constraint Area.⁴⁶ Figure 3-10 also identifies several offshore Type II areas that have promising wind potential.

In the 2006 study, the Department identified several Conditional Congestion Areas specifically because of their potential for wind development. In this

study, building upon the review above of all of the significant renewable resources available for development, the Department takes a somewhat different approach:

1. When all of the areas identified by NREL as having strong resource development potential for wind, geothermal and photovoltaic energy are combined into a single map, as shown in Figure 3-10, it is clear that significant portions of the western states and much of the eastern coastal region could host renewable resource development. Further, many western areas could host more than one kind of renewable energy development.
2. The Department concludes that it is appropriate to consider the on-shore resource areas shown

Figure 3-10. 2009 Type I and Type II Conditional Constraint Areas

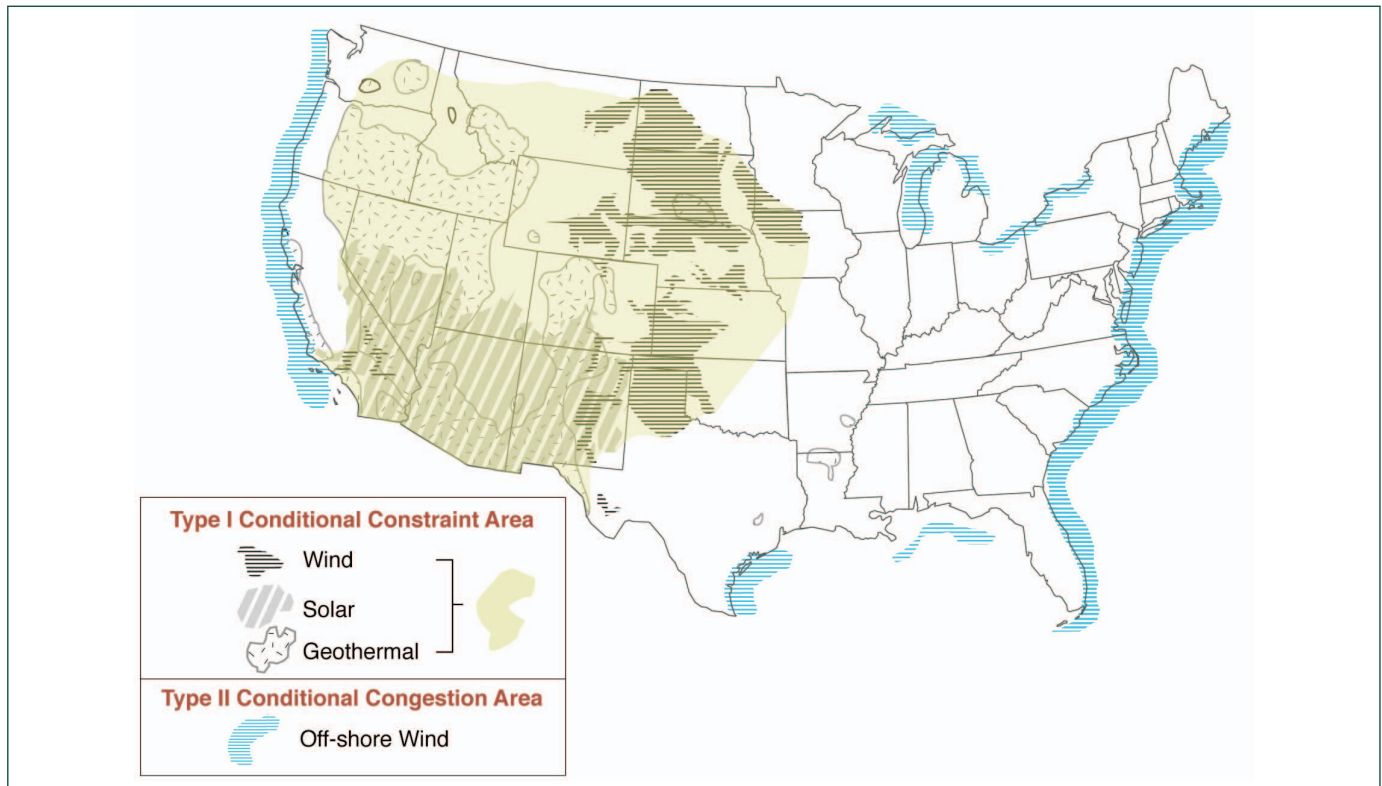

⁴⁶In March 2008, the Bonneville Power Administration (BPA), in order to identify the more speculative projects in its transmission queue, initiated a Network Open Season (NOS). Under the NOS, those seeking transmission capacity were asked to sign Precedent Transmission Service Agreements, which committed them to take service at a specified time and under specified terms. The NOS improves management of BPA's long-term transmission queue and provides a better understanding of market dynamics and what new infrastructure might be needed to support the evolving electrical needs of the region. At the close of the 2008 NOS, BPA had 153 requests from 28 customers for 6,410 MW of new long-term firm transmission service. Almost three-quarters of those requests are associated with wind generation, reflecting the region's momentum toward rapid development of renewable resources and the need to comply with state Renewable Portfolio Standards.

in the West and the upper Midwest as one very large Type I Conditional Constraint Area.⁴⁷

3. The Department also concludes that off-shore wind resources, though promising, still face many technological and economic hurdles and that the affected areas should be identified as Type II Conditional Constraint Areas.

At the same time, it is clear from current renewable development activities that many economically viable renewable resources exist outside the areas identified as having the best resource development potential. Some areas (such as Pennsylvania and West Virginia for wind and northern California for geothermal) are showing that they can develop substantial amounts of new renewable capacity in areas that NREL has not recognized as having high resource potential, without waiting for dedicated new transmission lines. Further, small-scale distributed renewables are being developed in some communities today, such as rooftop photovoltaics in Chicago and community wind in Minnesota, without need for new enabling transmission. The Department does not wish to imply that omission of an area from the Type I Conditional Constraint Area means that the omitted area has low quality or insufficient renewable resources, or that it would not be appropriate to build new transmission to facilitate major renewable resource development in those areas.

It is important to recognize that the economics of renewable resource development can vary widely, and that they are very location-specific. In many cases transmission access can make the difference between an economic and uneconomic project or development area. Such economic and geographic granularity must also consider the cost of transmission to access the resource,⁴⁸ and cannot be determined or conveyed in a national-scale study.⁴⁹

⁴⁷ Although Texas and specifically the region that makes up ERCOT is shown on the NREL maps as having significant renewable resource potential, this study does not include ERCOT within the Conditional Constraint Area, because the EPAct specifically excludes ERCOT from consideration in the study. ERCOT and the state of Texas are already doing a commendable job developing new transmission to facilitate renewable resource development.

⁴⁸ A recent study by LBNL found that, based on a review of transmission planning studies, the median projected cost of transmission to access wind generation is about \$300/kW, which is about 15% of the cost of building a new wind generating unit. Mills, A., R. Wiser, and K. Porter (2009), *The Cost of Transmission for Wind Energy: A Review of Transmission Planning Studies*. Lawrence Berkeley National Laboratory report LBNL-1417E, at <http://eetd.lbl.gov/EA/EMP/re-pubs.html>.

⁴⁹ It should be noted that the Department has not attempted to use any screen for economics or competitiveness to narrow down the resource-rich regions of the country. As discussed earlier in this chapter, the current renewable energy development zone analyses under way in Colorado, California, Arizona and elsewhere show that such screening depends on highly localized economic and engineering data and assumptions that are beyond the scope of a national study.

Much of the Type I Conditional Constraint Area also has potential for development of additional non-renewable generation as well as renewables— or instance, there are extensive coal and gas reserves in Montana and Wyoming near the wind resources, and natural gas lines can deliver fuel to power plants in most locations in the lower 48 states. A transmission project developed to open up new renewable resource areas could also be used to transmit non-renewable generation. A transmission line developed primarily to serve power from one source or area will probably carry electricity generated by various sources. One of the major benefits of a robust transmission network is that it enables grid operators to adjust the generation mix they are using in response to the intermittent nature of renewable electricity generation, as well as to other unanticipated events or conditions.

3.4. Reasons for the Failure to Develop Adequate Transmission for Renewables

In response to the Recovery Act, section 409, the Department finds a number of reasons why adequate transmission capacity has not been developed in some areas with large amounts of potential renewable resources:

- Until recently, new utility-scale renewable generation was rarely economically competitive with conventional fossil generation alternatives, particularly given the added cost of long-distance transmission. As a result, the transmission capacity we have now was usually built for other purposes.

- Renewable projects in particular have been subject to the “chicken and egg” timing problem—new transmission will not be built unless there is specific generation to deliver from and specific customers to deliver to, but remote renewables cannot be developed unless the transmission is there to serve them.
- Developers need to be sure there is a clear, predictable process for transmission project cost allocation and cost recovery, particularly if that project crosses more than one utility’s footprint and would serve a wider area; until recently, there have been few regional cost allocation schemes to recover the cost of large backbone transmission projects or portfolios of such projects.
- Until the past few years, transmission planning within the interconnections has been relatively localized rather than regional or interconnection-wide, so there was little analysis to support the idea of building regional and interregional high voltage transmission to open up large new renewable resource areas. Transmission planning requires broad scenario analyses that consider reliability and economic evaluations as well as detailed technical and engineering analyses, so it is a lengthy process to move from the concept of new transmission to a widely accepted transmission plan and from there through permitting and financing to actual construction.
- Because long-distance transmission is expensive, large transmission projects are very costly and difficult to finance and build for individual, independent renewable project developers. Until recently, only renewable projects developed by utility owners were able to ensure that required new transmission would be built.
- Because many significant renewable resource areas are far from loads, the transmission lines needed to serve them may cross multiple states and federal lands, requiring lengthy, costly, and potentially contentious and litigious environmental and regulatory permitting processes.
- The siting process can be hindered if state siting authorities do not address the multistate nature of many of the high-voltage electric transmission lines needed to transport renewable energy to

population centers. Under EPAct Congress gave FERC backstop authority to site transmission facilities in National Corridors, provided certain specific conditions had been met. FERC’s authority was severely curtailed, however, by a recent decision by the U.S. Court of Appeals for the Fourth Circuit. In *Piedmont Environmental v. Federal Energy Regulatory Commission*, 558 F.3d 304 (4th Cir. 2009), the Court significantly limited FERC’s ability to site transmission lines in National Corridors designated by the Department.

In *Piedmont*, the Court of Appeals struck down a FERC rule designed to implement its “backstop” transmission line siting authority granted under FPA § 216(b). The Court ruling significantly limits FERC’s authority to issue construction permits for interstate transmission lines located in National Corridors. This limitation on FERC’s transmission line siting authority could adversely impact efforts to site transmission across broad regional areas, such as will be needed for providing access to remotely located renewable energy resources. Moreover, the reach of the decision in this case appears to extend beyond the Fourth Circuit, because both the Public Service Commission of the State of New York and the Minnesota Public Utilities Commission were parties to the case.

3.5. Legal Challenges Delaying Transmission for Renewable Energy

The Recovery Act directs the Department to analyze and report on the extent to which legal challenges filed at the State and Federal level are delaying the construction of transmission necessary to access renewable energy. To research this issue, the Department conducted an informal inquiry with officials in various state energy offices, regional planning organizations, transmission companies and electric trade associations, and reviewed a decade of electric trade news coverage of proposed transmission project developments.

The Department interpreted “legal challenges filed at the State and Federal level” broadly, to encompass regulatory challenges before state utility

regulatory and permitting or siting agencies and similar challenges before state and federal environmental agencies, as well as court cases. The Department interpreted “transmission necessary to access renewable energy” to mean projects that would open up renewable resource-rich areas that were not previously served by transmission, rather than transmission projects that would serve a variety of generation sources including some renewables. Last, the Department interpreted “delaying the construction of transmission” broadly to include the permitting as well as the construction process, because legal challenges would more likely be raised to delay or deny permit issuance than they would during the construction phase, after a permit has been issued.

There are examples where transmission projects serving non-renewable resources have been delayed through lengthy permitting processes—such as American Electric Power’s (AEP) 765 kV line through West Virginia and Virginia, which was delayed for over ten years by factors that included environmental challenges to land use agency approval processes. More recently, proponents of the Trans-Allegheny Interstate Line (TrAIL) 500kV line project through Pennsylvania had to deal with lawsuits from property owners challenging the use of old right-of-way agreements. There are also examples where regulatory processes led to permit denials for proposed transmission projects, as with the Arizona Public Utility Commission’s denial of Southern California Edison’s (SCE) proposed Devers-Palo Verde 2 transmission line. All of these projects, however, were designed primarily to deliver generation from non-renewable sources.

The New York Regional Interconnect (NYRI) is the closest example found of a project that could serve renewable energy sources that was delayed (and possibly terminated) due to legal challenges. The NYRI project was a merchant direct current (DC) line proposed for construction from upstate New York, where it could pick up hydro generation and new wind projects planned in northern New York, off-shore in Lake Ontario, or elsewhere in Canada,

and deliver it to load centers in down-state New York, tying to the electric distribution system serving Manhattan and northern New Jersey.⁵⁰ NYRI has ceased its participation in the New York Public Service Commission’s siting process because it concluded that the New York Independent System Operator’s (NYISO) transmission tariffs, approved by FERC, would compromise its ability to recover the full costs of the transmission line.⁵¹ However, it is not clear that this result is due to legal challenges so much as to a failure by the project’s planners to identify an adequate, low-risk cost recovery mechanism.

Through the research described above, the Department has not found examples where legal challenges filed at the state and federal level are clearly delaying construction of transmission needed to access renewable energy. Among the cases where new transmission is now being built to open up new renewable resource-rich areas (as in Minnesota, California and Texas), the transmission projects worked through a deliberative but not hostile regulatory and permitting process that addressed grid engineering, siting, permitting, environmental, and cost allocation and cost recovery issues. None of these projects appears to have suffered inordinate legal challenges or delays in comparison to transmission projects targeted to serve non-renewable generation.

It is useful, however, to review several specific transmission and generation projects that, while not strictly meeting the statutory description of a transmission project serving renewable generation that has been delayed by legal challenges, are still relevant to the broader theme of developing transmission to serve renewables:

- The Cape Wind project, a proposed 454 MW wind generation project that would site 130 turbines in Nantucket Sound, has experienced extended delays from legal challenges filed before federal and state environmental and permitting agencies. Most of these legal challenges addressed the issue of developing the wind turbines offshore (with a variety of environmental issues

⁵⁰ Breslin, M. (2008). “New York’s HVDC Line Takes a Step Forward.” *Renewable Energy Transmission*, at http://nyri.us/pdfs/News/NYRI_Article-RenewableEnergyMagazine.pdf, p. 10.

⁵¹ Thompson, C. (2009). “Letter from Chris Thompson, President of NYRI,” at <http://nyri.us/>.

raised before the federal Minerals Management Service and state Division of Fisheries & Wildlife), but in 2008 the Cape Cod Commission denied siting of the 18-mile, 115 kV transmission line that would bring the wind power onto shore.

The Massachusetts Energy Facilities Siting Board then took review jurisdiction and overturned the denial, and the City of Barnstable filed suit challenging that review. Subsequently, the Barnstable Superior Court dismissed the suit⁵² and the City of Barnstable is preparing an appeal to the Massachusetts Supreme Judicial Court.⁵³ Opposition to the transmission line appears to be an alternate way to fight the off-shore generation project, rather than a challenge to transmission for its own sake.

- San Diego Gas & Electric's (SDG&E) Sunrise Powerlink transmission project is intended to deliver renewable energy 150 miles from the Imperial Valley to San Diego. SDG&E filed its initial request for approval to build the line at the California Public Utility Commission (CPUC) in 2005 and filed a new set of documents in August 2006; the CPUC approved the project in December 2008. The federal Bureau of Land Management (BLM) granted approval for the project to use federal lands in January 2009. The Utility Consumers' Action Network currently has an application pending before the CPUC requesting the Commission to reconsider its approval of the project, and intends to seek appellate court review of any adverse decision.⁵⁴ The project was hotly contested before the CPUC and the BLM on environmental grounds, including both land use and environmental impacts, and some critics questioned whether the line is justified on either reliability or economic grounds.

- The Montana-Alberta Tie Line, a proposed 214-mile, 230 kV, 300 MW line between Lethbridge, Alberta and Great Falls, Montana would enable development and delivery of wind generation in Montana. The regulatory approval process included scrutiny by the Montana Department of Environmental Quality, WECC, FERC, Canada's National Energy Board, and the Alberta Energy and Utilities Board.⁵⁵ Environmentalists' challenges in these proceedings reflected the concern that the line could transport electricity generated from Montana coal as well as wind generation,⁵⁶ as well as more specific issues relating to siting the line and its and environmental impacts.
- The CapX 2020 project (spearheaded by Xcel Energy with 11 other utilities) is a \$2 billion project building over 700 miles in three 345 kV lines to link wind farms in North and South Dakota to load centers in southern Minnesota and eastern Wisconsin. Press reports indicate that the lines are opposed by some environmental groups "questioning whether such a large project is necessary in light of new programs aimed at curtailing customer demand for electricity through energy efficiency and other programs."⁵⁷ Concerns about both need and environmental impact surfaced in routine agency regulatory proceedings rather than through the courts.
- A \$1.5 billion, 600-mile transmission project proposed by the Transmission Agency of Northern California (TANC), called the TANC Transmission Project (TTP), was terminated in mid-July 2009. TANC consists of 15 publicly-owned utilities in northern California that collectively serve more than one million customers. The line was intended, among other things, to enable the

⁵²Town of Barnstable v. Mass. Energy Facilities Siting Board, 25 Mass. L. Rep. 375, 2009 Mass. Super. LEXIS 108.

⁵³Ouellette, J. (2009). "Commission, Barnstable pursue Cape Wind lawsuits," *Wicked Local Yarmouth*, at <http://www.wickedlocal.com/yarmouth/news/x1438501070/Commission-Barnstable-pursue-Cape-Wind-lawsuits>.

⁵⁴Utility Consumers' Action Network (UCAN) (2009). "UCAN Files First (of Many) Appeals to Reverse CPUC's Sunrise PowerLink Approval," *UCAN News*, at http://www.ucan.org/energy/electricity/sunrise_powerlink/court_appeal_expected_fight_stop_sunrise_powerlink.

⁵⁵Tonbridge Power, Inc. (2008). "Tonbridge Power Receives Final DOE Permit to Construct MATL Transmission Line," at [http://www.tonbridgepower.com/News/2008%2017%2011%20TBZ%20Receives%20Final%20MATL%20Permit\(1\).pdf](http://www.tonbridgepower.com/News/2008%2017%2011%20TBZ%20Receives%20Final%20MATL%20Permit(1).pdf).

⁵⁶Brown, M. (2007). "Ill Winds for Montana Wind Power Project as Developer Eyes Different Site in California." Associated Press.

⁵⁷Cusick, D (2008). "Project That Could Boost Midwest 'Wind Belt' Faces Enviro Opposition." *Greenwire*.

delivery of renewable-based electricity. Three of TANC's major members withdrew their support for the line for a variety of reported reasons, including the potential for litigation by opponents of the line. Their withdrawal made the project financially infeasible for its remaining supporters. Although a range of alternative routes were under study, the line faced intense opposition from potentially affected local communities and landowners. Some homeowners asserted that just being included within the study areas reduced their property values.

In conclusion, while it appears that no new transmission project goes unchallenged, there is little evidence to date to suggest that transmission lines serving primarily renewable sources have experienced a different level of opposition or delay relative to lines for non-renewable generation. The cases reviewed suggest that transmission-related projects can be compromised or even killed by protracted regulatory proceedings and in some instances the apparent lack of an effective way to bring such proceedings to closure.⁵⁸

⁵⁸ See www.tanc.us, esp. TANC Transmission Project—Frequently Asked Questions, June 2009; also, *Transmission & Distribution World*, “TANC Commission Votes to Terminate TANC Transmission Project,” July 22, 2009, at <http://tdworld.com/newsletters/>.

4. Transmission Congestion in the Eastern Interconnection

4.1. Introduction

The 2006 *National Electric Transmission Congestion Study* identified two congestion areas in the Eastern Interconnection—the Mid-Atlantic Critical Congestion Area and the New England Congestion Area of Concern. These are shown in Figure 4-1. This chapter reviews developments in these areas since 2006 and determines whether these identifications are still appropriate, and whether new areas should be identified.


This chapter begins by discussing the metrics used to evaluate recent transmission congestion in the Eastern Interconnection, and then reviews congestion in 2007 across the interconnection. This section draws upon an analysis of historic congestion in the Eastern Interconnection conducted by OATI under contract to the Department’s LBNL.⁵⁹ It also examines the Mid-Atlantic and New England areas today, comparing current and projected conditions against the problems identified in the 2006 study, to determine whether they continue to exhibit congestion problems. Chapter 4 concludes with a review of the Conditional Congestion Areas identified in 2006 for potential coal and nuclear power development, and discusses whether any new congestion areas should be identified in the Eastern Interconnection.

4.2. Congestion Metrics Overview

This section provides an overview of three complementary elements that affect how transmission is managed and how congestion is measured in the Eastern Interconnection. The three elements examined are Transmission Reservations, Transmission Schedules, and Real-Time Operations. This section discusses the temporal relationships among the elements, the ways in which the Eastern transmission

operators differ in their implementation of these elements, the data that are publicly (and not publicly) available to calculate metrics pertaining to these practices, and finally, the interpretation and significance of the metrics in understanding congestion in the Eastern Interconnection.

Figure 4-1. Eastern Critical Congestion Area and Congestion Area of Concern Identified in the 2006 National Electric Transmission Congestion Study

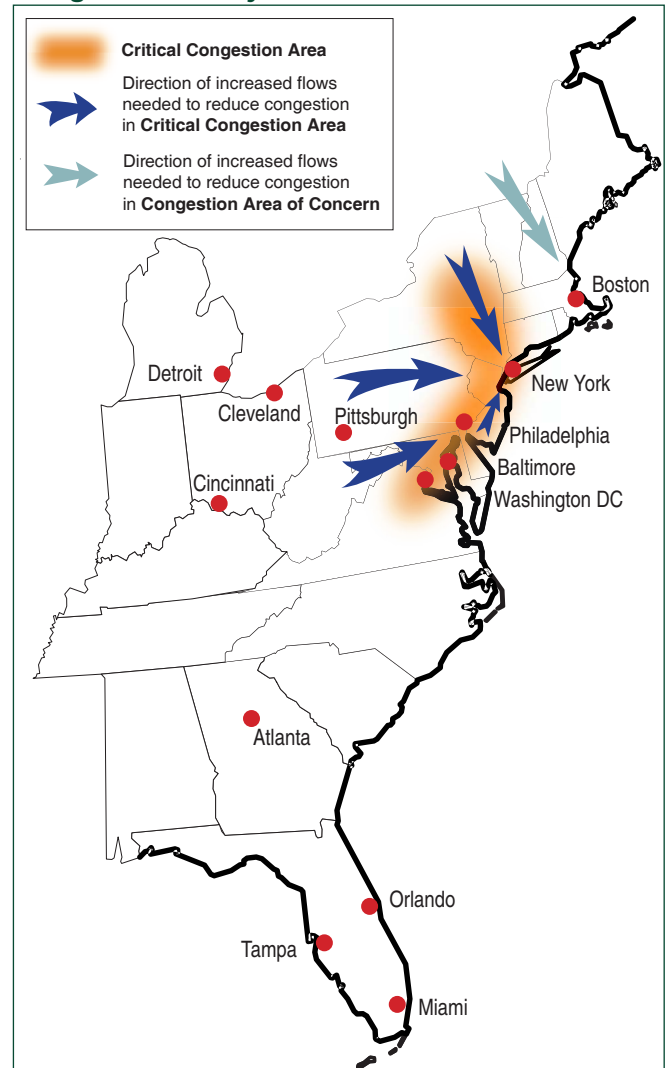

⁵⁹ OATI’s analysis and conclusions are published in a report, *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, available at <http://www.congestion09.anl.gov/>.

4.2.1. Transmission Reservations

As a result of FERC Orders 888 and 889, all transmission operators are required to make timely information publicly accessible about the availability of transmission service on their systems. This information is posted on OASIS websites. The posted information provides the basis for reservations of transmission service. Reservations may be made for varying time horizons, ranging from an hour to a year, and may be for either firm or non-firm service. In portions of the Eastern Interconnection, available capacity is posted for flowgates (available flowgate capacity or AFC), which represent combinations of electrically related transmission elements along a

defined path. In other portions of the Eastern Interconnection, available capacity is posted for contract paths (Available Transfer Capability or ATC), which represent the transfer capability available between adjacent zones or balancing areas.

OATI collected posted AFC and ATC data from all OASIS sites in the Eastern Interconnection. OATI used the absence of available transmission capacity (that is, ATC or AFC = 0) as the principal metric for congestion using the transmission reservation data. The logic for this interpretation is that if ATC or AFC = 0, then either the flowgate or the path it is on is already fully subscribed.

Flowgates and Contract Paths

In the Eastern Interconnection, analysts in some areas refer to transmission congestion occurring on a “contract path”; analysts in other areas refer to congestion occurring on a “flowgate.” This distinction arises because transmission capabilities in the Eastern Interconnection are described in two different ways. In some areas transmission is characterized as flowing between a source (point of generation) and a sink (point of delivery) along a contract path; in other areas transmission is characterized as flowing over intermediate, electrically related transmission facilities between a source and sink, called flowgates.

Although electricity flows according to the laws of physics (which means that an AC electrical flow may occur on many power lines across multiple utilities, not on a specific line between the source and sink), the contract path concept assumes that the electricity flows along the most direct electrical path from source to sink. Contract paths represent the transfer capability between adjacent “balancing authorities.” (Under reliability requirements approved by FERC, a balancing authority is responsible for ensuring in real time that electricity demand and available electricity supplies are very nearly equivalent; because electricity demand is constantly changing, an exact match is not feasible, but the balancing authority is required to keep imbalances within a very narrow range.) Contract path descriptions essentially aggregate a group of

transmission facilities (lines and transformers) and routes into a single “path” between the source and sink (or two balancing authorities) and simplify some aspects of the electrical properties of the individual links between points within balancing authorities.

By contrast, a flowgate is made up of one or more transmission facilities (lines, transformers, and other equipment) that behave in closely related fashion with respect to the flow of electricity and transfer capability between adjacent zones. Flowgates are more numerous than contract paths, as power may flow over several flowgates between adjacent balancing authorities. Flowgates are monitored constantly for reliability purposes and become the focal point for curtailments when such actions are required in real-time operations. There are thousands of flowgates in the Eastern Interconnection.

There are millions of individual transmission elements (line segments, transformers, substations, capacitors, breakers, etc.) in the East. Aggregating these elements into functional groups that are closely related electrically, such as a path between two balancing areas or a flowgate, makes it easier to understand and talk about transmission facilities according to their purpose and location. Reliability or economic congestion concepts and measurement techniques are the same whether the congestion is measured on flowgates or on contract paths.

There are several limitations associated with this metric as a measure of congestion. First, while reservations are often a prerequisite for scheduling transmission, they are not always a necessary prerequisite; transmission is sometimes scheduled over a flowgate or path without first having a reservation in place, as some of the schedules are based on grandfathered agreements and/or are for native load service and do not require reservations. Second, the unavailability of transmission service for reservation does not provide any indication of whether a reservation might have been sought and subsequently denied.⁶⁰ Third, the availability of transmission service is affected by scheduled outages, which might lead to congestion during the time of the outage, but would not necessarily indicate congestion under non-outage conditions.

4.2.2. Transmission Schedules

Transmission schedules are determined by transmission system operators during day-ahead and day-of operations, using established procedures for both security-constrained unit commitment (day-ahead time frame) and security-constrained economic dispatch (day-of time frame). These procedures lead to the identification of congestion, defined as situations in which not all requested transactions can be accommodated and generating units must be re-dispatched to operate the transmission system within established reliability limits (i.e., production levels from plants across the area must be readjusted so as to meet local load requirements by substituting local generation for supplies that cannot be imported because of the transmission congestion).

There are significant differences in the way these schedules are determined by different transmission system operators. RTOs or ISOs that operate formal, centralized markets develop their schedules based on competitive offers submitted by generators, plus flows dictated by bilateral contracts.

Outside of centralized electricity markets, transmission system operators develop schedules based on flows under bilateral agreements between purchasers, generators and marketers. OATI did not examine the resulting schedules, regardless of how they were developed, because OATI focused instead on transmission reservations, which place an upper limit on acceptable flows.⁶¹

Aspects of the schedules developed by RTOs and ISOs are publicly available and this information provides economic insights into congestion within their markets. The information includes shadow prices⁶² of binding constraints, and the congestion component of LMPs. OATI collected lists of binding constraints (and in most cases the shadow prices of these constraints) and the congestion component of LMPs from MISO, New York Independent System Operator (NYISO), PJM, and Independent System Operator New England (ISO-NE). OATI used the magnitudes of these prices as indicators of significant congestion and computed the market metrics accordingly.

As with AFC and ATC limitations, high market prices are only a partial measure of congestion. First, as noted, prices are only established and posted in formal wholesale markets; they are not applicable to or available for transmission systems that are not in or do not operate such markets. Second, prices alone do not indicate the magnitude of congestion, which depends also on the flow of power over congested paths. As noted, scheduled and actual flow information is not universally publicly available. Third, prices (even if flow information could be combined with them) do not, by themselves, provide a reliable indication of the level of grid operators' efforts to relieve congestion. They are simply economic scalars that enable comparison within a given market of congestion costs in one location with such costs in other locations.

⁶⁰ OATI also examined denied requests for reservations, but found them to be insignificant and did not review them further. Denied requests have uncertain value as a measure of desired but unconsummated transactions because they represent only requests that were actually made; they do not reflect desired transactions that were not pursued because the parties knew in advance that the requests were likely to be denied.

⁶¹ FERC Order 889 requires that schedules in the bilateral markets be posted after the fact for all transmission reservations. This information is available on many, but not all of the OASIS sites. Scheduled flow information is not posted publicly in the organized markets operated by RTOs and ISOs.

⁶² The shadow price of a constraint measures the incremental change in operating costs that would result from an incremental 1-MW change in the constraint limit.

4.2.3. Real-Time Operations

In real-time (or day-of) operations, transmission schedules are sometimes modified through Transmission Loading Relief (TLR) operating procedures developed by NERC. TLRs curtail scheduled transactions in order to modify power flows that might otherwise lead to violations of reliability criteria. These procedures are invoked typically when there are scheduling inconsistencies and/or where there are unplanned outages.⁶³ In some areas, such as SPP, TLRs are used as an alternative to LMPs for managing congestion. In these areas, a high frequency of TLRs indicates that the grid is being used heavily and does not, by itself, imply the existence of major reliability problems.

TLRs identify one or more specific flowgates and the amount of power that must be curtailed. Protocols have been established that determine how the curtailments are to be allocated among the various classes of affected energy transactions (e.g., firm vs. non-firm service). TLR information is recorded and maintained by NERC's Interchange Distribution Calculator Working Group, which made the data available for OATI's study. OATI evaluated the frequency and duration of TLR actions on particular flowgates as a measure of congestion. Frequency indicates how often scheduled transactions were curtailed and duration indicates the length of time transactions were curtailed. As was the case with the other two elements, TLRs are only partial measures of congestion, as no information on the commercial value of the curtailed transactions is recorded by NERC.

For centralized markets, real-time constraints are managed primarily by real-time market re-dispatch, not through TLRs. This information is captured in the shadow price for the binding constraints and was documented by OATI for some of the markets.

4.3. Historical Congestion in the Eastern Interconnection

Through LBNL, the Department hired OATI to analyze publicly available historical data on transmission congestion in the Eastern Interconnection. The available data are limited, and vary in content and quality across the interconnection. Such an effort has not been undertaken previously in the East (unlike in the West), so the Department and LBNL asked OATI to study data for 2007 only. This is the first time such a broad transmission data collection and analysis effort has been undertaken, and the most important finding from the effort may be the understanding of how uneven the publicly available data are, and how difficult it is to interpret the data consistently across the interconnection. Although the Department was aware that market operations affect congestion management practices, and that public reporting across the grid varies widely, it is nonetheless concerned to find major variations in data granularity and quality from region to region, and to learn how inconsistencies, such as those between the Interchange Distribution Calculator (IDC) and OASIS in how they name and map flowgates, sometimes make it difficult to determine precisely how transmission is being utilized across the interconnection.⁶⁴

Transmission congestion management practices differ widely across the Eastern Interconnection, reflecting region-to-region differences in philosophy, grid operations and market structure from region to region. Table 4-1 summarizes the variations in these practices and the available data. In the Northeast (NYISO, ISO-NE, and PJM), where centralized power markets have existed for many years, grid operators manage transmission flows and reliability over the short term primarily using price signals generated through the wholesale power market. In

⁶³ For instance, PJM called 150 TLRs in 2008, an increase of 87% over 2007, with most of the increase attributed to transmission line outages caused by storms and tornadoes. See Monitoring Analytics, LLC (2009). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), at http://www.monitoringanalytics.com/reports/PJM_State_of_the_Market/2008.shtml, p. 22.

⁶⁴ Common and more rigorous conventions for naming transmission facilities in the Eastern Interconnection would make it easier to track transmission activities and conditions, particularly when more than one data source is involved.

the Midwest (MISO and SPP), they manage transmission congestion over the short term using TLR curtailments (although this may change over time with greater market experience). In the Southeast (SERC Reliability Corporation (SERC), Florida Reliability Coordinating Council (FRCC), TVA and Entergy), where there are no centralized power markets, all utilities are vertically integrated, and there is limited information on transmission congestion because the utilities manage available transmission capacity and reservations in ways that limit the amount of transmission service that might otherwise have to be curtailed. Over the long term, all of the regions look explicitly at where transmission congestion occurs and what supply- and demand-side measures could alleviate it.

Notwithstanding the data challenges and the wide variety of practices employed by eastern operating entities to manage and document congestion on and among their systems, OATI’s analysis offers several insights into the patterns, causes, and trends in congestion within the Eastern Interconnection. While it is relatively straightforward to draw conclusions about individual areas and about the areas where organized markets operate, it is harder to draw broad conclusions across the entire interconnection.

4.3.1. Transmission Reservations

The availability of reservations for transmission service is not a complete measure of transmission

Table 4-1. 2007 Transmission Congestion Data Provided to OATI for Study of the Eastern Interconnection

	Entergy	FRCC	ISO-NE	MISO	MAPP	NYISO	PJM	Southern Company	SPP	TVA	VACAR
Operational and Reliability Metrics											
Transmission Reservations	Yes Reservations confirmed or refused	Yes Reservations and transmission service offers	No OASIS not utilized by ISO-NE	Yes Flowgate AFC, reservations confirmed or refused	Yes Flowgate AFC, reservations confirmed or refused	N/A OASIS not utilized by NYISO	Yes Confirmed reservations over interfaces	Yes Reservations and ATC	Yes Flowgate AFC, reservations confirmed or refused	Yes Reservations and transmission services offers	Yes Reservations and transmission service offers
Transmission Schedules	No	No	Yes Net schedules for flows over interfaces and interface TTC data	No	No	Yes Day ahead and real time schedules over interfaces	No	No	No	No	No
Actual Flows	No	No	No	No	No	No	No	No	No	No	No
Transmission Loading Relief Actions	Yes (ICTE)	Yes	No Resolved through market re-dispatch	Yes	Yes Included in MISO reliability footprint	No Resolved through market re-dispatch	Yes	Yes	Yes	Yes	Yes
Economic Metrics											
Market Organization	No organized spot market	No organized spot market			No organized spot market			No organized spot market		No organized spot market	No organized spot market
Locational Marginal Prices	No	No	Yes	Yes	No	Yes	Yes	No	Yes For second half of 2007	No	No
Shadow Prices for Binding Constraints	No	No	Yes	Yes	No	Yes	Yes	No	No LMPs did not have constraints and shadow prices available	No	No

congestion. OATI's hypothesis was that fully subscribed lines (i.e., zero availability of either firm or non-firm reservations) means that there is no room available to handle additional requests; however, this does not say much about actual flows or the availability of room for additional flows. While it measures the extent to which a contract path or flowgate has been subscribed, it does not measure the potential unmet demand for additional transmission usage, nor does it measure the actual usage of a contract path or flowgate. OATI could not identify congestion based on actual utilization of transmission paths or flowgates because scheduling is performed through the use of e-Tags; neither e-Tags nor actual flows are publicly available consistently throughout the Eastern Interconnection.⁶⁵

Generally speaking, OATI found that firm reservations were more fully subscribed than non-firm reservations as measured by the total MWh subscribed. However, for some reservations sinking into the organized markets (such as PJM), non-firm reservations were sometimes subscribed more fully than firm reservations. OATI believes that this may reflect sellers' desire to secure non-firm, rather than firm, transmission service opportunistically in response to prices available within these markets. It may also reflect a higher amount of merchant and intermittent generation selling into those markets.

Overall, the general pattern of firm reservations was from the north (Canada) toward the south (MISO) and from west (PJM-West) to the east (PJM-East). However the general pattern of non-firm reservations was from the east (MISO and PJM) to the west [Midcontinent Area Power Pool (MAPP)] and to the south [Entergy (EES) and TVA]. OATI found that the greatest amount of firm reservations subscribed (measured in MWh) sourced from PJM-West and Canada and sank into MISO. (See Figure 4-2). The greatest amount of non-firm reservations sank into MAPP and EES, followed by TVA. The source of these non-firm reservations was primarily

from MISO, followed by PJM. (See Figure 4-3). In these figures, a positive (greater than zero) flow indicates that the flows originate in the zone indicated; a negative (less than zero) flow indicates that the net flows sink in (are delivered to) the zone shown.

According to OATI's analysis, the interface between SERC and Florida is fully subscribed (i.e., all available transmission capacity is being used in most hours of the year).

Information on transmission reservations is not relevant for assessing transmission activities within ISO-NE, NYISO, and PJM, as these entities rely on offers and bids cleared through nodal pricing in their centralized electricity markets to ration the availability and allocate the provision of transmission services.

4.3.2. Transmission Loading Relief Actions

The need for and hence use of TLRs varies across the Eastern Interconnection. Where they are used,⁶⁶ a Reliability Coordinator initiates a TLR procedure when a transmission line is loaded to the point that there is a potential or actual security limit violation. The TLR usually entails cutting one or more transmission contract flows (in priority order, first cutting non-firm transmission and then firm transmission schedules) and redispatching generation on either side of the limiting line to reduce line loading. The Reliability Coordinator initiating the TLR identifies the transactions and native and network load curtailments that will be used to gain loading relief and uses the NERC IDC to calculate the impact of the load relief across specific flowgates.⁶⁷ There are five levels of TLRs, ranging in severity from Level 1 (notification that an operating limit is reached) through Level 3 (curtailing non-firm point-to-point service) to Level 5 (curtailing firm transmission service). Once a TLR is initiated, it is

⁶⁵ OATI recommends that the Department try to acquire records of scheduled and actual flows for future analysis (as is routinely performed in the Western Interconnection through TEPPC's long-standing analyses of historic congestion).

⁶⁶ TLRs are used in SPP, PJM and the southeast.

⁶⁷ On an AC transmission system, electricity flows follow the path of lowest impedance, so cutting generation at one plant will affect flows across numerous flowgates in addition to the specific point that is being targeted for loading relief. Note that this means that more than one transaction may have to be modified or disrupted in order to achieve the desired relief at a particular location.

tracked in the TLR log maintained by the NERC IDC working group.

As noted previously, within NYISO and ISO-NE (and to a lesser extent PJM), TLR procedures are supplanted by market operations relying primarily on real-time re-dispatch based on market offers and so are not useful in describing this aspect of transmission congestion within the footprints of these organizations.

Table 4-2 shows statistics on TLRs by region, as compiled by OATI based on IDC information—column 2 shows the number of TLR curtailments, column 3 shows the number of hours covered by those curtailments, and columns 4 and 5 show the amount of non-firm and firm energy curtailed by region. The table confirms that more non-firm MWh were curtailed than firm MWhs (as is intended by the design of the TLR procedures). Table 4-2 indicates that the highest number of curtailments, and the highest number of hours of curtailments, occurred within SPP. According to SPP, many of these curtailments were due to weather-related

outages in 2007. Despite the high number and duration of curtailments in SPP, far more MWh of non-firm and firm energy were curtailed in the adjacent MISO and Entergy regions than in SPP.

While OATI found limited evidence suggesting a correlation between these curtailments and earlier findings on non-firm transmission reservation metrics, OATI found no evidence of a correlation between firm curtailments and the firm transmission reservation metrics reported above. Both of these findings are consistent with the experience of the industry experts who provided suggestions to OATI on accessing and assembling the public information OATI relied upon to prepare its report.

The highest number of non-firm curtailments occurred in the MISO region, followed by those in SPP and Entergy. The constraints generally limited flows of power seeking to move from north to south and from west to east. In particular, the combination of curtailments and net reservations show that constraints limited the flow of electricity from Canada south through Minnesota and Wisconsin in 2007.

Figure 4-2. Net Firm Reservations for All Eastern Zones, 2007


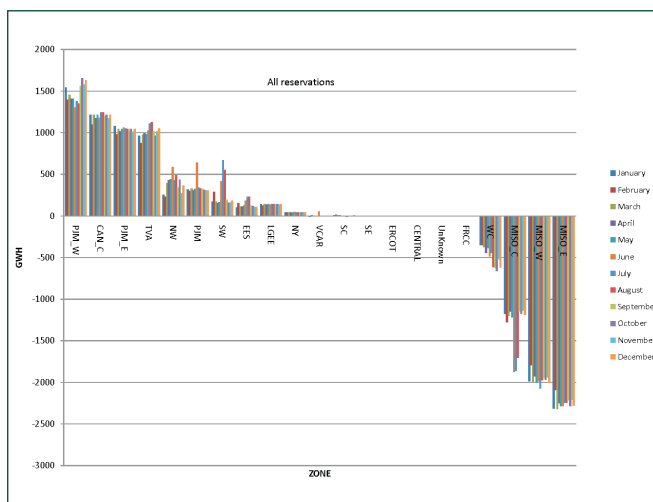


Figure 4-3. Net Non-Firm Reservations for All Eastern Zones, 2007

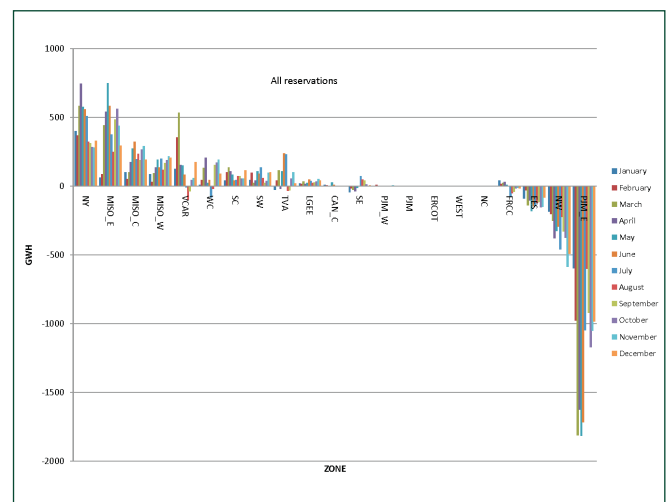

Notes: CAN_C = Central Canada; CENTRAL = Midwest ISO Central Region; EES = Entergy; FRCC = Florida Reliability Coordinating Council; LGEE = Louisville Gas and Electric Energy; MISO_C = Midwest ISO Central Region; MISO_E = Midwest ISO Eastern Region; MISO_W = Midwest ISO Western Region; NC = North Carolina; NW = Northwest Region of MAPP (Mid-Continent Area Power Pool); NY = New York; PJM = Pennsylvania-Jersey-Maryland; PJM_E = Pennsylvania-Jersey-Maryland = East; PJM_W = Pennsylvania-Jersey-Maryland = West; SC = South Central Region; SE = South East Region; SW = South West Region; TVA = Tennessee Valley Authority; VACAR = Virginia-Carolinas Sub Region; WC = West Central Part of MAPP; WEST = West Region of MAPP.

Sources: Open Access Technology International (OATI) (2009). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, at <http://www.congestion09.anl.gov/>, Figure 72, p. 106, and Figure 73, p. 107.

MISO reports that it completed significant transmission additions in 2007 and 2008 that have addressed the underlying physical basis for many of the 2007 TLR actions in Wisconsin and Minnesota, so the number and severity of TLR actions going forward is expected to be lower. There are also constraints in the flow from west to east through Iowa and in Nebraska affecting southbound flows. But these historic transmission curtailment patterns are expected to be modified going forward due to recent operational changes within MISO—in January 2009, MISO launched an ancillary services market that began operating as the region’s overall balancing authority, working with existing member entities as local balancing authorities.⁶⁸ Both developments should reduce the need for transmission curtailments.

The largest amount of firm MWhs curtailed was in the Entergy region. OATI’s discussions with ICTE staff (Entergy’s transmission manager) indicated that because pricing for firm and non-firm service is similar or identical, power marketers and independent generators moving electricity in that region tend to take comparatively more firm service than they might if firm service were priced higher (as it tends to be in other regions). Hence, curtailments affect firm service to a greater degree than might be

observed in other regions because there are comparatively fewer non-firm transactions.

4.3.3. Cost of Congestion

Information on transmission reservations and TLR actions does not capture the economic significance of transmission congestion. In the East, this information is only available at present for the organized markets (ISO-NE, MISO, NYISO, PJM, and SPP), which rely on formal market processes to manage transmission congestion and make this information publicly available. (See Figure 4-4, which displays the geographic areas covered by these markets.) In the Southeast and lower Midwest, comparable information on the economic significance of transmission congestion is not available.

OATI used the shadow prices for binding transmission constraints and the congestion component of Locational Marginal Prices (LMPCCs) as market metrics for congestion. Shadow prices directly assess the magnitude and direction of congestion on transmission paths.⁶⁹ LMPCCs characterize specific constrained areas (either generation or load pockets). OATI found that shadow prices for binding constraints in 2007 were more reliable indicators of congestion than were LMPCCs. Changes in the sign and magnitude of shadow prices could be

Table 4-2. Transmission Loading Relief in the U.S. Portion of the Eastern Interconnection 2007 Data

Reliability Coordinator	Number of TLR Curtailments (Level 3 and Above TLRs)	Number of Hours in TLR (for Level 3 and Above)	Non-Firm MWh Curtailed (TLR Level 3)	Firm MWh Curtailed (TLR Level 5 and Above)
Southwest Power Pool	14,817	14,895	42,1401	1,355
Midwest ISO	7,494	12,552	103,4746	25,474
Independent Coordinator Transmission (Entergy)	2,519	3,809	40,4781	53,687
Tennessee Valley Authority	692	852	82,258	1,582
PJM	502	1,692	106,573	2,088
Virginia-Carolinas-South Reliability Coordinator	21	51	0	0

Source: Open Access Technology International (OATI) (2009). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, at <http://www.congestion09.anl.gov>, Table 7, p. 109.

⁶⁸ Midwest ISO (2008b). “Midwest ISO to Begin Accepting Offers for Ancillary Services Market,” Midwest ISO Press release, at http://www.midwestmarket.org/publish/Document/1d44c3_11e1d03fcc5_-7dc30a48324a/2008-12-22%20Midwest%20ISO%20Begins%20Accepting%20ASM%20Offers.pdf?action=download&_property=Attachment.

⁶⁹ The shadow price of a transmission constraint on a path or interface is a direct indicator of congestion on that path. The positive or negative signs associated with individual shadow prices reflect only conventions adopted to indicate the direction of constrained flows; it is the absolute value of a shadow price that reflects the economic significance of the constraint.

readily related to seasonal and time-of-use (peak/off-peak) market flow patterns. In contrast, LMPCC values in 2007 were often volatile, exhibiting frequent and less explicable changes in sign (positive and negative)⁷⁰ than binding transmission constraint shadow prices. OATI speculated that LMPCCs might be more volatile because they sometimes reflect the collective effect of several simultaneously binding transmission constraints, some of which may be on facilities supplying power into an area while others are on facilities supplying power out of the same area at the same time. LMPCC metrics complement shadow price metrics in illustrating economic congestion—LMPCC helps to identify load or generation pockets, while shadow prices reflect the value of relieving constrained lines.

Before OATI could compare prices across the organized markets, it first had to determine whether the data from different markets were sufficiently comparable. OATI collected real-time price data for MISO congestion, while PJM and NYISO price data are from day-ahead markets.⁷¹ Several factors led OATI to conclude that the market-based data are comparable despite these differences between the markets and the data available from them:


- Across the eastern markets, virtual bidding allows market participants to arbitrage away systematic differences effectively between the day-ahead and real-time markets within a given market area. In ISO-NE, where real-time and day-ahead congestion data could be readily compared, OATI determined that the differences due to reliance on day-ahead versus real-time data in calculating metrics were insignificant. Therefore OATI concluded that the congestion data and results are comparable between the markets despite the time-frame difference.
- OATI also believes that market participants arbitrage away systematic differences among the markets with respect to variations in market rules or timelines. This arbitrage is assisted, in part,

because all of the markets analyzed have relatively similar uplift payment mechanisms to cover the situations when market prices (LMPs) are not sufficient to cover offer prices.

OATI reported several findings about eastern congestion, as measured by economic metrics:

- Counting the number of congested paths with high magnitude and frequency of non-zero shadow prices, MISO and PJM (the largest RTOs) experienced greater congestion than did either NYISO or ISO-NE in 2007.
- MISO and PJM experienced the greatest amount of economic congestion in 2007. Both regions had a significant number of transmission constraints with shadow prices exceeding \$500/MWh. In contrast, shadow prices within NYISO rarely exceeded \$200/MWh and within ISO-NE never exceeded \$200/MWh. The general pattern of congestion within and across MISO and PJM was one of increasing intensity from west to east. (See Figure 4-5.)
- For 2007, the ISO-NE network was the least congested among the Eastern markets analyzed. While there was some congestion across ISO-NE

Figure 4-4. Areas in the Eastern Interconnection Served/Not Served by Organized Wholesale Markets

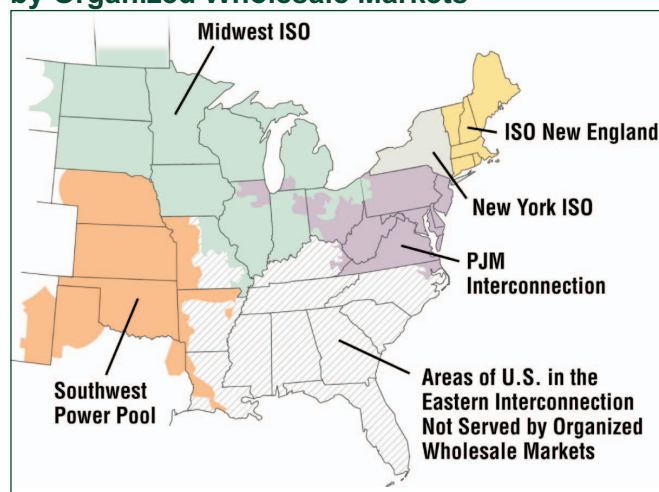

⁷⁰ A positive LMP congestion cost indicates that the area is a load pocket, and transmission constraints limit the ability to import electricity in; a negative LMPCC indicates that the area has an excess of generation and transmission constraints limit the ability to export all of the generation produced.

⁷¹ OATI collected both real-time and day-ahead congestion data from ISO-NE. Congestion data from SPP were only available for a portion of 2007 and were not analyzed.

inerties, there was far less congestion within ISO-NE than existed within the other organized markets. Still, some LMPCCs exceeded \$100/MWh; OATI attributed this in part to areas with sparse transmission.

- Congestion within the NYISO was dominated by flows from upstate toward New York City and Long Island. Few shadow prices averaged above \$200/MWh. Although New York LMPCCs rarely exceeded \$100/MWh, the pattern of LMPCCs formed a series of load pockets from New York’s East Central zone down the Hudson Valley to New York City and onto Long Island.

4.4. Mid-Atlantic Critical Congestion Area


In the 2006 study, the Department identified the mid-Atlantic area, from mid-state New York south along the Atlantic coastal plain to northern Virginia and west through eastern Pennsylvania, as a Critical

Congestion Area. The Department made this identification because of the area’s importance as a population and economic center and because of the many known transmission constraints and challenges to building new transmission and managing load growth.

The Department cited a number of congestion-related issues in this area in the 2006 study:

- The high electricity consumption and load growth of metropolitan New York City and Long Island, both of which are generation-short and face high electricity prices,
- The need for voltage support in southeastern New York,
- The region’s high dependence upon costly (and price-volatile) oil- and gas-fired generation,
- Transmission constraints, reliability violations, and limited local generation in New Jersey, which may nonetheless be pressed to serve as a

Figure 4-5. Combined MISO-PJM-NYISO Binding Constraints Metric: Annual Mean Shadow Prices (All Hours)

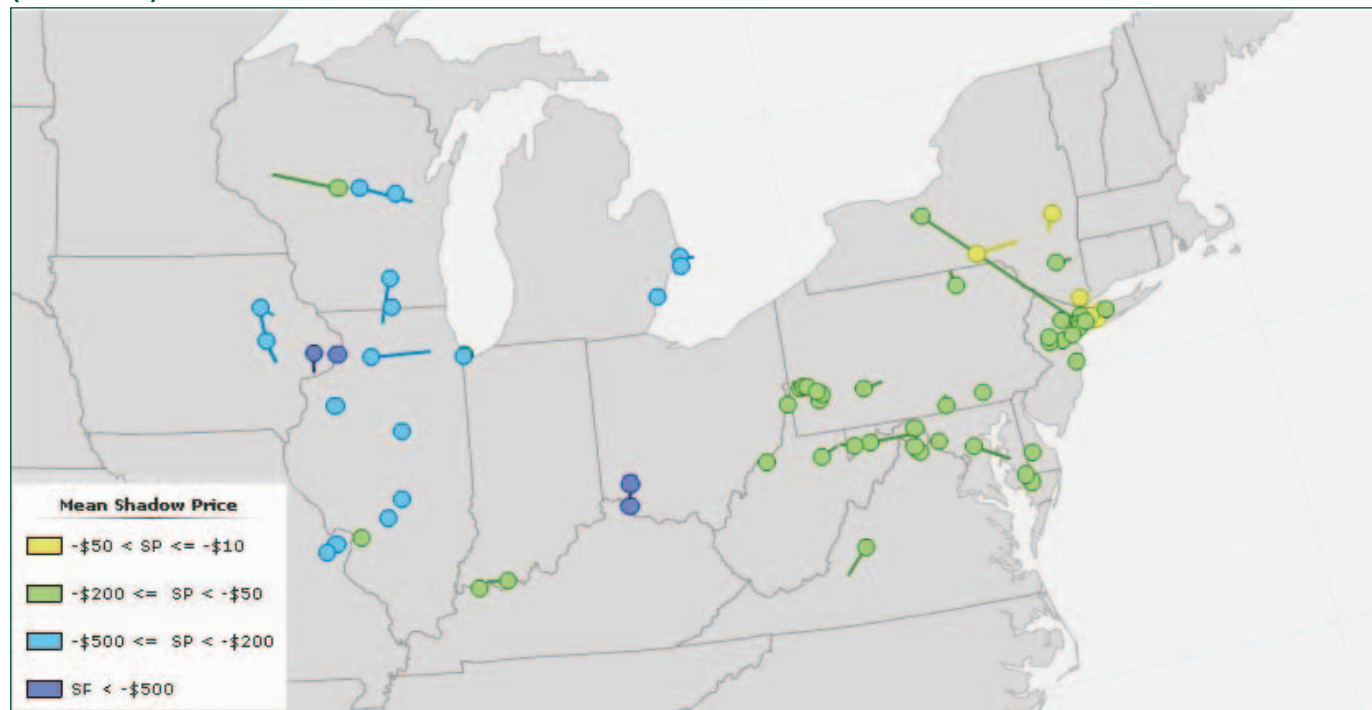

Notes: For each of the top ranking transmission constraints, the “from” and “to” terminals of the path in question are located and joined by a straight line, using approximate geographical latitude and longitude coordinates. Where the from/to geographical locations are so close that they would not be discernible on the map, a circle is shown instead of a line. The color of the line or circle indicates the relative magnitude of the shadow price (see legend).

Source: Open Access Technology International (OATI) (2009). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*, at <http://www.congestion09.anl.gov/>, Figure 120, p. 169.

Data Issues Hamper Analysis of Historical Congestion in the Eastern Interconnection

The lack of consistent, publicly accessible data on transmission flows and electricity costs across the Eastern Interconnection limited the Department's ability to analyze historic congestion across the region.

The OATI study could not identify congestion based on actual utilization of transmission paths or flowgates, as scheduling is done using "e-Tags" and these data are not publicly available. OATI recommended looking for a way to acquire scheduled and actual flows for future analysis (comparable to the analysis of historic congestion in the Western Interconnection that has been routinely conducted by WECC for a number of years).

One goal of the OATI study was to determine if there is a correlation among the various measures of congestion as identified through analysis of OASIS, market and IDC data. Lack of naming standards made it difficult to correlate the information available from the three sources.

Another goal of the OATI study was to present results on an electronic geographic map to facilitate further analysis. This proved to be a challenge as the geographic location of data was not readily available on a consistent basis for use in the study. The Department suggests that the regional planning entities should work together to develop such information on a consistent basis across the Eastern Interconnection, with suitable access restrictions for security-sensitive information.

NERC-provided IDC data were used to determine the number and magnitude of curtailments on the system. The flowgates were rated according to the number and size of the constraints. OATI could not determine the correlation between the refused reservations and curtailments on a flowgate because IDC does not report historic distribution factors.

Two sets of metrics used market data from ISO-NE, MISO, NYISO, and PJM: (1) binding congestion constraint shadow price statistics, and

(2) LMP congestion component statistics. Data availability varied widely:

- There are no organized electricity markets in the southeastern region (the areas managed by SERC, TVA, Entergy/ICTE and Florida) and the grid managers do not share electricity cost information or much transmission flow information beyond the minimum required by current federal reporting requirements.
- SPP did not have full year market data for 2007.
- Constraint shadow prices were publicly available for all centralized markets except SPP. For ISO-NE they were made available for the study for a subset of constraints (interfaces).
- The data needed for congestion rent computation were either unavailable or considered commercially sensitive. A surrogate (sum of constraint shadow prices) was used instead, when these data were publicly available.
- The LMP congestion component data were available for all markets except SPP, and except January through May 2007 for PJM. In consultation with PJM project advisors, OATI devised a procedure to back-compute an approximation of the PJM LMPCCs for January through May 2007.

The Energy Information Administration's 2004 report, *Electricity Transmission in a Restructured Industry: Data Needs for Public Policy Analysis*, offers a detailed discussion of the data then—and now—collected on electricity production, market operations, pricing and flows. The report provides commentary on where these data and existing data collection vehicles fall short in allowing policy officials and analysts to understand key dimensions of grid operations and markets. Although several orders from the FERC have increased the scope, depth and transparency of regional electric system planning, major improvements are needed to collect data on many aspects of grid operations and make them publicly available.

pathway for new transmission and additional electricity flows to serve New York City,

- High congestion costs caused by transmission constraints that limit eastbound flows across the Allegheny Mountains,
- High retirements of older fossil generators, and
- Expensive, generation-deficit load pockets on the Delmarva Peninsula and the Baltimore-Washington metropolitan area.

This section reviews recent developments in the Mid-Atlantic region, including notable changes in load, energy efficiency, demand response, and distributed generation, as well as supply-side progress in transmission and generation development, and considers the net effect of these changes upon transmission congestion.

As many stakeholders have observed, the Mid-Atlantic region illustrates several key points about transmission congestion and changes to the bulk power system:

- It would not be economic to eliminate all transmission congestion; however congestion that creates significant reliability risks or increases in economic costs to consumers should be addressed.
- Making improvements to reduce transmission bottlenecks in one part of grid may only move congestion to other parts of the grid and make other bottlenecks more problematic.
- Changes in location of generation and patterns of loads will affect the timing and magnitude of transmission congestion and hence its economic and reliability impacts.
- In many cases, not addressing economic congestion today may lead to reliability-eroding congestion in the future.

- There are a number of ways to mitigate transmission congestion, including adding large and small generation, developing demand-side resources, and building additional transmission; these options should be regarded as a portfolio from which planners should make appropriate use of every tool available.
- All of these efforts take time for analysis, planning, siting, regulatory review and approval, and implementation or construction.
- Joint, inter-regional planning and cost allocation are needed to solve grid reliability and cost problems that cross market and state borders.⁷²

The single greatest challenge in the Mid-Atlantic region is how southeastern New York will meet its electricity needs in the years ahead—with what combination of in-state resource development and efficiency, imports from New England and Canada to the north and east, and imports from the Midwest and south carried on cables through New Jersey and Pennsylvania. This issue lies at the heart of the Mid-Atlantic’s future. As framed by a New Jersey public utility commissioner:

Not only are we the most congested state in the country . . . , but we’re at the edge of PJM. And therefore we have another problem, and that is the seams issue between us and the New York guys There are at least 3,000 MW of projected projects that will take power out of New Jersey and run them across the Hudson River or the northernmost boundary or cross the water into Long Island out of New Jersey and out of PJM into New York And there are very few rules that indicate how New York has to make up for that deficit.⁷³

Similarly, according to PJM, “We are as concerned as New Jersey that as we continue to try to solve and

⁷² Extracted from comments by Messrs. Michael Kormos (PJM), Dan Cleverdon (DCPUC), Ed Tatum (Old Dominion Electric Cooperative), Steve Naumann (Exelon), Paul Napoli (PSE&G), Jim Haney (Allegheny Power), Ms. Lisa Barton (American Electric Power), and Commissioners Frederick Butler (New Jersey), Doug Nazarian (Maryland), and Sherman Elliott (Illinois). See U.S. DOE Office of Electricity Delivery and Energy Reliability (2008). “Materials Submitted & Transcripts: Pre-Congestion Study Regional Workshops,” at <http://www.congestion09.anl.gov/pubschedule/index.cfm>.

⁷³ Butler, F. (2008). “Comment of Frederick Butler Commissioner of the New Jersey Board of Public Utilities” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Chicago, Illinois. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 6.

fix our problems, [those solutions should not be] simply used and leveraged by New York at an unfair arrangement.”⁷⁴ The tension between New York and its neighbors, combined with the closely related question of how all the eastern states will meet their renewable portfolio standard requirements, highlights the growing importance of inter-regional, interconnection-wide scenario analysis and system planning across the East.

4.4.1. Changes in Load and Demand-Side Resources

New York has a projected peak demand of 33,452 MW in 2009, down from its record peak 33,939 MW in 2006⁷⁵ during record heat waves. Although load in New York was growing at an average annual rate of 1.23%, the recent economic slowdown and aggressive energy efficiency efforts have reduced forecast growth rates, which now are projected at 0.68% increase per year rather than the 1.31% expected previously.⁷⁶ Electricity consumption in New York fell from 167,208 GWh in 2005 to 165,613 GWh in 2008.⁷⁷

Recent commitments by the New York Governor and the state’s Department of Public Service have mandated a 15% reduction in electricity use by 2015, so the state’s utilities are investing in aggressive energy efficiency programs to achieve these goals. The NYISO reports that if current efficiency program funding levels are maintained, they expect peak consumption to be reduced by approximately 5% of 2007 forecasted levels by 2015. Absent

energy efficiency programs, New York’s peak electricity demand would be 2,126 MW higher by 2018.⁷⁸

In New York’s capacity resource program, demand-side resources can compete to supply operating reserves and regulation services in the day-ahead and real-time markets. For 2009, New York will have 2,138 MW of registered Special Case Resources (demand response), up 761 MW from 2008,⁷⁹ and 364 MW of Emergency Demand Response Program resources.⁸⁰ In August 2006, NYISO demand response programs reduced electric peak demand by almost 1,000 MW when the system hit record peak levels.⁸¹

To facilitate more effective demand response and customer energy efficiency choices, most of the New York utilities are installing advanced metering systems designed to deliver transparent, market-based prices to all consumers.⁸²

It appears that the combined impacts of New York’s energy efficiency policies and programs, increased demand response from customers registering as Special Case Resources, and increases in expected generation and transmission availability are improving the state’s reliability outlook. These changes allow the NYISO to conclude that “the forecasted baseline system meets applicable reliability criteria for the next 10 years, from 2009 through 2018, without any additional resource needs.”⁸³ The ISO cautions, however, that the New York system could need resources as soon as 2010

⁷⁴Kormos, M. (2008). “Comment of Michael J. Kormos, Senior Vice President-Operations PJM Interconnection, L.L.C.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Chicago, Illinois. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 9.

⁷⁵New York ISO (NYISO) (2009d). “2009 Summer Outlook,” at [http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_2009_Summer_Outlook__05212009_\(2\).pdf](http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_2009_Summer_Outlook__05212009_(2).pdf), p. 4.

⁷⁶NYISO (2009b). *Power Trends 2009*, at http://www.nyiso.com/public/webdocs/newsroom/current_issues/nyiso_powertrends2009_final.pdf, p. 19, and New York ISO (NYISO) (2009d). “2009 Summer Outlook,” p. 9.

⁷⁷NYISO (2009a). *2009 Load and Capacity Data ‘Gold Book,’* at http://www.nyiso.com/public/webdocs/services/planning/planning_data_reference_documents/2009_LoadCapacityData_PUBLIC.pdf, Section 1.

⁷⁸NYISO (2009e). *Reliability Summary 2009-2018*, at http://www.nyiso.com/public/webdocs/newsroom/current_issues/rna2009_final.pdf, p. 8.

⁷⁹*Ibid.*, p. 6.

⁸⁰NYISO (2009d). “2009 Summer Outlook,” pp. 12-13.

⁸¹NYISO (2009e). *Reliability Summary 2009-2018*, p. 10.

⁸²NYISO (2009b). *Power Trends 2009*, p. 26.

⁸³NYISO (2009c). *2009 Reliability Needs Assessment: Comprehensive System Planning Process*, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/RNA_2009_Final_1_13_09.pdf, p. i.

if it experiences both high load growth and extreme hot weather.⁸⁴

Within PJM, 2009 summer peak load is projected to exceed 134,000 MW, with the region's Mid-Atlantic load expected at 59,621 MW. Summer peak load across the entire PJM region (which is larger than the area within the Mid-Atlantic region of concern here) is expected to grow at an average of 1.7% over the next 10 years.⁸⁵

Several of the Mid-Atlantic states have developed ambitious energy efficiency programs:

- Maryland's goal, set by gubernatorial order and confirmed by the EmPOWER Energy Efficiency Act of 2008, is to use energy efficiency to reduce per capita electricity consumption and peak demand by 15% by 2015.
- Pennsylvania's Act 129 of 2008 requires electric distribution companies to adopt and implement cost-effective energy efficiency and conservation plans to reduce energy demand and use.
- Washington DC's Clean and Affordable Energy Act of 2008 requires the District's utilities to reduce per capita energy consumption.
- New Jersey has a goal of reducing energy consumption by at least 205 MW by 2020, with peak demand reductions of 5,700 MW by 2020.
- Delaware has enacted legislation seeking a 30% average reduction in annual energy usage for its citizens by the end of 2015.

The American Council for an Energy Efficient Economy (ACEEE) has recognized several of the Mid-Atlantic states as leaders in delivering energy

efficiency—ACEEE's State Energy Efficiency Scorecard ranked New York as 5th, New Jersey 10th, Maryland 12th, and Pennsylvania 15th among the nation's best for efficiency policies and programs.⁸⁶

Recent market changes within PJM allow demand response and energy efficiency to be bid as forward capacity resources. PJM has 5,925 MW of load management and demand response in place to meet summer 2009 load.⁸⁷ PJM acquires firm capacity through its Reliability Pricing Model Base Residual Auction (BRA) process. Its latest BRA, held in spring 2009, acquired a total of 136,143 MW of capacity including 7,047 MW of demand response and 569 MW of energy efficiency for the years 2012-2013; 67% of this demand response will be located in PJM's most constrained areas.⁸⁸ Before the latest BRA, PJM had about 1,400 MW of demand response capacity. However, there is not yet enough of a track record with new demand-side resources to be sure that they will materialize on the schedules called for under the BRA commitments.

Several states have aggressive goals for distributed generation and photovoltaics. One of the most aggressive is New Jersey. Since 2001, New Jersey has built more than 60 MW of solar projects, assisted by Clean Energy Program solar energy rebates (now phased out) and Solar Renewable Energy Credits. The state's current goal is to install enough solar capacity (1,800 MW) to get 2,120 GWh of energy from solar by 2020. The state is also developing community-based solar programs for distributed, aggregated resources and commercial grid-connected projects.⁸⁹

⁸⁴ *Ibid.*, p. ii.

⁸⁵ PJM (2009e). *PJM Load Forecast Report*, at <http://www.pjm.com/~media/documents/reports/2009-pjm-load-report.ashx>, p. 1.

⁸⁶ Eldridge, M., et al. (2008) *The 2008 State Energy Efficiency Scorecard*, ACEEE Report Number E086, at http://www.aceee.org/pubs/e086_es.pdf, p. 4.

⁸⁷ PJM (2009f). "Region Ready for Hot Weather Power Demand," PJM Press release, at <http://www.pjm.com/media/about-pjm/newsroom/2009-releases/20090506-pre-seasonal-forecast.pdf>.

⁸⁸ PJM (2009g). "Table 1 – RPM Base Residual Auction Resource Clearing Price Results in the RTO," *2012/2013 RPM Base Residual Auction Results*. PJM Docs #540109, at <http://www.pjm.com/~media/markets-ops/rpm/rpm-auction-info/2012-13-base-residual-auction-report-document-pdf.ashx>, p. 5.

⁸⁹ State of New Jersey (2008). *NJ Energy Master Plan*, at http://www.state.nj.us/emp/docs/pdf/081022_emp.pdf, pp. 69-70.

4.4.2. Changes in Generation and Transmission

Changes in Generation


New York has 38,547 MW of installed generation in place to meet load in the summer of 2009.⁹⁰ Independent generators have added over 2,400 MW of new generation between January 2006 and May 2009⁹¹ (including additional renewable resources that bring total wind generation to 1,275 MW⁹²), and generator availability has increased by 7%. NYISO reports that 83% of the 7,300 MW added since 1999 has been sited in New York City, Long Island and the Hudson Valley, where the need for new generation was greatest.⁹³ (See Figure 4-6.) The addition of new generation capacity in Astoria East and West in New York City in 2006 has substantially reduced congestion within the City.⁹⁴

Additional planned new market-based generation and merchant transmission projects are moving through the planning and permitting process, although four generation projects anticipated on-line in 2010-2011 are now experiencing delays.⁹⁵ The ISO reports that over the past year, “NYISO’s markets have provided the incentive for approximately 1,700 MW of proposed generating capacity.”⁹⁶ At the same time, however, retirements of existing power plants representing over 1,200 MW of capacity are projected over the coming decade.⁹⁷

Changes in the types and locations of generation can have a significant effect on congestion in the future. New York adopted a renewable portfolio standard in 2004 that requires 25% of the state’s

electricity to be generated from renewable resources by 2013; achieving this goal will require development of both new generation and transmission. Around 8,000 MW of wind generation alone (not counting other renewables) are proposed for development across western New York. Currently 1,275 MW of wind generation is on-line; an additional 1,000 MW is expected to come on-line in 2009; and another 6,500 MW is in the interconnection queue.⁹⁸ New York also has the ability to access additional hydro and wind generation imported from Quebec, off-shore in Lake Erie, and off-shore in Long Island Sound and the Atlantic Ocean. As more of this wind generation is added to the system,

Figure 4-6. Generation Added in New York State, 1999–Early 2009

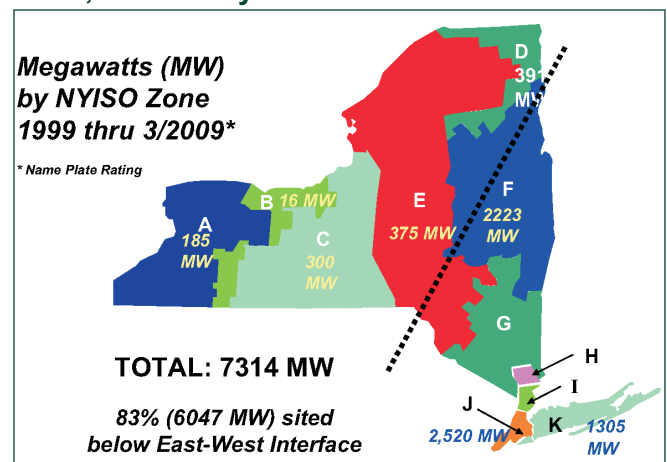

Source: Buechler, J. (NYISO) (2009). “Inter-Regional Planning in the Northeast.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slide 11.

⁹⁰ NYISO (2009f). “NYISO Anticipates Sufficient Electricity Supply for Summer 2009,” NYISO Press release, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_Anticipates_Sufficient_Electricity_Supply_for_Summer_2009_05212009.pdf.

⁹¹ Derived from NYISO (2009a). *2009 Load and Capacity Data ‘Gold Book’*. “Table III-2,” pp. 30-57.

⁹² NYISO (2009f). “NYISO Anticipates Sufficient Electricity Supply for Summer 2009,” NYISO Press Release.

⁹³ Buechler, J. (NYISO) (2009). “Inter-Regional Planning in the Northeast.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slide 10.

⁹⁴ Patton, D. and P. Lee VanSchaick (2008). *2007 State of the Market Report*. New York ISO. Prepared by Potomac Economics, Ltd. Independent Market Advisor to the New York ISO, at http://www.nyiso.com/public/webdocs/documents/market_advisor_reports/NYISO_2007_SOM_Final.pdf, p. 37.

⁹⁵ NYISO (2009c). *2009 Reliability Needs Assessment: Comprehensive System Planning Process*. Table 2-1, pp. 2-7.

⁹⁶ NYISO (2009e). *Reliability Summary 2009-2018*, p. 5.

⁹⁷ NYISO (2009b). *Power Trends 2009*, p. 15 and NYISO (2009e). *Reliability Summary 2009-2018*, p. 6.

⁹⁸ Buechler, J. (NYISO) (2009). “Inter-Regional Planning in the Northeast.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slide 35.

the grid's dynamics and transmission and generation needs could change markedly in ways that this Congestion Study cannot predict or address.

A significant amount of new generation is proposed in PJM. At the end of 2008, PJM's interconnection queue had 32,965 MW of active projects, of which 30 MW had come in service and 83 MW was under construction. By the end of 2008, however, 5,990 MW of generation capacity within PJM had retired, with another 1,651 MW pending retirement;⁹⁹ the net result of these retirements, weighed against the new generation additions and continued load growth, meant that PJM faced possible near-term reliability criteria violations in many areas.¹⁰⁰

Development of new wind generation is likely to have a significant effect on bulk system power flows across the region; but with many potential wind development sites across the Mid-Atlantic, from the Appalachian Mountains to large wind developments off the shores of New Jersey, the likely flow patterns and impacts are not yet fully understood and will require further analysis. At the start of 2009:

- PJM had about 1,800 MW of wind generation connected to its system, with another 1,800 MW under construction and over 46,000 MW of wind generation capacity (250 project requests) in its interconnection queue.¹⁰¹
- New Jersey is evaluating at least 3,000 MW of potential off-shore wind development by 2020 (some projects with in-service dates of 2013), with a complementary goal of producing 2,120 GWh from solar energy by 2020.
- New York had 1,274 MW of wind plant capacity in operation as of April 2009, and 8,017 MW in its interconnection queue.¹⁰² Con Edison and the Long Island Power Authority have joint plans to evaluate transmission needed to develop off-shore wind in increments of 350 MW.

⁹⁹ PJM (2009h). *2008 Regional Transmission Expansion Plan (RTEP)*, at http://www.pjm.com/documents/reports/rtep-report.aspx?sc_lang=en, p. 31.

¹⁰⁰ *Ibid.*

¹⁰¹ ISO-NE, NYISO and PJM (2009). *2008 Northeast Coordinated Electric System Plan: ISO New England, New York ISO and PJM*, at http://www.interiso.com/public/document/NCSP_2008_20090327.pdf, p. 31.

¹⁰² NYISO (2009g). "Wind Power Growing in New York," NYISO Press release, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/Wind_Power_Growing_In_NY_04222009.pdf.

¹⁰³ Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), p. 24.


The Department is supporting the work of NREL and the Eastern Interconnection system planning organizations on the Eastern Wind Integration and Transmission Study (EWITS), to better understand how significant increases in variable generation can be incorporated reliably into the Eastern grid.

Changes in Transmission

Figure 4-7 shows recent transmission built in New York. One of the most notable transmission additions in New York was the completion of the merchant Neptune project in 2007, an under-sea 230 kV cable from PJM to Long Island that added 660 MW of eastbound import capability. Although flows on the cable can be bi-directional, in 2008 all power flows went from PJM to New York, with average hourly east-bound flows at 572 MW.¹⁰³

Figure 4-8 illustrates why new transmission such as the Neptune project is needed. Most of the electricity flows in upstate New York are either west-to-east or north-to-south, and all move electricity toward the New York City area. Because transmission capacity into this area is limited, New York City is

Figure 4-7. New Transmission Built in New York Area

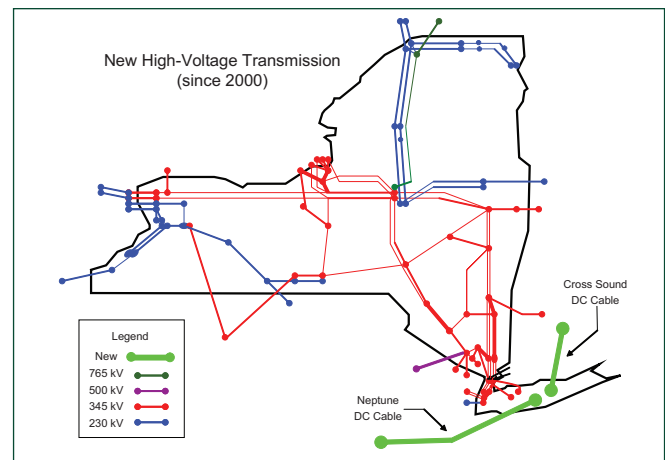

Source: NYISO (2009b). *Power Trends 2009*, at http://www.nyiso.com/public/webdocs/newsroom/current_issues/nyiso_power Trends 2009_final.pdf, p. 6.

an epicenter of transmission congestion and its delivered energy prices are higher than in other eastern load centers.

New York's Market Monitor explains that:

The primary transmission constraints in New York occur at the following locations:

- The Central-East interface that separates eastern and western New York;
- The transmission paths connecting the Capital region to the Hudson Valley;
- The transmission interfaces into load pockets inside New York City; and
- The interfaces into Long Island.

As a result of transmission congestion and losses, there was considerable variation in clearing prices across the system. In the day-ahead market, eastern up-state prices were 27% higher than average prices in western

New York, New York City prices were 8% higher than average prices in the eastern up-state region, and Long Island prices were 22% higher than average prices in the eastern up-state region.


Total congestion costs declined from \$770 million in 2006 to \$740 million in 2007. The reduced congestion costs in 2007 were largely due to: a) mild summer weather, which reduced the frequency of shortage conditions; and b) the installation of 660 MW of new transmission capacity from New Jersey to Long Island, which reduced congestion on the interface between up-state New York and Long Island.¹⁰⁴

The effect of the Neptune cable, activated in July 2007, was to reduce average prices in east New York by 3%.¹⁰⁵

The NYISO reports several recent changes in congestion patterns in the state:

- Congestion into southeast New York (Long Island and New York City) has declined over the past two years due to the availability of the Cross Sound Cable (2006), the Neptune Cable (2007), and improved system modeling of the New York City load pockets;
- Higher net imports into western New York from Hydro Quebec, Ontario and PJM have increased congestion on the Central-East interface (responsible for 39% of 2007 congestion costs, with the adjoining Pleasantville-Leeds and Dunwoodie-Shore facilities responsible for another 48% of those costs¹⁰⁶);
- Weather alerts and reserve shortages have increased congestion from Albany through the Hudson Valley;
- Congestion-reducing benefits of new transmission have been offset by higher fossil fuel prices.¹⁰⁷

Figure 4-8. Bulk Power Flows in New York State

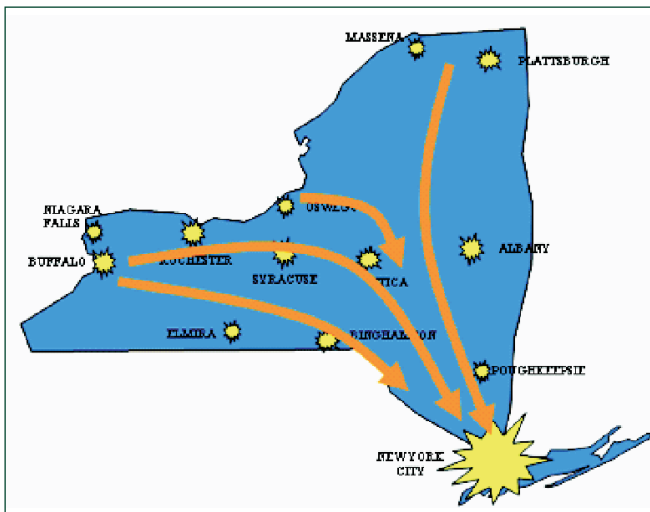

Source: Buechler, J. (NYISO) (2009). "Inter-Regional Planning in the Northeast." Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slide 20.

¹⁰⁴ Patton, D. and P. Lee VanSchaick (2008). *2007 State of the Market Report*. New York ISO, p. vi.

¹⁰⁵ *Ibid.*

¹⁰⁶ NYISO (2009c). *2009 Reliability Needs Assessment: Comprehensive System Planning Process*, p. 6-2.

¹⁰⁷ Buechler, J. (NYISO, 2008). "Comments of the New York ISO." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study, Hartford, Connecticut. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 6.


Transmission congestion affects New York’s day-ahead and real-time markets, preventing customers from buying power from the least expensive producers. Market operations software calculates the LMP or market-clearing price of serving load at each location; a higher LMP at a given point in time reflects the fact that transmission congestion and line losses limit deliverability of less expensive energy to that location. Transactions in the day-ahead market are based on predicted transmission capacity, and congestion costs are priced at the calculated congestion component of the LMP. However, “market participants can hedge congestion charges in the day-ahead market by owning Transmission Congestion Contracts (TCCs), which entitle the holder to payments corresponding to the congestion charges between two locations. Excepting losses, a participant can perfectly hedge its bilateral contract if it owns a TCC between the same two points over which it has scheduled the bilateral contract.”¹⁰⁸ Day-ahead congestion costs in 2007 were over

\$750 million, offset by \$680 million in day-ahead congestion rents; balancing congestion costs (incurred when forecast day-ahead transmission flows exceed actual real-time availability on a particular line, and the ISO must redispatch generation to keep the constraint in balance) equaled \$159 million in 2007.¹⁰⁹

The decline of real-time congestion on New York’s major interfaces is shown in Figure 4-9, which shows that congestion has declined markedly since its peak in 2004. However, congestion was still problematic in 2007, affecting the Central-East interface in 10% of the hours of the year, into New York City 5% of the time, into Long Island 25% of the hours, and into City load pockets 20% of the year.¹¹⁰ The cost of down-state congestion in New York reached \$280 million in 2007.

PJM has experienced annual congestion costs of about \$1.6-\$1.8 billion per year since 2005, and doesn’t expect those costs to decline significantly

Figure 4-9. Frequency of Real-Time Congestion on Major Interfaces 2002-2007

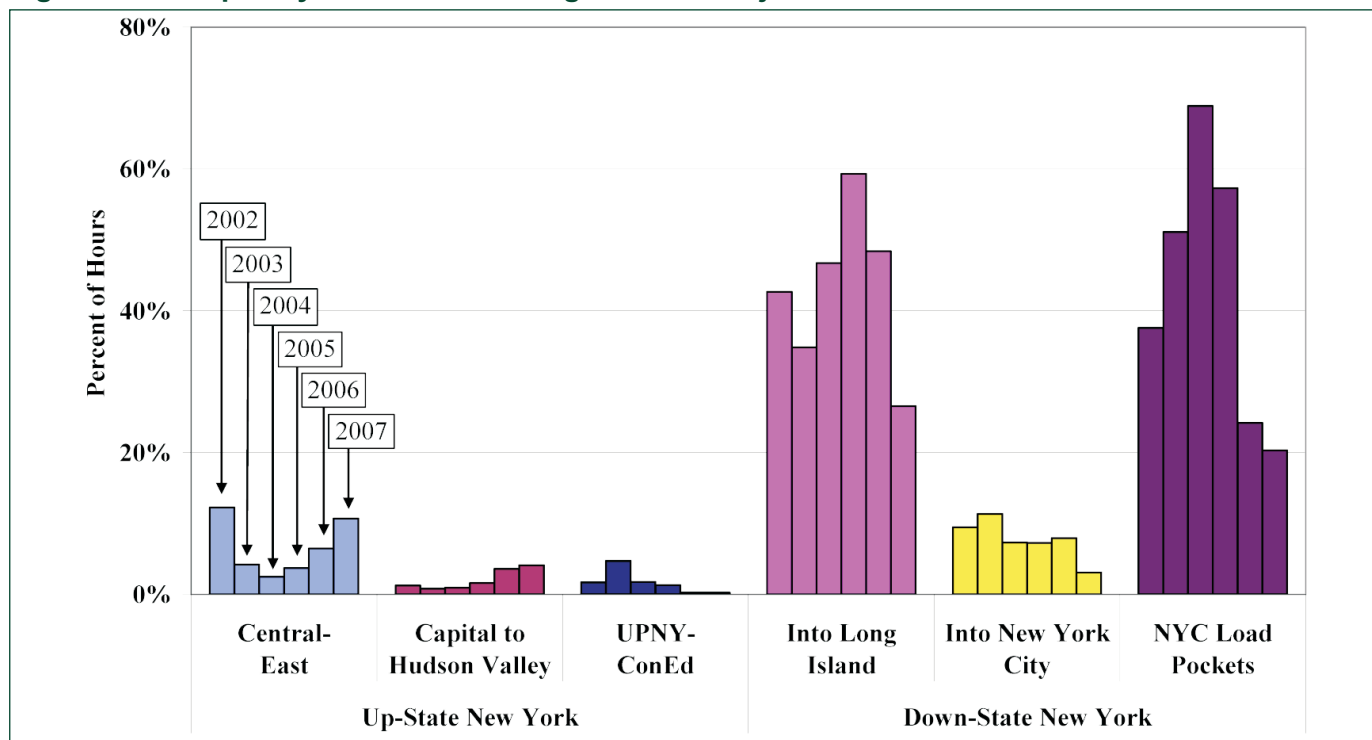

Source: Patton, D. and P. Lee VanSchaick (2008). *2007 State of the Market Report*. New York ISO. Prepared by Potomac Economics, Ltd., Independent Market Advisor to the New York ISO, at http://www.nyiso.com/public/webdocs/documents/market_advisor_reports/NYISO_2007_SOM_Final.pdf, Figure 35, p. 68.

¹⁰⁸ Patton, D. and P. Lee VanSchaick (2008). *2007 State of the Market Report*. New York ISO, p. 66.


¹⁰⁹ *Ibid.*, pp. 67-74.

¹¹⁰ *Ibid.*, p. 68.

until major new transmission projects are completed. Congestion costs increased to \$2.12 billion PJM-wide in 2008, amounting to approximately 6% of total electricity billings.¹¹¹ “Price separation between eastern, southern and western control zones in PJM was primarily a result of congestion on the Allegheny Power (AP) South interface. This interface had the effect of increasing prices in eastern and southern control zones located on the constrained side of the affected facilities while reducing prices in the unconstrained western control zones.”¹¹² PJM reports that in 2007 its top 20 congestion-causing constraints were responsible for 87% of PJM’s total congestion costs in that year; one particular constraint caused half a billion dollars of congestion annually. (See Figure 4-10.)

Total congestion is less important than its local or zonal impacts. The impacts of PJM’s congestion on electricity producers and users differ as a function of the location of each relative to the constraints. Table 4-3 summarizes congestion costs across PJM by control area for 2008 in total dollars paid by, or credited to, electricity users and producers. Note that AP and Dominion customers paid the highest net total for congestion (as one would expect given the location of the key PJM transmission constraints shown in Figure 4-10), while generators on the eastern side of the constraints [e.g., those in the Baltimore Gas & Electric (BGE), Potomac Electric Power Company (PEPCO) and New Jersey’s Public Service Enterprise Group (PSEG)] all earned high congestion credits in PJM’s day-ahead market.¹¹³

Figure 4-10. Major Points of Congestion in PJM, 2007

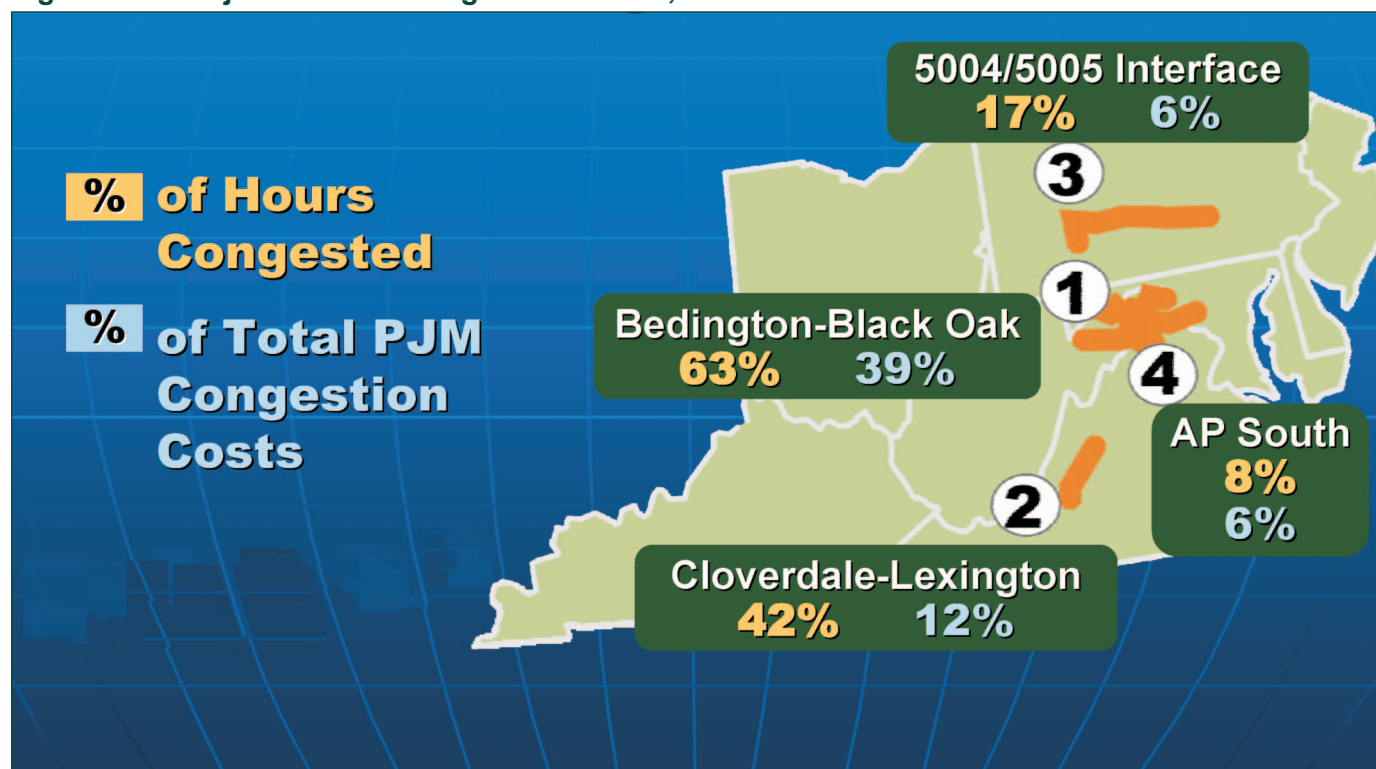

Source: Federal Energy Regulatory Commission (FERC) (2008a). “2008 Summer Market Forecast.” Office of Enforcement, <http://www.ferc.gov/market-oversight/mkt-views/2008/05-15-08.pdf>, slide 10.

¹¹¹ Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), p. 50.

¹¹² *Ibid.*, p. 51.

¹¹³ PJM and other organized wholesale markets have financial hedging mechanisms so electricity buyers and sellers can offset the costs of congestion. In PJM these mechanisms are tradable Financial Transmission Rights (FTR) and Auction Revenue Rights (ARR), made available to the firm loads that pay for the cost of the transmission system. “While the transmission system, and therefore ARRs/FTRs, are not guaranteed to be a complete hedge against congestion, ARRs/FTRs do provide a substantial hedge to the cost of congestion to firm load.” See Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), p. 50.

These observations support the concerns raised in the 2006 study about the continuing impacts of transmission congestion upon the metropolitan area stretching from Washington DC north through eastern Maryland, Pennsylvania and New Jersey.

New transmission projects and upgrades designed and approved through PJM’s Regional Transmission Expansion Plans (RTEPs) target each of these transmission constraints; these projects have in-service dates ranging from mid-2008 out through 2012. Using simulations developed for the RTEP, PJM estimates that annual congestion costs of \$1,800 million in 2007 could be reduced to \$250 million by 2012.¹¹⁴

As noted earlier, however, PJM warns that “transmission [congestion] is more of a network issue than an individual constraint,” i.e., it is a major west-to-east problem on the Mid-Atlantic transmission grid, and a broad program of improvement is required. If only a single key constraint is eased,

another will emerge—for instance, as Bedington-Black Oak becomes less problematic, there will be more frequent congestion on the Cloverdale-Lexington 500 kV line in West Virginia.¹¹⁵ As the major new transmission projects such as the Trans-Allegheny Interstate Line (TrAIL) and the Potomac-Appalachian Transmission Highline (PATH) are brought into service, they could significantly change the electricity flow and congestion patterns at these constrained interfaces and elsewhere across the Mid-Atlantic.

New York offers a similar observation—since two-thirds of the state’s load is located in the southeast (around New York City and Long Island), while most of its lower-cost generation is in the north, the state’s physical and economic transmission constraints “just walk down the Hudson River.”¹¹⁶ New York’s transmission constraints showed a similar pattern to PJM’s in that only a few constraints accounted for the bulk of the transmission congestion cost (on a bid production cost basis) is

Table 4-3. PJM Congestion Cost Summary by Control Zone, Calendar Year 2008 (Million Dollars)

Control Zone	Day Ahead				Balancing				Grand Total
	Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	
AECO	\$111.1	\$31.8	\$1.2	\$80.5	(\$12.9)	\$8.1	(\$2.0)	(\$23.0)	\$57.5
AEP	(\$367.1)	(\$671.0)	\$15.7	\$319.6	(\$85.2)	\$4.0	(\$6.9)	(\$96.1)	\$223.6
AP	\$124.4	(\$391.6)	\$38.7	\$554.7	(\$13.6)	\$21.5	(\$32.6)	(\$67.7)	\$487.1
BGE	\$314.3	\$245.3	\$3.2	\$72.2	\$10.1	(\$14.2)	(\$4.5)	\$19.8	\$92.0
ComEd	(\$480.9)	(\$820.9)	\$4.8	\$344.8	(\$54.9)	\$0.4	(\$5.2)	(\$60.6)	\$284.2
DAY	(\$45.5)	(\$56.5)	\$0.2	\$11.1	\$3.5	\$2.6	(\$0.3)	\$0.6	\$11.8
DLCO	(\$159.2)	(\$249.2)	\$1.1	\$91.2	(\$49.4)	\$22.2	\$0.3	(\$71.3)	\$19.9
Dominion	\$337.2	\$5.2	\$33.0	\$364.9	(\$9.3)	(\$0.9)	(\$33.9)	(\$42.3)	\$322.6
DPL	\$149.5	\$54.1	\$1.1	\$96.5	\$8.0	\$6.2	(\$1.8)	(\$0.1)	\$96.4
External	(\$59.5)	(\$51.5)	\$35.6	\$27.5	(\$31.6)	(\$36.4)	(\$107.5)	(\$102.7)	(\$75.2)
JCPL	\$260.6	\$72.1	\$9.1	\$197.6	(\$0.0)	(\$0.4)	(\$8.9)	(\$8.5)	\$189.0
Met-Ed	\$104.9	\$104.5	\$3.3	\$3.8	\$2.3	\$0.8	\$10.4	\$12.0	\$15.7
PECO	\$70.9	\$118.1	\$0.5	(\$46.8)	(\$0.5)	\$15.5	(\$0.7)	(\$16.8)	(\$63.5)
PENELEC	(\$43.2)	(\$224.3)	\$4.8	\$186.0	(\$4.8)	\$13.6	(\$1.4)	(\$19.9)	\$166.1
Pepco	\$642.4	\$436.2	\$8.4	\$214.7	\$6.6	(\$3.7)	(\$9.1)	\$1.2	\$215.9
PPL	\$29.0	\$39.9	\$12.7	\$1.8	\$0.2	\$5.6	(\$5.2)	(\$10.6)	(\$8.8)
PSEG	\$287.3	\$190.9	\$33.3	\$129.7	\$5.2	\$34.5	(\$27.9)	(\$57.3)	\$72.5
RECO	\$10.0	\$0.1	\$1.5	\$11.4	\$0.5	(\$0.2)	(\$2.2)	(\$1.5)	\$9.9
Total	\$1,286.1	(\$1,166.7)	\$208.4	\$2,661.2	(\$225.9)	\$79.2	(\$239.5)	(\$544.6)	\$2,116.6

Source: Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. (Vol. 1- Introduction), at http://www.monitoringanalytics.com/reports/PJM_State_of_the_Market/2008.shtml, Table 6, p. 53.

¹¹⁴Herling, S. (PJM) (2009). “Congestion and the PJM Regional Transmission Plan.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slides 3-12, and remarks at that workshop.

¹¹⁵Kormos, M. (2008). “Comment of Michael J. Kormos Senior Vice President-Operations PJM Interconnection, L.L.C.,” p. 4.


¹¹⁶Private communication between Diane Barney, New York State Public Service Commission, and Joe Eto, Lawrence Berkeley National Laboratory, March 27, 2009.

due to three transmission constraints—the Central East voltage constraint, the Leeds to Pleasant Valley line, and the Dunwoodie to Shore Road line.¹¹⁷ Eliminating upstate bottlenecks will not relieve the fact that the Dunwoodie interface still limits flows into New York City.¹¹⁸ But under New York’s cost allocation rules, transmission projects that significantly reduce congestion and prices downstate generally increase prices for upstate consumers without creating large net benefits overall.¹¹⁹

One recent analysis suggests that it would be more economical to relieve in-City congestion by increasing local energy efficiency and in-city generation than to build new major transmission facilities down from upstate.¹²⁰

PJM now has five major new transmission projects approved and under development, as shown in Figure 4-11. They are:

Figure 4-11. Approved New Backbone Transmission in PJM

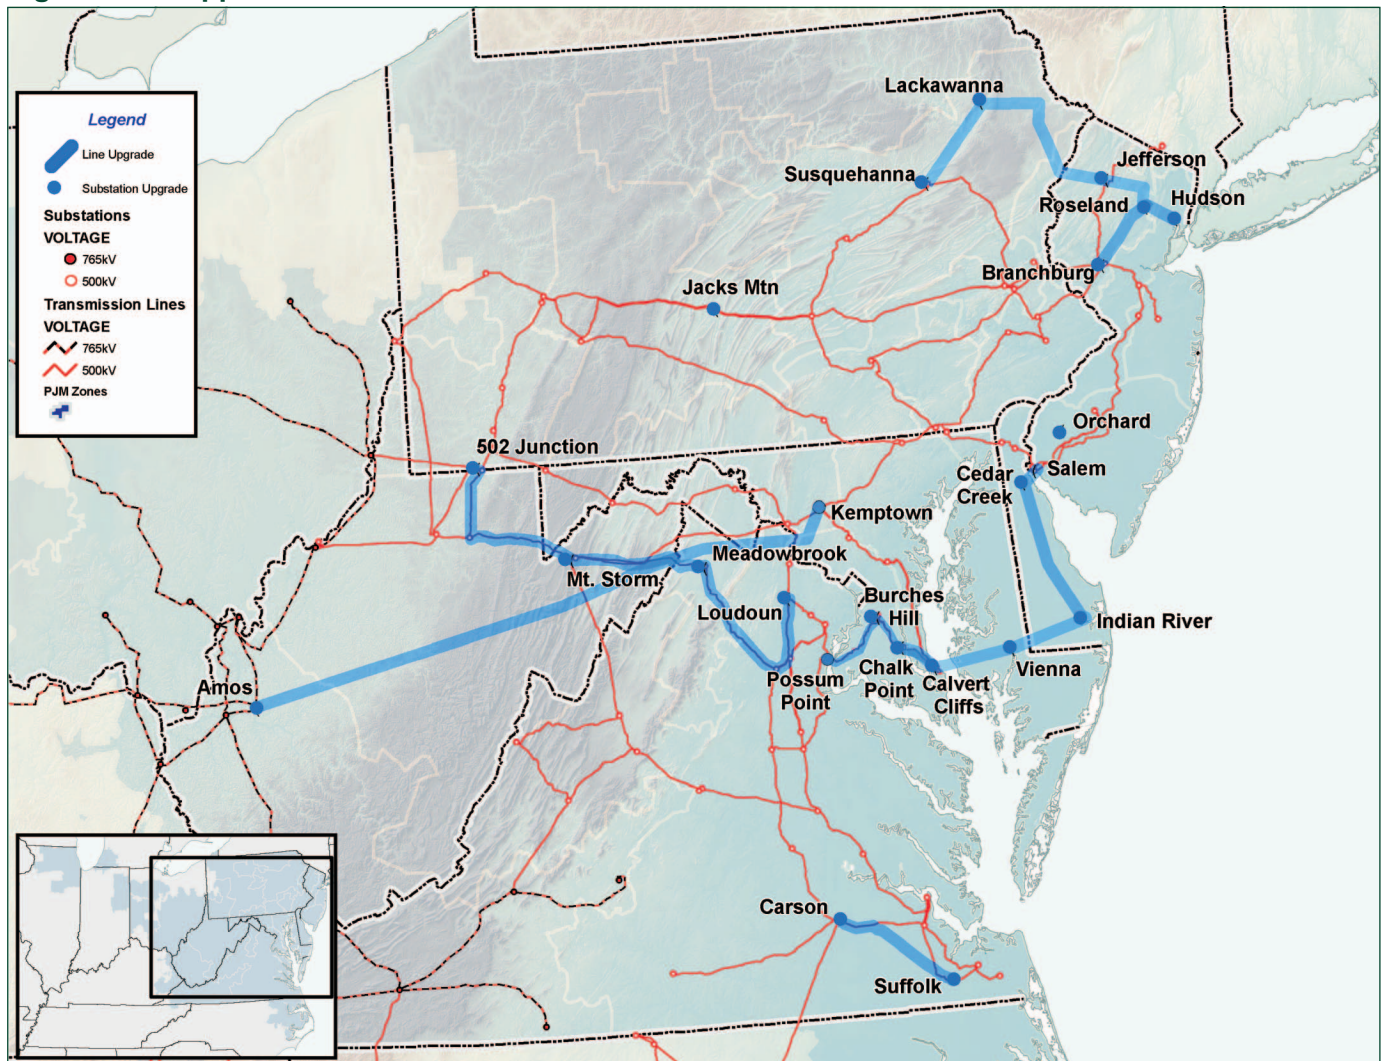

Source: Herling, S. (PJM) (2009). “Congestion and the PJM Regional Transmission Plan.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slide 7.

¹¹⁷ Buechler, J. (NYISO, 2009). “Inter-Regional Planning in the Northeast,” slide 23, and Workshop Transcript, p. 10.

¹¹⁸ Russo, C.J., R.B. Niemann et al. (2009). *A Master Electrical Transmission Plan for New York City*. Draft prepared for the New York City Economic Development Corporation. CRA International Project No. D13536, at <http://www.crai.com/uploadedFiles/Publications/a-master-electrical-transmission-plan-for-new-york-city.pdf>, p. 29.

¹¹⁹ *Ibid.*, p. 21.

¹²⁰ *Ibid.*, pp. 24-29.

- TrAIL is a 210-mile, 500 kV line from West Virginia, Maryland and Virginia, that will relieve expected overloads in the Washington DC area.
- A 130-mile, 500 kV circuit from Susquehanna, Pennsylvania to Roseland, New Jersey, will link generation from northeastern and north-central Pennsylvania into New Jersey.
- PATH will be a 244-mile 765 kv line from Amos, WV to Bedington, MD and a 92-mile, 500 kV line from Bedington to Kempton, MD and is expected to relieve congestion around Washington DC and Baltimore.
- The Mid-Atlantic Power Pathway (MAPP) will be a 190-mile 500 kV line from Possum Point, Virginia, to Salem, New Jersey, with a direct current (DC) line crossing the Chesapeake Bay.
- The Branchburg to Roseland to Hudson (all in New Jersey) 500 kV line will resolve a number of thermal and reactive voltage reliability violations.¹²¹

These projects, and continuing upgrades to the system, will significantly alter the magnitude and location of congestion in the region in the future. PJM estimates that the transmission projects listed above, once completed, will eliminate 90% of the region's total congestion cost.¹²²

There is a large merchant transmission queue in PJM, as shown in Figure 4-12. The fact that so many merchant transmission projects are competing in the region indicates market confidence that PJM's market rules and regulatory environment offer good prospects for financial and market success with sustainable long-term cost recovery.

In New York, comparable transmission projects include the addition of a Variable Frequency Transformer to the Goethals 345 kV line and two proposed transmission projects across the Hudson River (660 MW and 550 MW), to support

downstate New York, and a proposed new line from Canadian Niagara Power to import energy downstate from Canada.¹²³ As noted in Chapter 3, the proposed NYRI High Voltage Direct Current (HVDC) project was recently withdrawn.

4.4.3. Other Evidence of Congestion

Figures 4-13 and 4-14 show daily bilateral on-peak locational marginal prices averaged at hubs in the Mid-Atlantic, for a recent 15-month period and for the past four years. Both graphics show clear patterns of significant, sustained price differentials.

Figures 4-13 and 4-14 demonstrate three other points. First, they illustrate that congestion impacts (as reflected in differences between wholesale electric prices at area pricing hubs) are generally higher at eastern locations than western. For instance, although the average real-time energy price across PJM was \$66.29/MWh for all of 2008, the average real-time LMP in Commonwealth Edison's service territory was \$49.38/MWh, \$74.70 to \$79.14/MWh for New Jersey's utilities, and \$80.45 for PEPCO.¹²⁴ This is what one would expect, given that Mid-Atlantic load-serving entities import electricity across constrained interfaces from lower-cost sources located to their west. Second, they show that overall prices have gone down over the past year, which reflects the decline in fuel costs and some recent transmission improvements reducing congestion. Third, there is less volatility in recent price differentials between regions; this too may reflect the impact of transmission upgrades that went into service in 2008.

4.4.4. Conclusions for the Mid-Atlantic Region

The above information leads the Department of Energy to several conclusions pertinent to past and future transmission congestion within the Mid-Atlantic region:

¹²¹North American Electric Reliability Corporation (NERC) (2008). *2008 Long-Term Reliability Assessment, 2008-2017*, at http://www.nerc.com/files/LTRA2008v1_2.pdf, p. 165, and PJM (2009h). *2008 Regional Transmission Expansion Plan (RTEP)*, pp. 2 and 5.

¹²²PJM (2009h). *2008 Regional Transmission Expansion Plan (RTEP)*, p. 7.

¹²³NYISO (2009a). *2009 Load and Capacity Data 'Gold Book'*, p. 117.


¹²⁴Monitoring Analytics (2009b). "State of the PJM Market, Quarter 1, 2009." Presentation to PJM Members Committee, at <http://www.pjm.org/Media/committees-groups/committees/mc/20090507/20090507-item-11-market-monitor-report.pdf>, p. 34.

- The load centers continue to experience the impacts of significant levels of transmission congestion, measured in terms of economic cost and reliability. Much of that congestion limits west-to-east flows toward coastal load centers.
- The region is making significant progress in reducing loads and improving reliability through the use of aggressive energy efficiency and demand response programs.
- Although there are many projects in the NYISO and PJM generation interconnection queues, new generation is slow to come on-line and is often offset by retirement of older generation capacity.
- Although the planning entities (PJM and NYISO) have strong analytical planning processes with good stakeholder involvement, it takes years to bring needed large-scale, multi-state transmission projects from analysis to plan to reality.
- While PJM is making important progress toward significant transmission system upgrades and transmission expansion, it will be several years

before these projects have a significant impact on current transmission congestion levels.

- Much less new transmission has been built in New York, although its market mechanism is causing more generation and demand-side resources to be built close to southeast load centers. Until New York has better load and resource balance from sources within and close to New York City, Long Island and Westchester County, there will continue to be tension between New York's needs and PJM's, and significant price differentials across the region.
- Slow development of new generation and new backbone transmission facilities (notwithstanding the growth in demand-side resources to moderate load growth and assist operational reliability) could compromise continued reliability in the Washington, Baltimore, New Jersey and New York City areas.
- Aggressive state renewable portfolio standards, large queues of proposed wind generation projects, and uncertainty about the potential for lower use of fossil plants due to carbon emissions

Figure 4-12. PJM Merchant Transmission Queue (as of 1/31/09)

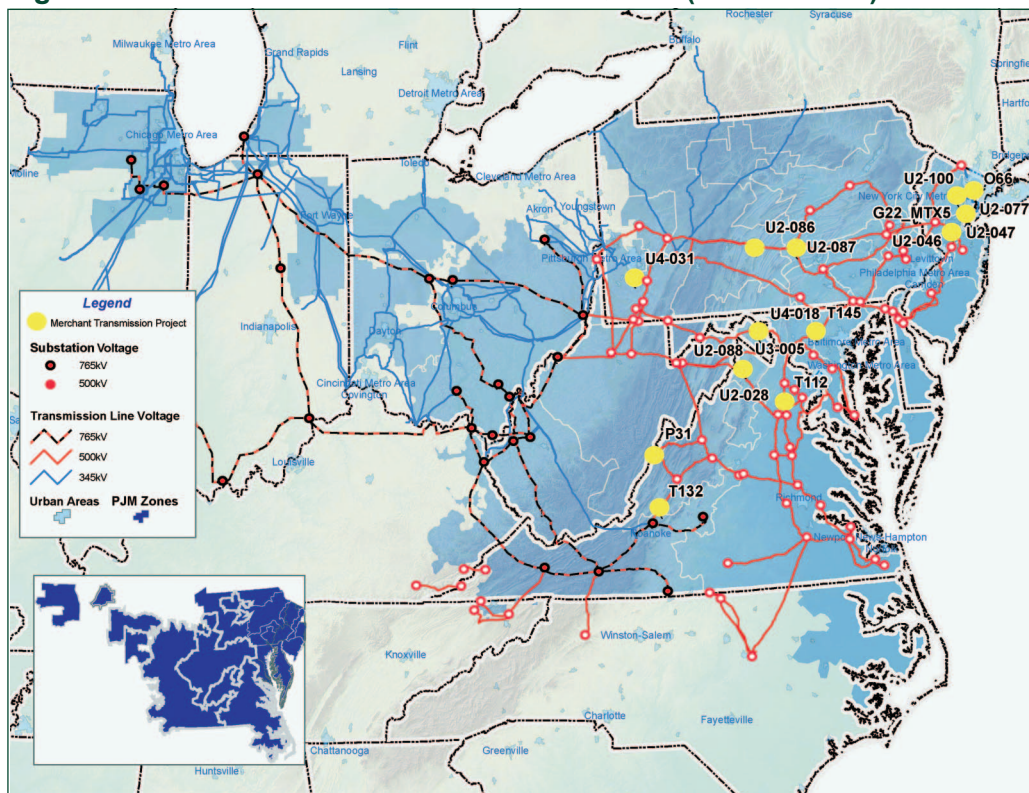


Source: PJM (2009h). *2008 Regional Transmission Expansion Plan (RTEP)*, at http://www.pjm.com/documents/reports/rtep-report.aspx?sc_lang=en, p. 33.

limits make it difficult for planners to determine what future transmission projects will be needed to link generation to loads.

- The pace of economic activity in the Mid-Atlantic region has slowed as a result of the recession that began in 2008. Although the slowdown has tended to reduce transmission congestion in the area, this is likely to be a short-term effect that will be eroded as the regional economy revives. As such, it does not imply that the overall area’s congestion problems have been resolved. The slowdown may, however, provide additional time for the various congestion-reducing measures discussed above to work. DOE invites commenters on this study to address the relationship between the recession and transmission congestion.

For these reasons, the Department finds that the Mid-Atlantic region continues to exhibit major transmission congestion problems and should be continue to be identified as a Critical Congestion Area. This identification—as is the case with the others that follow in this document—is based on consideration of the totality of the various kinds of information presented, rather than on whether specific congestion metrics have been met or exceeded.

Figure 4-13. Sustained Price Differentials Across the Mid-Atlantic Region

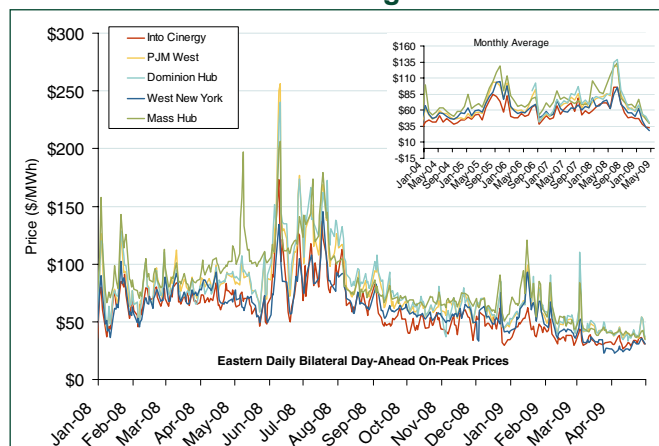

Source: Federal Energy Regulatory Commission (FERC) (2009b). “OE Energy Market Snapshot: Northeast States Version—April 2009 Data.” Office of Enforcement, at <http://www.ferc.gov/market-oversight/mkt-snp-sht/2009/06-2009-snapshot-ne.pdf>, p. 11.

¹²⁵ ISO New England (ISO-NE) (2008d). *2008 Regional System Plan*, at http://www.iso-ne.com/trans/rsp/2008/rsp08_final_101608_public_version.pdf, Table 3-3, p. 25.

¹²⁶ *Ibid.*, p. 23.

¹²⁷ *Ibid.*, p. 25.


4.5. New England Congestion Area of Concern

The Department’s 2006 study identified New England as a Congestion Area of Concern, reflecting the transmission constraints and significant congestion in the Southwest Connecticut and Boston area load pockets and the surplus of generation trapped behind transmission constraints in Maine. Conditions in New England have changed markedly over the past three years, as reviewed below.

4.5.1. Changes in Load and Demand-Side Resources

Peak load in New England equaled 26,545 MW in 2005, and 27,765 MW in 2008;¹²⁵ the peak hit 28,130 MW in 2006 under extremely hot weather conditions. The current load forecast anticipates peak demand of 28,480 MW in 2009, given normal weather.¹²⁶ ISO-NE reports that although load was growing at an annual compound rate of 1.2%, the combined effects of the economic slowdown and energy efficiency have slowed the rate of load growth.¹²⁷ Some areas have been growing disproportionately faster than others; for instance the

Figure 4-14. Significant Price Divergence Between Zones in NYISO—Daily Average of NYISO Day-Ahead Prices, All Hours

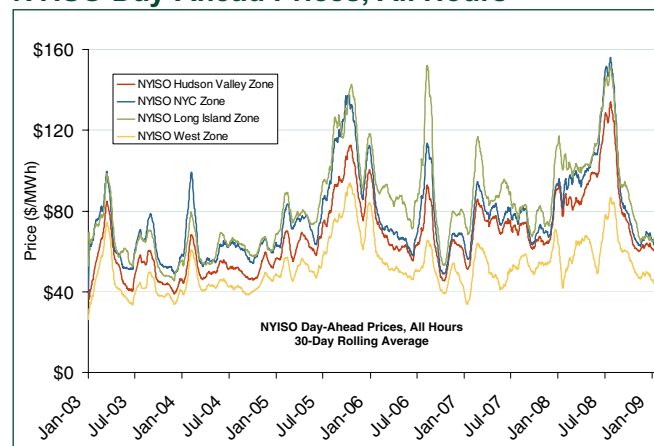

Source: Federal Energy Regulatory Commission (FERC) (2009b). “OE Energy Market Snapshot: Northeast States Version—April 2009 Data,” Office of Enforcement, at <http://www.ferc.gov/market-oversight/mkt-snp-sht/2009/06-2009-snapshot-ne.pdf>, slide 10.

Boston metro area, Cape Cod and northwestern Vermont have experienced higher load growth.¹²⁸

Most of the New England states have energy efficiency resource goals:

- Connecticut has set goals of 1.5% annual savings from 2009 through 2019, using all cost-effective energy efficiency;
- Maine seeks a 10% energy efficiency load reduction by 2017, using demand response and energy efficiency as priority resources;
- Massachusetts seeks a 25% cut in electric capacity needs and energy use by 2020 using energy efficiency, demand response, load management and distributed generation;
- Rhode Island calls for a 10% reduction of 2006 electric sales by 2022; and
- Vermont set goals for 2009-2011 of 2% annual efficiency savings, with programs administered by the statewide Efficiency Vermont program.¹²⁹


New England states rank among the nation’s leaders in energy efficiency policy and program accomplishments. The ACEEE ranks Connecticut 3rd, Vermont 4th, Massachusetts 7th, Rhode Island 11th, and New Hampshire 18th among all states in its “2008 State Energy Efficiency Scorecard.”¹³⁰

New England has achieved impressive growth in demand response resources, particularly since adoption of its Forward Capacity Market (FCM) auction process to procure new location-specific resources. In New England’s first FCM, over 2,500 MW of demand response resources cleared the auction;¹³¹ those resources are due on line in 2010-2011. In the second FCM, in 2008, over 2,900 MW of demand response cleared the auction, spread

broadly across the region, as shown in Figure 4-15; those resources are due on line in 2012. As of April, 2009, New England reports a total of 3,276 assets ready to contribute 2,032 MW of demand response, with another 56 MW in the registration process; 40% of these demand response resources are concentrated in Connecticut, with another large percentage in Massachusetts load centers.¹³² New England’s demand response programs include critical peak pricing, emergency generation, and seasonal peak demand response.¹³³

With the adoption of the FCM, New England has begun valuing energy efficiency and demand response as location-based, long-term reliability resources equivalent to supply-side resources. Under the FCM, “ISO New England projects the needs of the power system three years in advance and then holds an annual auction to purchase the power system resources that will satisfy the future regional requirements.”¹³⁴ In its system planning, the region

Figure 4-15. Growth of Demand Resources in New England, 2003-2008

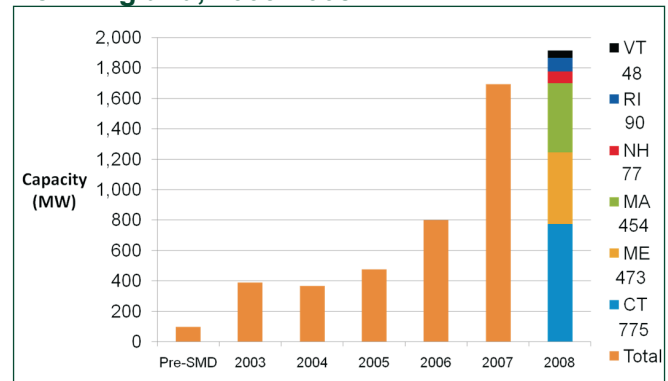

Source: Chadalavada, V. (2009b). “Roadmap to Renewable and Demand Resource Integration in New England.” Presented at the New England Conference of Public Utilities Commissioners Symposium, Newport, Rhode Island, at http://www.iso-ne.com/pubs/pubcomm/pres_spchs/index.html, slide 4.

¹²⁸NEEA (2007). “Electricity Transmission Infrastructure Development in New England: Value through Reliability, Economic and Environmental Benefits,” at <http://www.newenglandenergyalliance.org/downloads/New%20England%20Transmission%20Paper.pdf>, pp. 20-22.

¹²⁹FERC (2008b). “Electric Efficiency Resource Standards (EERS) and Goals.” Office of Market Oversight, at <http://www.ferc.gov/market-oversight/mkt-electric/overview/elec-ovr-eeeps.pdf>.

¹³⁰*Ibid.*, p. iv.

¹³¹ISO-NE (2008a). *2007 Annual Markets Report*, at http://www.iso-ne.com/markets/mkt_anlys_rpts/annl_mkt_rpts/2007/amr07_final_20080606.pdf, p. 77.

¹³²Chadalavada, V. (2009a). “NEPOOL Participants Committee Meeting, COO Report.” Presentation at NEPOOL Participants Committee Meeting, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/prtcpnts/mtrls/2009/may12009/coo_npc_report_may_1_2009.pdf, slide 30.

¹³³ISO-NE (2008d). *2008 Regional System Plan*, p. 49.

¹³⁴ISO-NE (2009c). *ISO New England Outlook*, at http://www.iso-ne.com/nwssiss/nwltrs/outlook/2009/outlook_jan_2009.pdf, p. 3.

therefore reports energy efficiency, demand response, distributed generation and load management procured through the FCM as resources rather than as load offsets.

4.5.2. Changes in Generation and Transmission

New Generation

New England anticipates that it will have 33,700 MW of resources available to meet demand of 27,875 MW in the summer of 2009, with local generation accounting for 31,225 MW, energy efficiency providing 500 MW, and demand response accounting for 1,900 MW.¹³⁵

A total of 42,777 MW of resources qualified to participate in New England's second FCM auction; of that amount, 33,988 MW of supply-side resources were selected, of which 1,157 MW are new generation.¹³⁶

New England has 101 new generation projects in its interconnection queue, representing approximately 13,700 MW. These projects are spread broadly across the region, reflecting the locational signals established by the area's FCM location-specific pricing—a majority of the proposed projects are located in Connecticut and Massachusetts, the zones that offer the highest future capacity payments.¹³⁷ It is also worth noting that 31% of the generation in the queue is peaking capacity, which offers high value for maintaining grid reliability and balancing variable renewable generation.¹³⁸ These resources are committed to be in service by 2012.

New England is transmission-constrained for the Maine generation pocket. It requires local reliability support for the Boston, North Shore, southeast Massachusetts, Springfield, and western Massachusetts areas and for much of Connecticut.¹³⁹

Despite these bright prospects for generation development several years out, New England faces some near-term challenges. The ISO's projections report that under reference or extreme load conditions, the region will have less operable capacity available than it will need to meet expected summer peaks in 2009 and 2010. If this situation materializes, operating plans to address it include calling on all interruptible and demand response resources reducing operating reserves, implementing voltage reductions, and even calling for voluntary customer load reductions in real-time,¹⁴⁰ to gain as much as 1,730 MW of load relief if extreme heat and loads occur. The region's 2008 Regional System Plan projects that this operable capacity deficit could continue through 2017.¹⁴¹ Note, however, that this is a projected deficit in resource availability that is distinct from issues related to transmission congestion.

All six New England states have a renewable portfolio standard or renewable goal. These will change electricity flow patterns as a function of where the new renewables are built (or imported from). It is likely that much of the new renewable capacity will require new or upgraded transmission facilities, as well as new or increased fast-start generation in load centers.

New Transmission

The New England utilities have brought a significant amount of new transmission projects into service since 2005, as listed in Table 4-4. Most of these projects were planned and built to improve reliability, and have helped to remedy several of New England's most problematic reliability and economic congestion problems. These and other projects now under construction are shown in Figure 4-16. Several of New England's prior congestion and reliability problems have been alleviated with these new lines—for instance, the new projects have added

¹³⁵ ISO-NE (2009b). "ISO New England Forecasts Adequate Resources to Meet Summer Electricity Demand; Economic Conditions Are Expected to Keep Peak Demand Flat." ISO-NE Press release, at <http://www.reuters.com/article/pressRelease/idUS166672+29-Apr-2009+BW20090429>.

¹³⁶ ISO-NE (2009c). *ISO New England Outlook*, p. 3.

¹³⁷ Chadalavada, V. (2009a). "NEPOOL Participants Committee Meeting, COO Report," slide 34.

¹³⁸ *Ibid.*, slide 36.

¹³⁹ ISO-NE (2008d). *2008 Regional System Plan*, p. 143.

¹⁴⁰ Chadalavada, V. (2009a). "NEPOOL Participants Committee Meeting, COO Report," slides 83-87.

¹⁴¹ ISO-NE (2008d). *2008 Regional System Plan*, Table 4-3, p. 36.

1,000 MW of additional import capacity into the Boston metro area, improved imports into critical load pockets like Southwest Connecticut (including the Connecticut-Long Island undersea cable) and strengthened the system in areas that have experienced major load growth, such as Northwest Vermont. A new 345 kV line from New Brunswick into Maine improves import capabilities from Canada.

ISO-NE reports that its transmission planning process has “identified the need for more than \$6 billion of additional transmission investment over the next decade to ensure the region meets reliability standards.”¹⁴² That planning process has extensive stakeholder participation, including market participants and government representatives, including those from neighboring Canadian provinces. ISO-NE planners also coordinate with the NYISO and PJM planning activities, and expect to participate in upcoming interconnection-wide inter-regional planning efforts.

4.5.3. Other Evidence of Congestion

One way to assess congestion is to look at how price levels vary across the study area. Examination of real-time and day-ahead LMPs across New England for the past year shows that prices vary relatively little across the 9 zones. This is illustrated in Figure 4-17, which shows 13 months of monthly average real-time LMPs across all hours. A similar pattern holds for on-peak hours and in the day-ahead and real-time markets. ISO-NE’s analyses of LMPs also show relatively small variations between LMPs across zones.¹⁴³

Several factors suggest that the work New England has been doing to build new transmission and add new generation and demand-side resources is having a substantial impact in reducing total transmission congestion. First, the most persistent nodal LMP variations in New England trend from north to south, as shown in Figure 4-18. ISO-NE reports that

Table 4-4. New Transmission Projects Brought In-Service in New England, 2005-2009

Subregion	Transmission Project Name	In-Service Date
Boston	NSTAR 345 kV Transmission Reliability Project (Stage 1)	Nov-06
Boston	NSTAR 345 kV Transmission Reliability Project (Stage 2)	Dec-08
Southwest Connecticut	Southwest Connecticut (Bethel - Norwalk) Project	Dec-06
Southwest Connecticut	Southwest Connecticut (Middletown - Norwalk) Project	Dec-08
Southwest Connecticut	Norwalk - Glenbrook Cable Project	Nov-08
Southwest Connecticut	Norwalk - Northport 1385 upgrade	July 08
Vermont	Northern Loop Project	Dec-05
Vermont	Portions of Northwest Vermont Reliability Project	Apr-09
New Hampshire	Tioga Project	Jun-05
New Hampshire	Scobie Pond to Hudson Reinforcement Project	May-08
Northeast Massachusetts	North Shore Project	Jul-06
Central Massachusetts	Central Massachusetts Reinforcements	Dec-06
Connecticut	Killingly Project	Dec-06
Connecticut	Haddam / Middletown Reliability Project	Nov-05
Rhode Island	Southwest Rhode Island Project	Dec-08
Maine	Northeast Reliability Interconnect Project	Dec-07
Maine	Maguire Road Project	Aug-08

Source: Information modified from material provided by Michael Henderson, ISO-New England system planning.

¹⁴²Rourke, S. (ISO-NE) (2008). “Remarks of Stephen J. Rourke, Vice President, System Planning, ISO New England.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Hartford, Connecticut. See Materials Submitted at the Meeting at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 3.

¹⁴³See, for example, ISO-NE (2009a). *2008 Fourth Quarter Markets Report*, at http://www.iso-ne.com/markets/mkt_anlys_rpts/qrly_mktops_rpts/2008/2008_q4_quarterly.pdf, p. 24.


the lower prices in Maine (blue on the map, at \$54/mWh) reflect transmission losses on imports coming into New England, while the higher prices in western Connecticut reflect transmission losses on exports to New York.¹⁴⁴ However, the variation between the highest and lowest locational prices is not extreme—a high of \$64 and a low of \$54, indicating that while some transmission congestion exists, it is not creating disproportionately large price differentials across the region. Second, the hourly average LMP differences between New England zones are small.¹⁴⁵ Third, not only are the variations in total price relatively small across the New England zones, as shown in Figure 4-19, the magnitude of those differentials has declined consistently across all of the zones over the past four years.¹⁴⁶

ISO-NE and others conclude that much of the price differentials remaining are due to line losses from generation distant from loads, that there appears to be little congestion on the New England system as a whole, and that what congestion remains is centered in the Connecticut sub-areas, rather than affecting many areas across the region.¹⁴⁷

4.5.4. Conclusion for New England

Over the past three years, transmission congestion within New England has fallen significantly. This is due to years of sustained effort and achievement on several fronts—new utility-scale and distributed, small-scale supply resources have come on line, primarily in the locations where they are most needed

Figure 4-16. Map of New and Recent Transmission Projects in New England

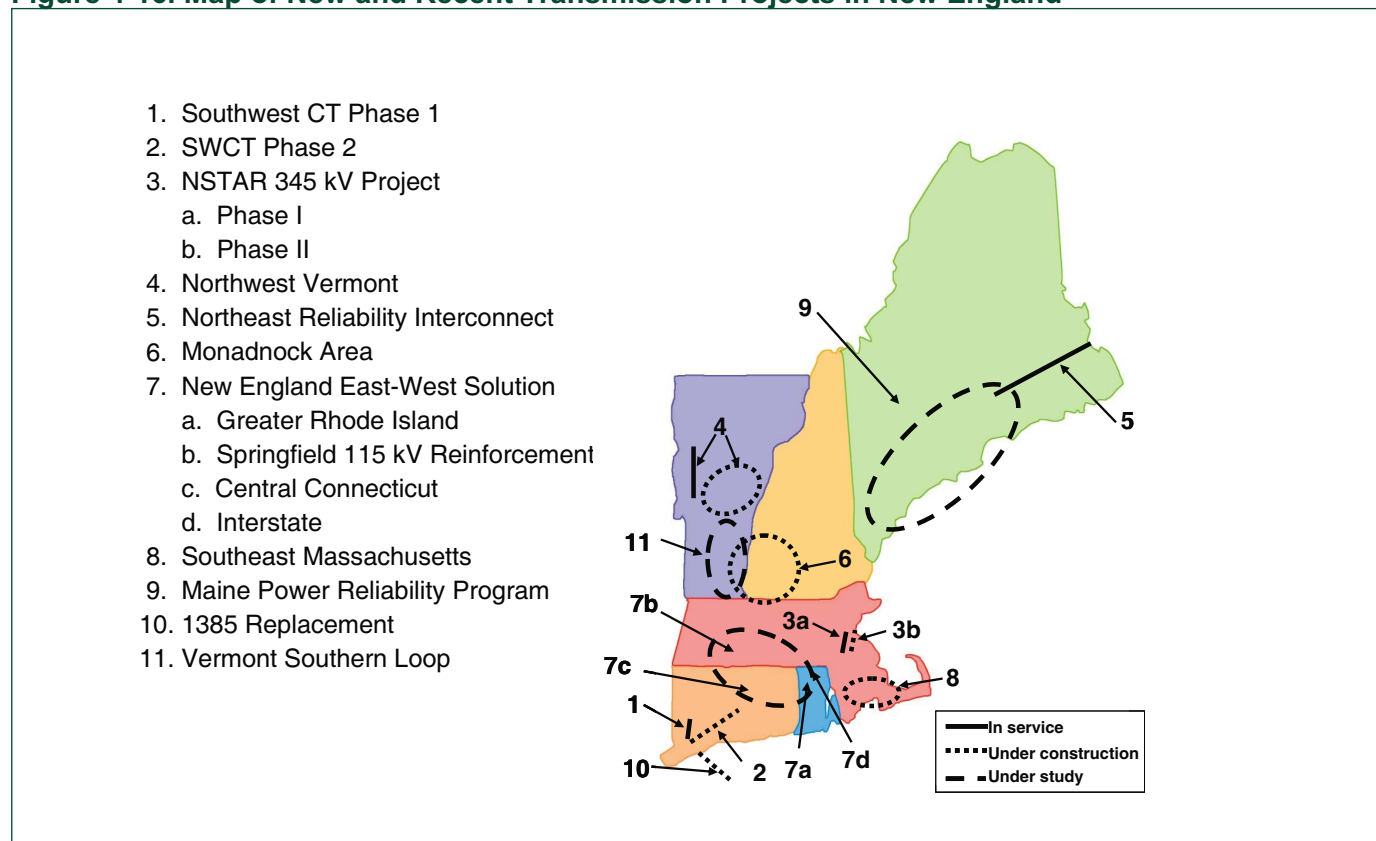

Note: This map was developed in 2008. Many of the projects shown as under construction are now in service, and some of those shown as under study have now been approved.

Source: ISO New England (ISO-NE) (2008d). *2008 Regional System Plan*, at http://www.iso-ne.com/trans/rsp/2008/rsp08_final_101608_public_version.pdf, p. 147.

¹⁴⁴ISO-NE (2009a), *2008 Fourth Quarter Markets Report*, p. 20.


¹⁴⁵*Ibid.*, p. 22.

¹⁴⁶Ehrlich, D. (2009). “RSP09, 2008 Historical Market Data: Locational Margin Prices – Interfaces, MW Flows.” Draft, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/pac/mtrls/2009/jan212009/a_lmp_interface.pdf, slides 4-9.

¹⁴⁷*Ibid.*, slide 63.


and valuable; aggressive demand response programs have made load reduction into a geographically targeted resource that can be used to reduce peak loads and mitigate the effects of temporal transmission constraints; and energy efficiency is

Figure 4-17. Average Real-time Prices in New England

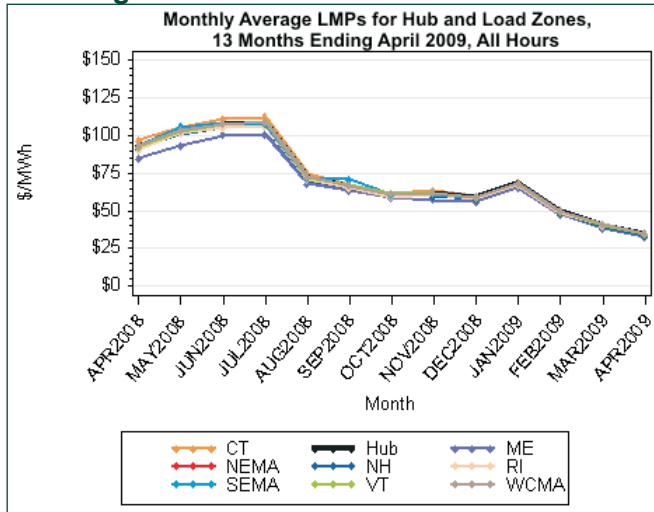

Source: ISO-NE (2009d). "Monthly Market Operations Report, April 2009." Market Analysis and Settlements, at http://www.iso-ne.com/markets/mkt_anlys_rpts/mnly_mktops_rtps/2009/2009_04_monthly_market_report.pdf, p. 8.

Figure 4-18. Average Nodal Locational Market Prices in New England, Fourth Quarter, 2008

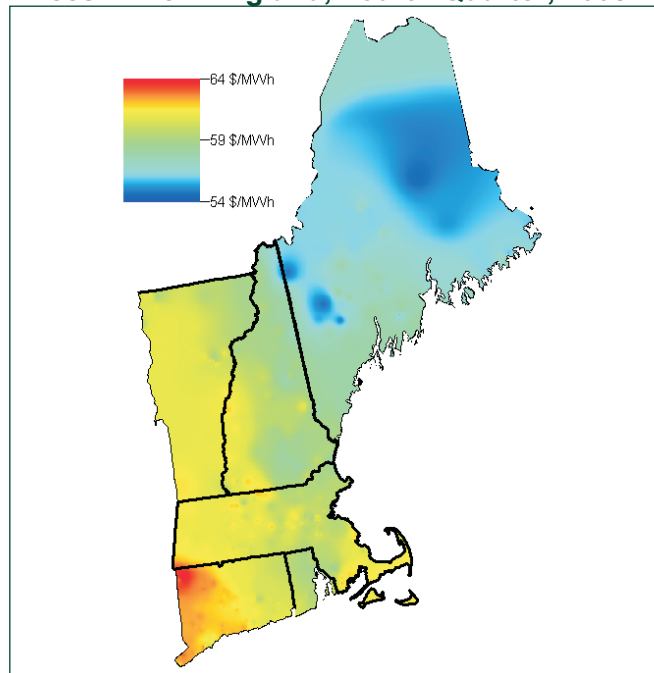


Source: ISO-NE (2009d). "Monthly Market Operations Report, April 2009," Figure 17, p. 20.

reducing total loads. Further, the area has a strong queue of new generation projects, as well as a diverse set of new reliability- and economics-oriented transmission projects completed or sitting in its interconnection and transmission system study queues. This combination of developments has, over several years, eased the significant reliability and economic differentials affecting the Boston metropolitan area and Southwest Connecticut that factored in the Department's identification of New England as a Congestion Area of Concern in 2006. These results reflect the steady efforts of the utilities, ISO, independent generators, regulators, legislators, energy service companies, and customers who have worked together to develop and implement a comprehensive and consistent set of policy, pricing and planning tools.

Nevertheless, New England's most recent system plan indicates that the region could experience a negative operating reserve margin of as much as 750 MW as early as 2009 under an extreme (high load, 10% probability) load forecast or 2010 under a base (50%-50% probability) load forecast.¹⁴⁸ If this occurs, the region would need to use various load relief measures, including calling all demand response measures, calling for customer conservation, and possibly rotating load cuts.

Figure 4-19. Average Locational Marginal Prices Across New England Zones, Calculated as Differences from the Hub, for 2004-2008

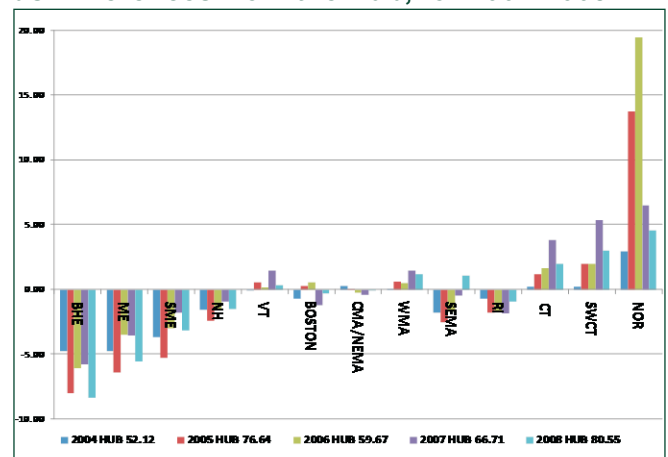

Source: Ehrlich, D. (2009). "RSP09, 2008 Historical Market Data: Locational Margin Prices—Interfaces, MW Flows," Draft, at http://www.iso-ne.com/committees/comm_wkgtps/prtcpnts_comm/pac/mtrls/2009/jan212009/a_imp_interface.pdf, slide 8.

¹⁴⁸ ISO-NE (2008d). *2008 Regional System Plan*, pp. 35-36.

Does the threat of a reliability problem indicate transmission congestion? On the one hand, the potential inability to meet loads indicates that the lack of more transmission is limiting imports that might solve the problem; on the other hand, the reliability problem could also be solved by acquiring more generation or demand-side resources. It appears that New England is taking a broad, balanced approach to this reliability challenge by making a reasoned assessment of the risks and costs of new generation and transmission construction relative to load-shedding, and has concluded that concerns about the costs and feasibility of new generation and transmission over the short-term outweigh their benefits. Many of the individuals offering their views to the Department recommended this type of economic evaluation, in preference to an automatic assumption that congestion should be eliminated exclusively or primarily through construction of new transmission.

The Department finds that while some transmission congestion remains in New England, most of the significant transmission constraints have been eliminated by the region's multi-faceted approach. The region has shown that it can permit, site, finance, cost-allocate and build new generation and transmission, while encouraging new demand-side resources as well. New England faces some near-term reliability challenges, but is working aggressively to address them. For these reasons, the Department no longer identifies New England as a Congestion Area of Concern.

4.6. Congestion in the Midwest

4.6.1. Midwest ISO

The OATI analysis of congestion in 2007 found that the most congested high-voltage constraints affecting MISO were Black Oak-Bedington in Virginia

(located in PJM, not MISO), Tekamah to Raun in Iowa, and Eau Claire-Arpin and Ellington-Hintz to N. Appleton 345 kV, both in Wisconsin. These interfaces were among the most congested measured in terms of either the number of hours congested, the frequency of high real-time shadow prices, or the sum of shadow prices. Much Midwest congestion was one-way, in that it consistently reflected the direction of flows and the existence of persistent transmission-limiting load or generation pockets.

MISO staff recommend caution in interpreting OATI's 2007 results, for reasons that include the potential for variation between AFC (forecast) and TLR (real-time) results, the fact that generation and transmission outages affect congestion, and that schedules (tags) better reflect actual transmission usage than planned usage.¹⁴⁹ Several of the most notable constraints affecting MISO in 2007 (including those outside MISO, such as Black Oak-Bedington, that affect it nonetheless) will be mitigated by now-completed or planned transmission upgrades (such as those at Eau Clair-Arpin and in central Indiana).

MISO's 2008 Transmission Expansion Plan found that congestion charges within the region are relatively low. Examination of the 29 most congested flowgates (in terms of number of binding hours) within the MISO footprint against MISO's expansion plans revealed that approved expansion projects to relieve reliability problems will resolve congestion at 20 of these flowgates.¹⁵⁰ These improvements will mitigate the Midwest's most persistent and well-known congestion area, spanning the Wisconsin Upper Michigan System (WUMS) and northern WUMS. Congestion in an area at the intersection of southeast Minnesota, northern Iowa and southwestern Wisconsin is also expected to be alleviated by planned and approved transmission expansion.

¹⁴⁹Walsh, M. (2009). "Historic Congestion in the Eastern Interconnection, MISO Overview and Comments." Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://www.congestion09.anl.gov/techws/index.cfm>, slides 8-11.

¹⁵⁰Midwest ISO (2009c). *MTEP 08: The Midwest ISO Transmission Expansion Plan*, at http://www.midwestiso.org/publish/Document/279a04_11db4d152b9_-7d8d0a48324a/2008-11_MTEP08_Report.pdf?action=download&_property=Attachment, p. 10. MISO observes that "The fact that most of the heaviest constrained flowgates are eventually being addressed by reliability based upgrades points to the linked nature of reliability and congestion or economic issues: it's often a matter of timing. For example, a transmission solution which is driven solely by perceived economic benefits in the short term may be required to address reliability concerns over time" (p. 11).

Several large transmission projects, comprising a group called the Capacity Expansion (CapX) 2020 Project, are being planned to enable development of wind resources in North Dakota, South Dakota, Minnesota and Iowa. The first phase of this project—consisting of three 345 kV lines—has been approved as a reliability project for cost allocation under MISO’s 2008 Transmission Expansion Plan and granted Certificates of Need by the Minnesota Public Utilities Commission.¹⁵¹ Other large projects have been proposed to serve renewables, including the Green Power Express, a merchant transmission proposal to move 12,000 MW of power from the Dakotas, Minnesota and Iowa to load centers including Chicago, southeastern Wisconsin and Minneapolis.¹⁵² Further, the Midwest ISO is working with the other eastern system planning organizations to study alternative renewable energy development scenarios and associated transmission plans.

4.6.2. Southwest Power Pool

As noted previously in this chapter, SPP uses TLRs as a grid management tool. SPP’s planning director commented that “the increases in TLRs in SPP represent a more effective use of the transmission system to provide lower-cost wholesale energy to buyers. It doesn’t necessarily mean that we’re in trouble or that the system is more congested. We’re just pushing the system harder.”¹⁵³

In the Southwest Power Pool, congestion impacts do not occur over large areas (as in the Mid-Atlantic region); they are more localized—“what we have is the economic opportunities that are not being maximized or realized because we don’t have the transmission to move generation [from] fossil, nuclear or

renewable from our state into the region, much less to load centers” in other parts of the country.¹⁵⁴

Within SPP, the areas of greatest economic congestion are known and SPP’s system planners look at both reliability and economic congestion in devising appropriate solutions. In 2008, SPP experienced congestion particularly in northeastern Kansas and southeastern Nebraska on several constraining flowgates; in northwestern Louisiana, at the Southwest Shreveport transformer. SPP’s market monitor reports that in 2008, 75% of SPP’s congestion occurred on just 10 flowgates (out of more than 200 flowgates in SPP).¹⁵⁵

SPP planners note that “as wind farms in the Panhandle of Texas, Oklahoma, and western Kansas continue to develop, the congestion in that region will increase”¹⁵⁶; the area already had moderate congestion in 2008. These and other points of congestion are identified in monthly market monitoring reports and in SPP’s annual Transmission Expansion Plan, where they are evaluated as either reliability or economic expansion projects. Many of SPP’s most congested flowgates (whether identified in terms of the number of five-minute periods when the flowgate operating limit is breached, or in terms of shadow price impact) are being addressed by scheduled transmission network upgrades, including a series of high-voltage lines intended to move wind generation out of western Kansas and Oklahoma.¹⁵⁷

The Missouri Public Utility Commission observes that average monthly prices of electricity in SPP and MISO track closely, with a maximum difference of only \$3/MWh between the markets in 2007. This suggests that there is little congestion

¹⁵¹ Midwest ISO (2009c). *MTEP 08: The Midwest ISO Transmission Expansion Plan*, and CapX (2009). “CapX2020 Granted Certificate of Need for 345-kilovolt Projects in Minnesota,” at http://www.capx2020.com/Regulatory/State/Minnesota/pdf/PUC_Decision_on_345_CON_press_release_4-16-2009_final.pdf.

¹⁵² ITC (2009). “ITC Holdings Corp. Unveils Green Power Express.” ITC Press release, at <http://investor.itc-holdings.com/releasedetail.cfm?ReleaseID=364150>.

¹⁵³ Caspary, J. (SPP) (2008). “Comments of Jay Caspary.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Oklahoma City, Oklahoma. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 20.

¹⁵⁴ Sloan, T. (Kansas) (2008). “Comments of Representative Tom Sloan.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Oklahoma City, Oklahoma. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, pp. 9-10.

¹⁵⁵ Roach, C.R., S. Rein, and K. Gottshall (2009). *2008 State of the Market Report: Southwest Power Pool, Inc.*, at <http://www.spp.org/publications/SPP%202008%20State%20of%20the%20Market%20Report.pdf>, p. 10.

¹⁵⁶ SPP (2009). *2008 SPP Transmission Expansion Plan*. Approved April 29, 2009, at http://www.spp.org/publications/2008_Aproved_STEP_Report_Redacted.pdf, p. 35.

¹⁵⁷ *Ibid.*, pp. 5-6.

hampering flow between the two markets¹⁵⁸ (although it might also reflect similar generation mixes).

Much of SPP lies within the Midwestern portion of the large 2009 Conditional Constraint Area for renewable resources (see Chapter 3), where substantial new transmission development will be required to enable development of large potential wind energy resources. SPP is active in inter-regional planning efforts, where it works with other planning organizations to study potential high voltage and extra-high voltage overlay options to export wind to other U.S. markets. If renewable energy development were to become a high priority for the nation, a North Dakota Public Utility Commissioner recommended that the wind-rich, transmission-sparse region of the Dakotas and Minnesota should be declared a National Interest Electric Transmission Corridor to ensure expedited transmission siting and development.¹⁵⁹

Although congestion within SPP can be problematic, at present it does not rise to a level that would merit formal Departmental action.

4.7. Congestion in the Southeast

4.7.1. SERC

The SERC region covers all or portions of 16 states in the southeast and south central portion of the U.S., from Arkansas east to Virginia, south to Georgia and west to Louisiana, and serving over 70 million people.

The SERC region has a large reserve margin of generation in excess of load—both historically and into the future—plus additional merchant generation capacity that is not counted in the reserve margin because those plants do not have firm transmission capacity contracts. Most of the states require their utilities to conduct integrated resource planning studies on a 2- or 3-year planning cycle, with the clear expectation that the utilities will continue to be proactive in forecasting loads and building ahead to avoid congestion and assure resource and facility redundancy in the face of natural disasters.¹⁶⁰ The SERC states and utilities coordinate and share their system expansion studies.¹⁶¹

The SERC region has a unique philosophy with respect to electric system planning and construction:

The transmission system within SERC has been planned, designed and is operated such that the utilities' generating resources with firm contracts to serve load are not constrained. Network customers may elect to receive energy from external resources by utilizing available transmission capacity. To the extent that firm capacity is obtained, the system is planned and operated in accordance with NERC Reliability Standards to meet project customer demands and provide contracted transmission services.¹⁶²

This approach works well for the electric utilities within SERC (all of which are traditionally vertically integrated and regulated, with no central organized bulk electricity wholesale market). The region has a number of proposed major new nuclear

¹⁵⁸Missouri Public Service Commission (2008). "Comments of the Missouri Public Service Commission." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Oklahoma City, Oklahoma. See Materials Submitted at the Meeting at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 9, citing analysis by Potomac Economics (SPP's Market Monitor).

¹⁵⁹Wefald, S. (North Dakota Public Utilities Commission) (2008). "Comments of North Dakota Public Utilities Commissioner." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Oklahoma City, Oklahoma. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p.9, and "Comments from the Organization of MISO States to DOE regarding draft National Interest Electric Transmission Corridor designations," July 6, 2007.

¹⁶⁰Sullivan, J. (Alabama Public Utility Commission) (2008). "Comments of Commissioner Jim Sullivan." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 18, and Wise, S. (Georgia Public Service Commission) (2008). "Comments of Commissioner Stan Wise." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 3.

¹⁶¹Bartlett, G. (Entergy Services) (2008). "Comments of George Bartlett." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 21.

¹⁶²NERC (2009a). *2009 Summer Reliability Assessment*, at <http://www.nerc.com/files/summer2009.pdf>, p. 131.

and coal generators under utility ownership, and has already completed most of the planning necessary to ensure that sufficient transmission will be available when those plants come on-line.¹⁶³ Independent power producers that want to sign a long-term firm transmission contract are reportedly able to get service,¹⁶⁴ although those that want non-firm service may not be able find adequate ATC to accommodate their requests.

The concept of building to serve firm transmission requirements may make it difficult for the region to develop profitable variable-output renewable resources, since such plants generally use only non-firm transmission service. As of mid-2009, only two of the states in SERC (North Carolina and Virginia) have a renewable portfolio standard that will require significant renewable generation development. However, the Southeast does not appear to have strong on-shore wind development potential.

SERC reports that “there are no transmission constraints that could significantly impact reliability of the utilities in the SERC region”¹⁶⁵ in the summer of 2009, and that there are no limits to transfers between areas with the sole exception of the interface between the Delta subregion and SPP.¹⁶⁶ The utilities within SERC do not depend on purchases or imports into SERC to meet loads.¹⁶⁷ Because the southeastern utilities build aggressively in advance of load, there is little economic or reliability congestion within the region. The Department’s 2006 study identified two historical constraints in the Southern Company’s footprint, affecting flows from the north into Atlanta and from TVA into Southern; Southern reports that new transmission lines have been placed into service to address each

constraint, and is repowering a coal plant in the Atlanta area as well.¹⁶⁸

The TVA region sits at the center of the Eastern Interconnection, at the northwest edge of the SERC region. TVA says it is “less concerned with congestion . . . than with having enough transmission that we get economic dispatch of our designated native-network resources to our native loads.”¹⁶⁹ The utility recognizes that congestion costs its customers money, but its managers build the system “to get the best dispatch of the resources for the load internally and then we’re accommodating the market to the degree that we can or to the degree that the market is willing to invest.”¹⁷⁰ TVA intends to use its regional planning process to clear up congestion that is an economic concern to the market. Over the near term, TVA sets its path ratings aggressively to avoid calling TLRs, and seeks to create enough real-time transmission capacity to allow post-contingency redispatch of resources.¹⁷¹

TVA plans to build several new nuclear generating facilities over the coming decade. All of these new units would be located at existing nuclear sites, so TVA anticipates being able to put the transmission in place needed to avoid any congestion that would limit the nuclear plants’ ability to deliver to loads.¹⁷²

4.7.2. Entergy

Through subsidiaries, Entergy serves customers in Louisiana, Texas, Arkansas and Mississippi. The Entergy region contains a number of significant transmission constraints that limit electricity flows, as evidenced by the high number of TLRs mentioned in Section 4.3.2 above. By design, these

¹⁶³ Wise, S. (Georgia Public Service Commission) (2008). “Comments of Commissioner Stan Wise,” p 4, and Terreni, C. (Public Service Commission of South Carolina) (2008). “Comments of Charles Terreni.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 6.

¹⁶⁴ Sullivan, J. (Alabama Public Utility Commission) (2008). “Comments of Commissioner Jim Sullivan,” p. 12.

¹⁶⁵ NERC (2009a). *2009 Summer Reliability Assessment*, p. 128.

¹⁶⁶ *Ibid.*

¹⁶⁷ *Ibid.*, p. 127.

¹⁶⁸ Carlsen, R. (Southern Company) (2008). “Comments of Ron Carlsen.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm> p. 29.

¹⁶⁹ Till, D. (Tennessee Valley Authority) (2008). “Comments of David Till.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 17.

¹⁷⁰ *Ibid.*

¹⁷¹ *Ibid.*, pp. 18-19.

¹⁷² *Ibid.*, pp. 10-11.

TLRs interrupt non-firm transactions (primarily from independent power producers and merchant generators) and firm transmission (often from merchant generators).¹⁷³

The number of TLRs in Louisiana has increased since 2006. Although the Department's 2006 study speculated that historic congestion levels in the state would go down because of lower load following Hurricane Katrina in 2005, in fact the opposite has occurred.¹⁷⁴ Where there are high levels of congestion and transmission bottlenecks, transmission-dependent utilities and merchant generators have been asked to fund costly transmission upgrades to secure firm (un-curtailed) transmission service—for instance, the Lafayette Utility System reports that to secure five-year firm transmission service for 25 MW, the utility would have to pay between \$85 million and \$284 million to grant the 25 MW request,¹⁷⁵ NRG Power Marketing was told that its request for 100 MW of yearly network service within the Louisiana Generating, LLC (LAGN) control area would cost between \$70 million and \$105 million, and Westar Energy Generation & Marketing's request for 15 MW of firm service from Entergy into Ameren for one year would require upgrades costing between \$44 and \$50 million.¹⁷⁶ Entergy's Transmission Coordinator recognizes that the system needs to be expanded but points out that Entergy does not yet have an effective cost allocation method to finance upgrades to resolve economic congestion rather than reliability needs.

Entergy responds that these are economic issues that its independent transmission coordinator must deal with, driven by:

... about 15,000 MW of independent power producer facilities on the system with cheaper energy than some of the designated network resources, and the fact that entities are all trying to avail themselves of that energy, it creates flows on the system for which it wasn't originally designed. And we have no control over that TLRs are an indication in real time of what happens when the operators are trying to deal with these . . . problems¹⁷⁷

One reason the number of TLRs has increased in the Entergy region is that in the past, Entergy would voluntarily redispatch its units to manage around a congestion problem, but now uses TLRs instead.¹⁷⁸

Several load pockets exist on the Entergy system—in Acadiana, Amite South, and WOTAB (West of the Atchafalaya Basin), and the McAdams flowgate (the interface between Entergy and TVA) have traditionally been among Entergy's most congested facilities. Entergy Louisiana and Entergy Gulf States Louisiana recently completed three transmission projects in south Louisiana; two of the lines, the Amite II and III 230 kV expansion and upgrade projects, increase import capacity into the Amite South area by 350 MW.¹⁷⁹ This may reduce the number of TLRs in the Entergy region in years ahead. There is also limited transfer capability in the Ozarks between Entergy and SPP.¹⁸⁰ SPP, Entergy's independent transmission coordinator, is studying the need for transmission upgrades across the Entergy system, as illustrated in Figure 4-20.

Although the amount of congestion on the Entergy system appears high, it is hard to determine the cost

¹⁷³Vosburg, J. (NRG Energy) (2008). "Comments of Jennifer Vosburg." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, pp. 30-31.

¹⁷⁴Huval, T. (Lafayette Utility System) (2008). "Comments of Terry Huval" Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm> pp. 26-27; and SPP (2008c). "Independent Coordinator of Transmission (ICT) for Entergy – Annual Performance Report, November 17, 2007 to November 17, 2008," submitted to FERC on February 11, 2009, p. 14.

¹⁷⁵*Ibid.*, p. 27.

¹⁷⁶*Ibid.*, p. 14.

¹⁷⁷Bartlett, G. (Entergy Services) (2008). "Comments of George Bartlett." Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 34.

¹⁷⁸Vosburg, J. (NRG Energy) (2008). "Comments of Jennifer Vosburg," p. 35.

¹⁷⁹Entergy Louisiana, LLC (2009). "Entergy's Louisiana Utilities Announce Completion of Three Transmission Projects," Entergy Louisiana, LLC and Entergy Gulf States Louisiana, LLC Press release, at http://www.entergy.com/news_room/newsrelease.aspx?NR_ID=1494.

¹⁸⁰Southwest Power Pool, Inc. (SPP) (2007c). *ICT Strategic Transmission Expansion Plan (ISTEP) Report*, at http://oasis.e-terrasolutions.com/documents/EES/Strategic%20Plan%20Report%20Phase%201_Dec_07.pdf.

of that congestion because there are no clear economic or market-based congestion metrics in the region. The Department will continue to monitor developments in the area.

4.7.3. Florida

Sitting at the corner of the Eastern Interconnection, Florida has only limited interconnections through interfaces with Georgia. The state’s electric utilities coordinate their planning through the FRCC and the Florida Public Utility Commission, which runs a ten-year planning process that addresses generation and transmission needs against load forecasts and aggressive energy efficiency programs.

Most of Florida’s power needs are met from in-state generation; summer generation capacity is predicted at 52,162 MW to serve internal demand of 45,531 MW (net of energy efficiency and demand response).¹⁸¹ NERC reports that the FRCC has 2,377 MW of generation under firm contract for import into FRCC from the southeastern sub-region of NERC, with firm transmission service for deliverability.¹⁸² Joint studies of the Florida-Southeastern interface show that there is a summer import capability of 3,600 MW flowing southbound and an export capability northbound of 1,000 MW.¹⁸³ The 2006 study’s simulation analysis identified congestion that limited imports at the Georgia to Florida interface; as the discussion of 2007 transmission congestion indicates, there are little publicly available data to illuminate current conditions other than the fact that the available capacity is fully subscribed.


FRCC has identified transmission constraints in Central Florida that could require remedial actions in summer 2009 if west-to-east flow levels increase across the Central Florida metro load areas. Although transmission rebuild and expansion efforts are reported underway to alleviate this congestion, in the near term remedial operating strategies will be used as needed to mitigate thermal loadings and

protect reliability.¹⁸⁴ FRCC explains that transmission constraints may be triggered in Northwest Florida under conditions of high imports into Florida from SERC; when necessary these too are mitigated by a special operating procedure.¹⁸⁵ FRCC does not identify other transmission constraints.

Florida does not participate in any organized power market, so there is no public pricing record to determine whether economic congestion occurs within the state or the magnitude of its impact.

Florida utilities are planning the possible construction of four new nuclear plants with a cumulative capacity of 4,400 MW. As in the SERC region, these plants are far enough out on the planning horizon that the utilities and the Florida Commission can plan and execute the needed transmission expansion and facilities upgrades to effectively integrate all of the new nuclear capacity as it becomes

Figure 4-20. Entergy Region Transmission Upgrades Under Study, 2009

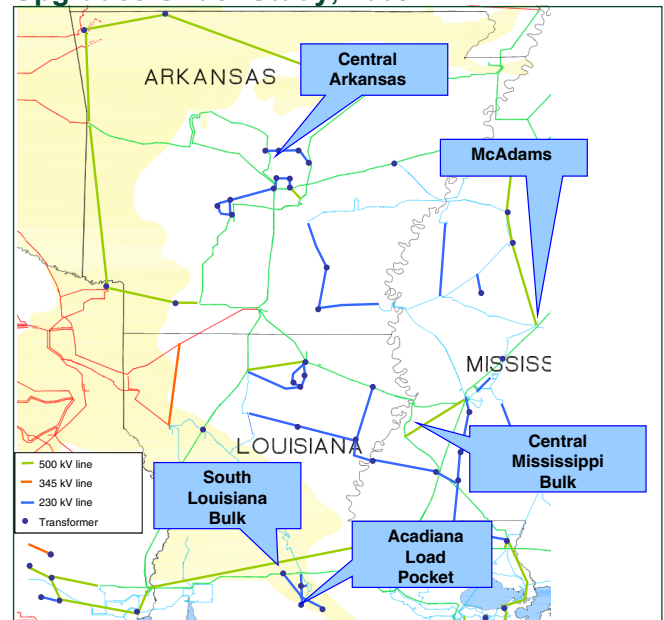

Source: Southwest Power Pool, Inc. (SPP) (2008b). *ICT Strategic Transmission Expansion Plan (ISTEP) Phase II Report, Rev. 1*, at http://www.spp.org/publications/ISTEP_Phase_2_report.pdf, p. 4.

¹⁸¹ NERC (2009a). *2009 Summer Reliability Assessment*, pp. 38-39.

¹⁸² *Ibid.*, p. 40.

¹⁸³ *Ibid.*, p. 44.

¹⁸⁴ *Ibid.*, p. 41.

¹⁸⁵ *Ibid.*

available.¹⁸⁶ FRCC conducts regional studies to ensure “that all dedicated firm resources are deliverable to loads under forecast conditions.”¹⁸⁷

4.8. Nuclear Power Development and the Need for New Transmission

The desire for generation sources that do not emit greenhouse gases has given new vigor to advocates of nuclear power, with aggressive nuclear construction programs now underway in China, Russia, India and South Korea. The EPAct included significant incentives for new nuclear plant design, licensing, financing and construction. These have sparked a potential nuclear boom in the United States, beginning with the resumption of construction at the TVA’s Watts Bar nuclear plant in 2007. By the end of 2008, 17 license applications had been submitted to the Nuclear Regulatory Commission for 26 new nuclear reactors, and more plants are reportedly under consideration.¹⁸⁸ However, recent news reports suggest that some of the proposed reactors may be delayed or cancelled because the sponsoring utilities do not have confidence that they can afford the high costs and risks involved in nuclear plant construction.¹⁸⁹

Figure 4-21 shows the locations of proposed nuclear plants. As the map shows, most of these plants are proposed in the southeastern states, in an arc from eastern Texas through most of the Southeast up through Maryland. Although the Department identified a Conditional Congestion Area in the Southeast in the 2006 Congestion Study, it does not extend that identification here.

After further consideration, the Department believes that Conditional Constraint Area¹⁹⁰ identification should be applied only to areas that meet three conditions:

- 1) Important potential generation resources in the area are locationally restricted (i.e., the generation source cannot be moved to another location);
- 2) The potential resources are located relatively close together in such a way that a large new transmission project could serve thousands of MW of potential generation; and
- 3) The resources are unlikely to be developed on a large scale and in a coherent fashion unless new transmission is designed and built to serve a broad area.

Nuclear power development in the Southeast does not meet these conditions. Nuclear power is not locationally restricted; it is not limited by the vagaries of where nature put resources, but chiefly by the siting choices of the potential developers and communities. As Figure 4-21 shows, these proposed plant sites are widely dispersed, and their capacity would be added to the grid in increments of 1,000 to 2,000 MW per site; thus, building one or two new large transmission projects will not help bring many thousands of new nuclear capacity on-line. Last, the Department understands that the pending nuclear projects have been proposed by sponsors that plan to secure the needed transmission to interconnect the generator to the grid, so reactor development will not be contingent primarily upon transmission availability. For these reasons, the Department is not identifying any area as a Conditional Constraint Area specific to nuclear power development.

¹⁸⁶ Miller, C. and S. Garl (Florida Public Service Commission) (2008). “Comments of Cindy Miller and Steve Garl.” Provided at the U.S. Department of Energy Workshop on 2009 Congestion Study. Atlanta, Georgia. See Workshop Transcript at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, pp. 9-10.

¹⁸⁷ NERC (2009a). *2009 Summer Reliability Assessment*, pp. 42-43.

¹⁸⁸ Nuclear Energy Institute (2008). “Fact Sheet – New Nuclear Plants Create Opportunities for Expanding U.S. Manufacturing,” at <http://www.nei.org/keyissues/newnuclearplants/factsheets/>.

¹⁸⁹ Williams, M. (AP) (2009). “Nuclear plants face major funding crisis.” *Seattle Daily Journal of Commerce*, at <http://www.nwbuildingpermits.com/news/co/12005472.html?cgi=yes>.

¹⁹⁰ In the present report, the Department has replaced the term “Conditional Congestion Area” with “Conditional Constraint Area.” See Chapter 3 for a discussion of the reasons for the change.

4.9. Coal Development and the Need for New Transmission


The 2006 *National Electric Transmission Congestion Study* identified two Conditional Congestion Areas in the Eastern Interconnection for potential coal development, one in Illinois and one in West Virginia and Pennsylvania. In the present study, the Department does not extend that identification for four reasons:

- Although there are significant coal reserves available in each area, it appears that a lack of transmission is not the principal impediment to new coal development in these areas. Rather, a review of PJM’s transmission interconnection queue (and others) indicates that there are few coal plants in the queue; this suggests that the lack of new coal construction is driven by financial and political uncertainty surrounding future

carbon regulation and strong legislative and regulatory preferences for renewable and low-carbon generation sources.

- Unlike the renewable resource areas identified in Chapter 3, these coal reserves are not under-served by existing transmission, nor are they new frontiers for the transmission grid. Although it is possible to develop a significant amount of additional coal-fired generation in each area, each area is already well-served by transmission infrastructure. Establishing transmission access for new coal generation capacity would not require extensive new transmission development (beyond that already in development or under study in the PJM transmission planning process).
- Like nuclear plants, coal-fired power plants are not locationally restricted. Although it has often been advantageous to develop coal-fired plants at the mine-mouth, there are many examples of coal shipments to plants developed at distant sites

Figure 4-21. Proposed New Nuclear Power Plants

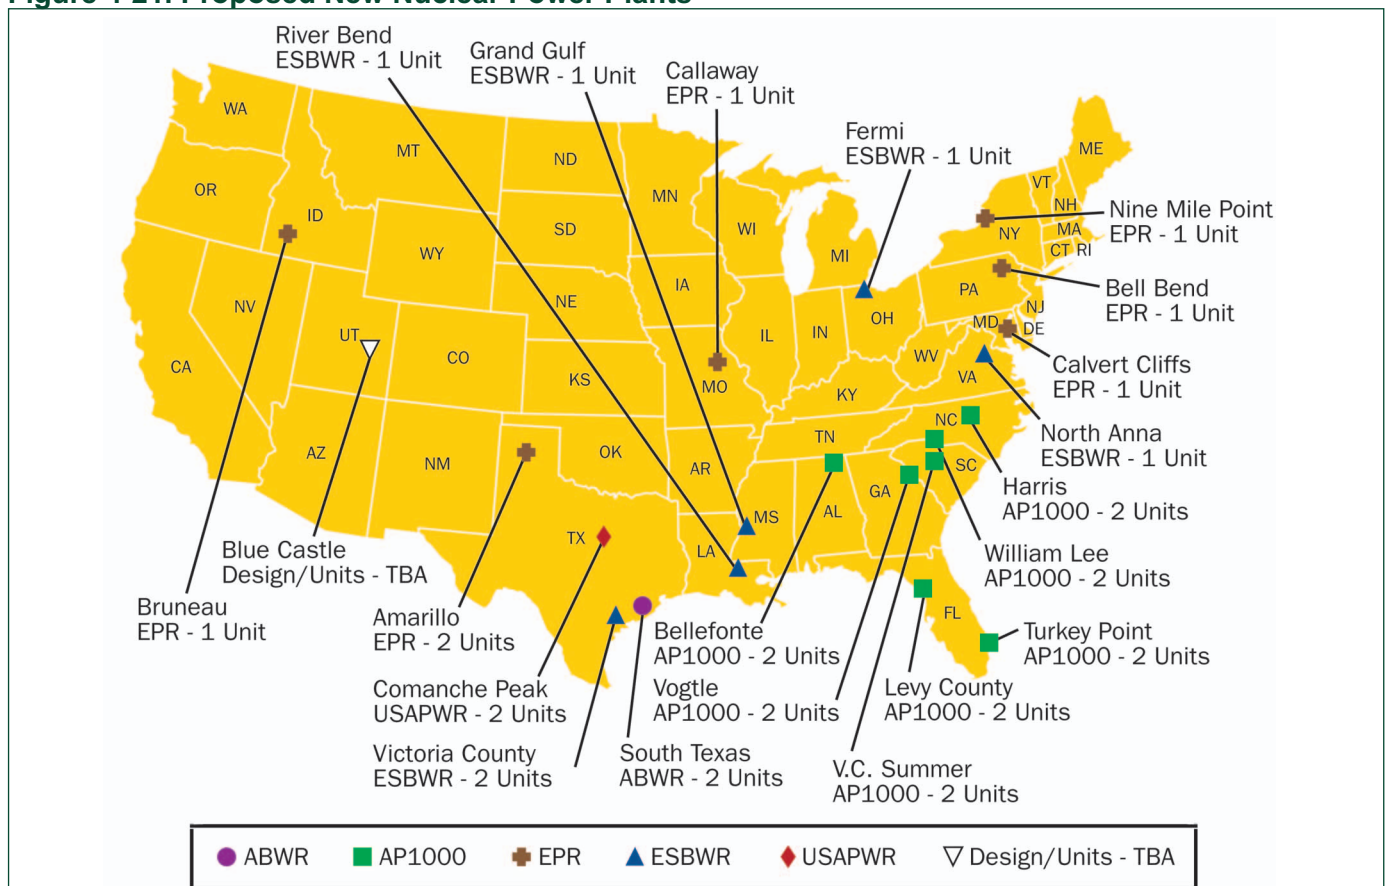

Source: Nuclear Regulatory Commission (2008). "Location of Proposed New Nuclear Power Reactors," at <http://www.nrc.gov/reactors/new-reactors/col/new-reactor-map.html>.

with better transmission or other locational advantages (such as economic incentives).

- Further, domestic coal development is not dependent upon power grid access alone—coal can be converted to a product similar to natural gas rather than to electricity,¹⁹¹ and much coal is delivered directly to industrial consumers to serve fuel boilers without passing through an electric power plant.


For these reasons, the Department finds that the Illinois and Northern Appalachian coal fields should not be identified as Conditional Constraint Areas.

4.10. Congestion Areas in the Eastern Interconnection

The Department concludes that there is only one nationally significant congestion area in the Eastern Interconnection based on the evidence reviewed above. As shown in Figure 4-22, that is the Mid-Atlantic Critical Congestion Area, which continues to experience high and costly levels of congestion that affect a significant portion of the nation’s population, reaching from south of Washington DC to north of New York City. While transmission constraints and congestion exist elsewhere in the interconnection, they occur over smaller geographic areas affecting fewer customers with lower costs. Although it may be challenging to build new transmission in many parts of the country, in parts of the Midwest and Southeast new transmission is being built to anticipate or mitigate transmission congestion before it imposes broad economic or reliability

costs. As discussed above and in Chapter 3, the Department has not identified distinct, resource-specific Conditional Constraint Areas in the eastern United States.

Figure 4-22. Congestion Area in the Eastern Interconnection, 2009

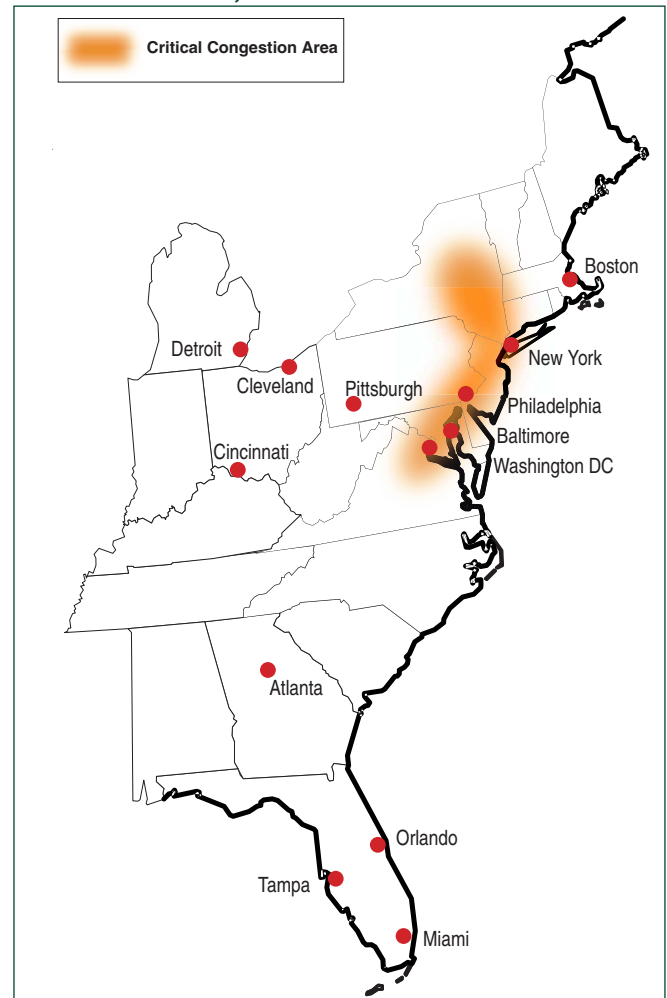

¹⁹¹For example, see, Peabody Energy (2008). “ConocoPhillips and Peabody Energy Select Site in Muhlenberg County, KY, to Develop Coal-to-Gas Facility.” Peabody Energy News release, at <http://phx.corporate-ir.net/phoenix.zhtml?c=129849&p=irol-newsArticle&ID=1236657&highlight=#splash>.


5. Transmission Congestion in the Western Interconnection

5.1. Introduction

This Chapter begins by reviewing the congestion areas in the Western Interconnection that the Department identified in the 2006 *National Electric Transmission Congestion Study*. Then it presents TEPPC’s broad conclusions about congestion in 2007 across the Western Interconnection, and TEPPC’s analyses of projected congestion in the West. Building on these observations, this report then examines each of the 2006 Congestion Areas of Concern and the Critical Congestion Area to

ascertain the degree to which conditions in these areas have changed, informed by both the historical congestion information and current and projected conditions documented in various studies. The review of each area concludes with the Department’s determination of whether the area continues to be so congested that it merits continued identification as a congestion area. The chapter also addresses major constraints in the Interconnection that lie outside the previously identified congestion areas, and whether any of the areas affected by these constraints should be identified as new congestion areas.

Figure 5-1. Western Congestion Areas Identified in the 2006 National Electric Transmission Congestion Study

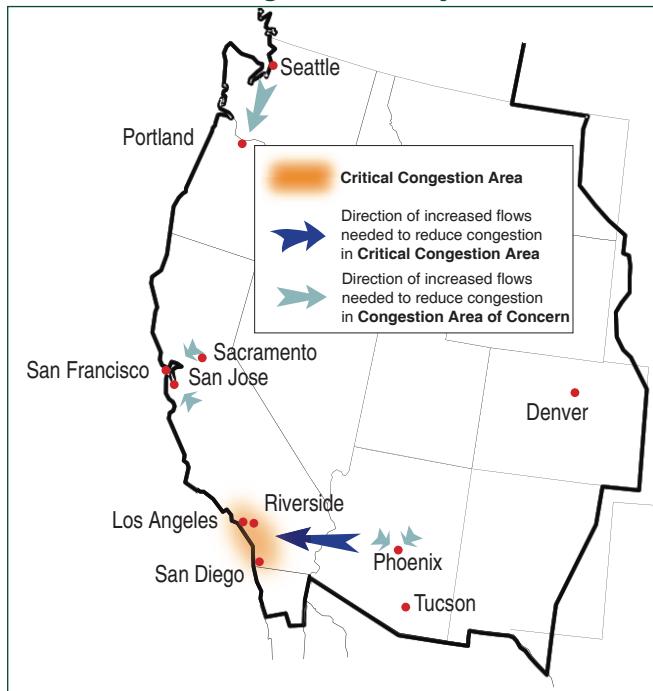

Source: U.S. Department of Energy (DOE) (2006a). *National Electric Transmission Congestion Study*, at http://www.oe.energy.gov/DocumentsandMedia/Congestion_Study_2006-9MB.pdf, p. ix.

The 2006 *National Electric Transmission Congestion Study* identified four congestion areas in the Western Interconnection: the Southern California Critical Congestion Area, the Seattle-Portland Congestion Area of Concern, the San Francisco Bay Congestion Area of Concern, and the Phoenix-Tucson Congestion Area of Concern. These areas are shown in Figure 5-1.

5.2. Recent Historical Congestion in the Western Interconnection

The transmission system in the Western Interconnection is based to a large extent on long-distance lines that connect remote generation to load centers.¹⁹² There are 23 major transmission paths in the West, representing the major transmission links between control areas and between the major resource and load areas of the interconnection.¹⁹³ These paths are shown in Figure 5-2 below; path identification convention in the West can include more than one transmission line within a single “path” (as indicated where a solid bar crosses multiple lines), and most paths are identified with a number (shown

¹⁹²In some instances, notably along the West Coast, transmission lines were built to enable seasonal exchanges of power (from north to south in summer and from south to north in winter).

¹⁹³TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council’s Transmission Expansion Planning Policy Committee, Part 3 – Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov/>, p. 3.

in a small square) rather than a location-specific name. The text box, “Key Transmission Paths in the Western Interconnection,” offers further detail on why these paths were identified.

In its analysis of the 2007 transmission usage data, TEPPC sorted the data using several related measures: path loading (usage at 75, 90 and 99% of allowed path loading relative to path limits, also called U75, U90 and U99); over different seasons; direction-neutral maximum flow per path; and load levels. The study team found that different sorting methods produced significantly different results when the paths were ranked to determine which ones were most heavily used. Despite this variation in rankings, TEPPC found some common results in terms of the six most heavily used paths (relative to

their path limits) under different ranking methods, as shown in Table 5-1.

After reviewing the various rankings, TEPPC concluded that the most heavily used paths in the West in 2007 were:

- Bridger West (Path 19)
- Montana to Northwest (Path 8)
- Southwest of Four Corners (Path 22)
- Four Corners 345/500 kV Transformer (Path 23)
- Pacific AC Intertie (California-Oregon Interface, Path 66)
- Pacific DC Intertie (Path 65)
- TOT 2C (Utah-Nevada, Path 35)

Key Transmission Paths in the Western Interconnection

The Western Interconnection has a long history of cooperative transmission analysis and planning, conducted by WECC. To make system planning and analysis more manageable, WECC has aggregated groups of transmission lines and related facilities that together enable the transfer of power between areas into “transmission paths.” Over a period of years, WECC has developed a “path rating catalog” that today identifies 67 distinct paths that represent the most important linkages within the WECC footprint. Each path is identified with a number (e.g., Path 26) and sometimes also with a geographical name (e.g., California-Oregon Intertie or East of River). A path rating indicates the reliability-based electric flow capacity limits of the path in each direction. Much of the analysis that WECC performs is focused on these paths.

Some of the WECC paths are more important than others in terms of managing power flows and maintaining grid reliability. The WECC-TEPPC Historical Analysis Working Group (HAWG) analyzed historical schedule and actual flow information to identify the most important of the paths from the standpoint of congestion analysis. Specifically, HAWG relied on the following criteria in

selecting 23 paths for inclusion in its most recent analysis:

- 1) The path is commercially important, as identified in previous WECC transmission planning work;
- 2) The path links an important wind resource area to load centers;
- 3) The path was identified as problematic in the Regional Transmission Authorities’ 2000 biennial transmission plan;
- 4) The path is frequently subject to unplanned electricity flows (loop flow);
- 5) The path ensures good coverage for all parts of the Western Interconnection; and
- 6) The path had schedule data available in eTags.


HAWG expects, to the extent practicable, to track congestion trends in the future using this set of paths. However, the list of key paths examined may change in the future as the WECC electricity infrastructure and usage change; recent experience has shown that congestion can sometimes occur on portions of the Western grid that are not identified as one of WECC’s key transmission paths.

- West of Borah (Path 17)
- Southern New Mexico (Path 47)
- TOT 2A (Path 31).¹⁹⁴

These paths are shown in Figure 5-3 below. During 2007, most of these paths were sufficiently

congested that schedule curtailments were required on at least one occasion.¹⁹⁵ The analysis also confirmed expected regional import/export characteristics: “The Rocky Mountain and Desert Southwest were net exporting area[s]; California was a net importing area. The Pacific Northwest was net exporting during the spring and summer (March through

Figure 5-2. WECC Transmission Paths

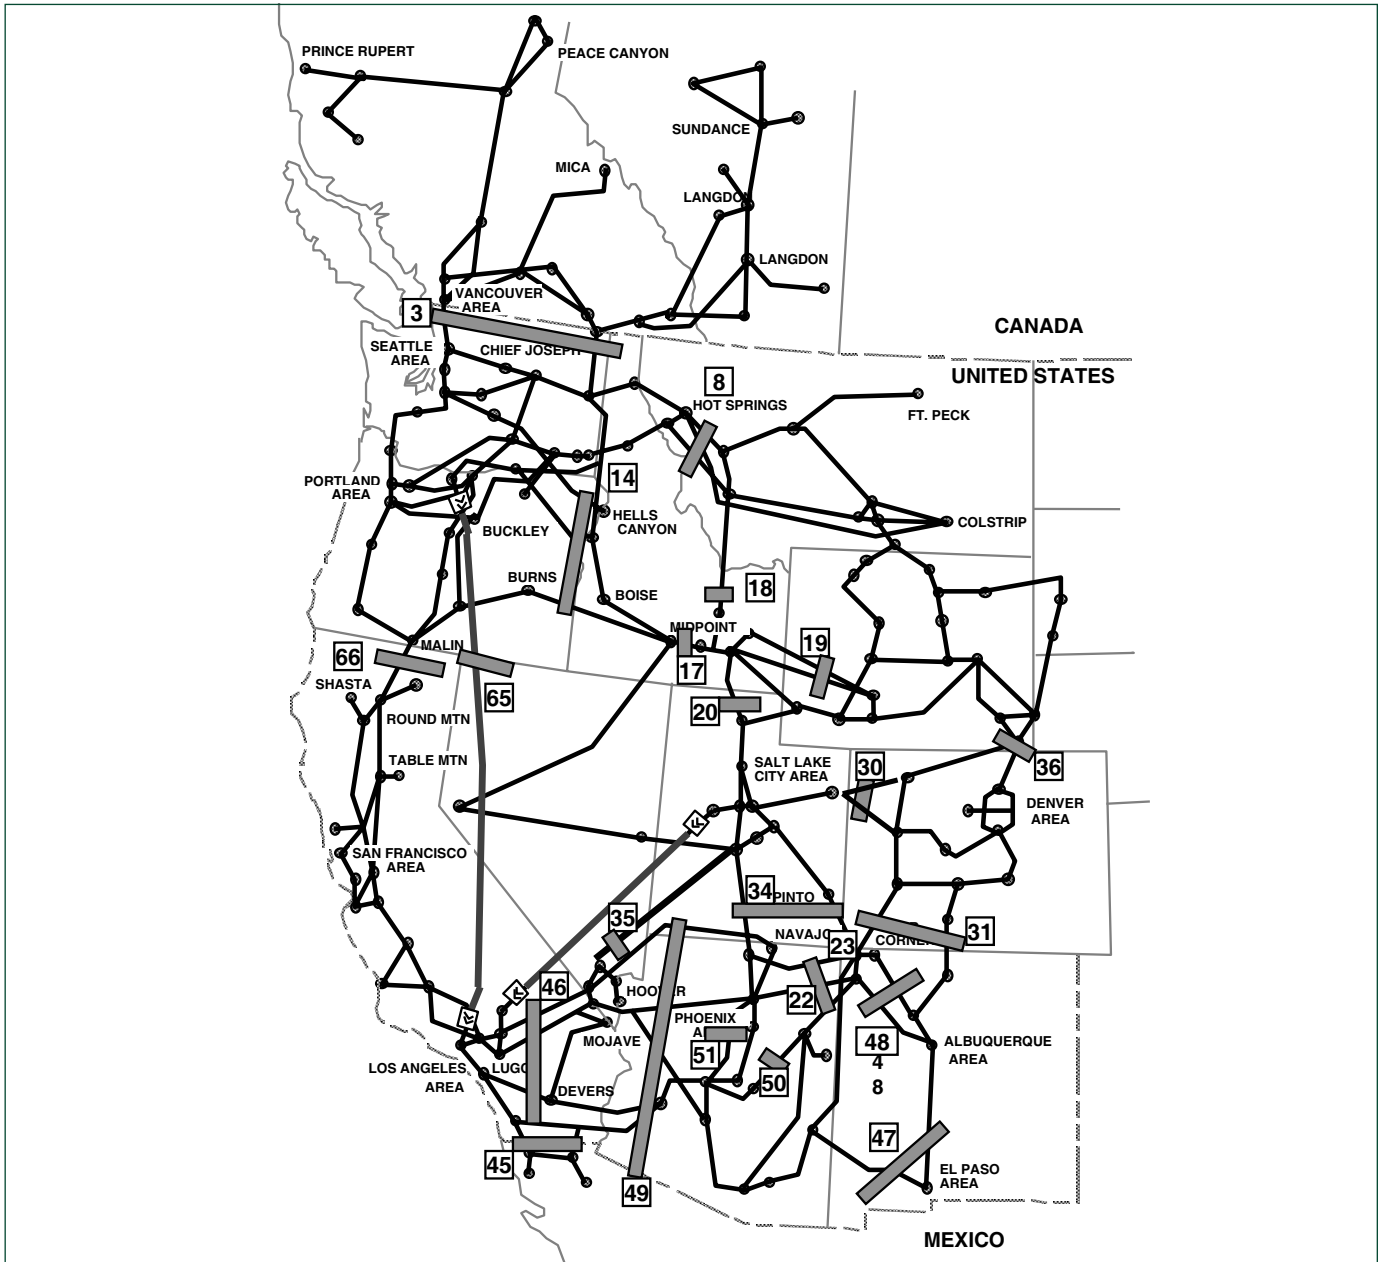

Source: TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee, Part 3 – Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov/>, p. 4.

¹⁹⁴ *Ibid.*, pp. 9 and 22. This excludes the Bridger West path because it is a radial line designed solely to deliver generation from the Jim Bridger power plant up to its maximum capability, and its typical high loading reflects the intended utilization of this line (directly following Bridger dispatch), rather than other grid conditions and possible transmission congestion.


¹⁹⁵ *Ibid.*, p. 27.

Table 5-1. Most Heavily Loaded Transmission Paths in the West Sorted by Alternative Ranking Methods, 2007 Data

Ranking (Top 6 Most Congested Out of 23 Paths)	Ranked by Actual Flow	Ranked by Net Schedule	Ranked by Maximum Directional Schedule (Either Direction)
1	Path 19: Bridger West	Path 19: Bridger West	Path 47: Southern New Mexico
2	Path 22: Southwest of Four Corners	Path 17: Borah West	Path 31: TOT 2A
3	Path 8: Montana to Northwest	Path 35: TOT C	Path 19: Bridger West
4	Path 66: California-Oregon Interface	Path 31: TOT 2A	Path 8: Montana to Northwest
5	Path 23: Four Corners 345/500 kV Transformer	Path 65: Pacific DC Intertie	Path 17: West of Borah
6	Path 65: Pacific DC Intertie	Path 23: Four Corners Transformer	Path 18: Montana to Idaho

Source: TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee, Part 3 – Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov>, p. 21.

Figure 5-3. Most Heavily Used Transmission Paths in WECC, 2007

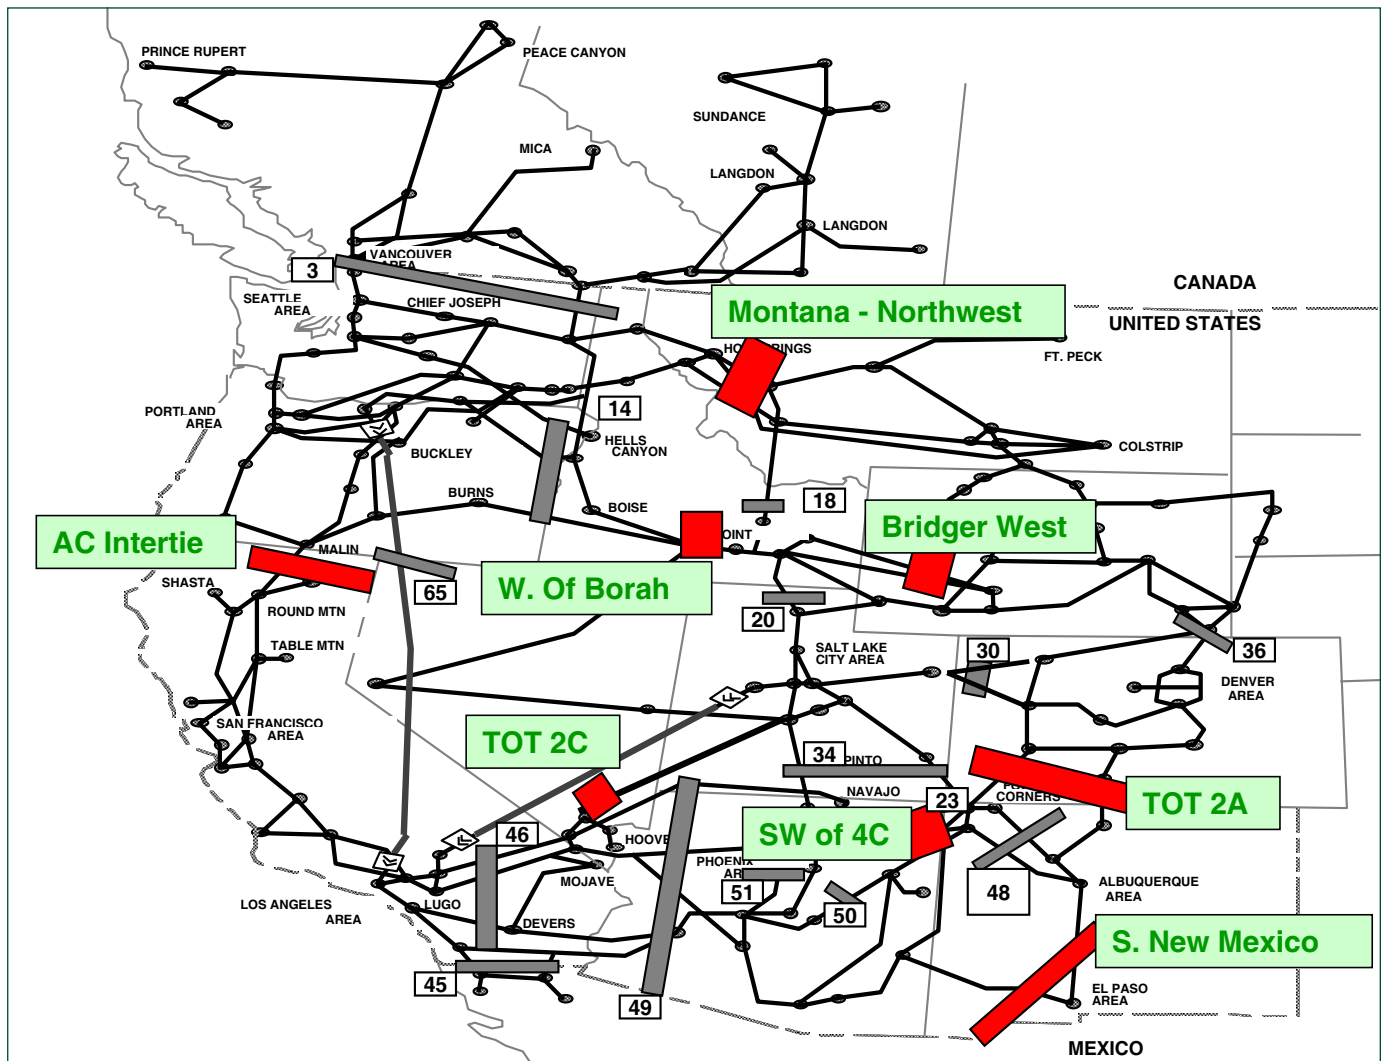

Source: Perry, D. (2009). "Historical Transmission Congestion Study, Western Interconnection." Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm>, slide 26.

August) and was neutral during the winter months (both importing and exporting).¹⁹⁶ Generally, the TEPPC historical analysis confirmed that the periods of heaviest flows on WECC transmission paths follow previously observed seasonal loading and import-export patterns.

Figure 5-4 shows that actual congestion in the West has been variable but has not increased significantly over the past 8 years. It indicates the number of paths loaded at or above 75% of rated capacity (U75) more than 25% and 50% of the time over the seasons spanning from winter 1998-99 through summer 2007. The figure reveals that as a general trend, U75 loading has come down and remained relatively stable over recent years.


One problem with TEPPC’s current analytic approach is that it only measures historical congestion along WECC’s traditionally recognized major paths, and thus by definition does not provide

information on congestion within smaller geographic areas. For example, as indicated in Figure 5-2 above, TEPPC does not presently evaluate historical congestion for areas that others might deem important for understanding congestion, such as the well-known Path 15 between Northern and Southern California. Similarly, the TEPPC analysis does not shed much light upon conditions between Seattle and Portland, which DOE identified as an area of concern in 2006.

5.3. Projected Congestion in the Western Interconnection

TEPPC conducted a number of simulation analyses for the year 2017 as part of its annual regional transmission planning study program. These simulation studies found that the most heavily constrained transmission paths were Path 20 (Path C Utah-Idaho), Path 31 (TOT2A Colorado-New Mexico),

Figure 5-4. Path Utilization Levels Vary But Have Not Increased: Path Utilization Trend, 1998-2007

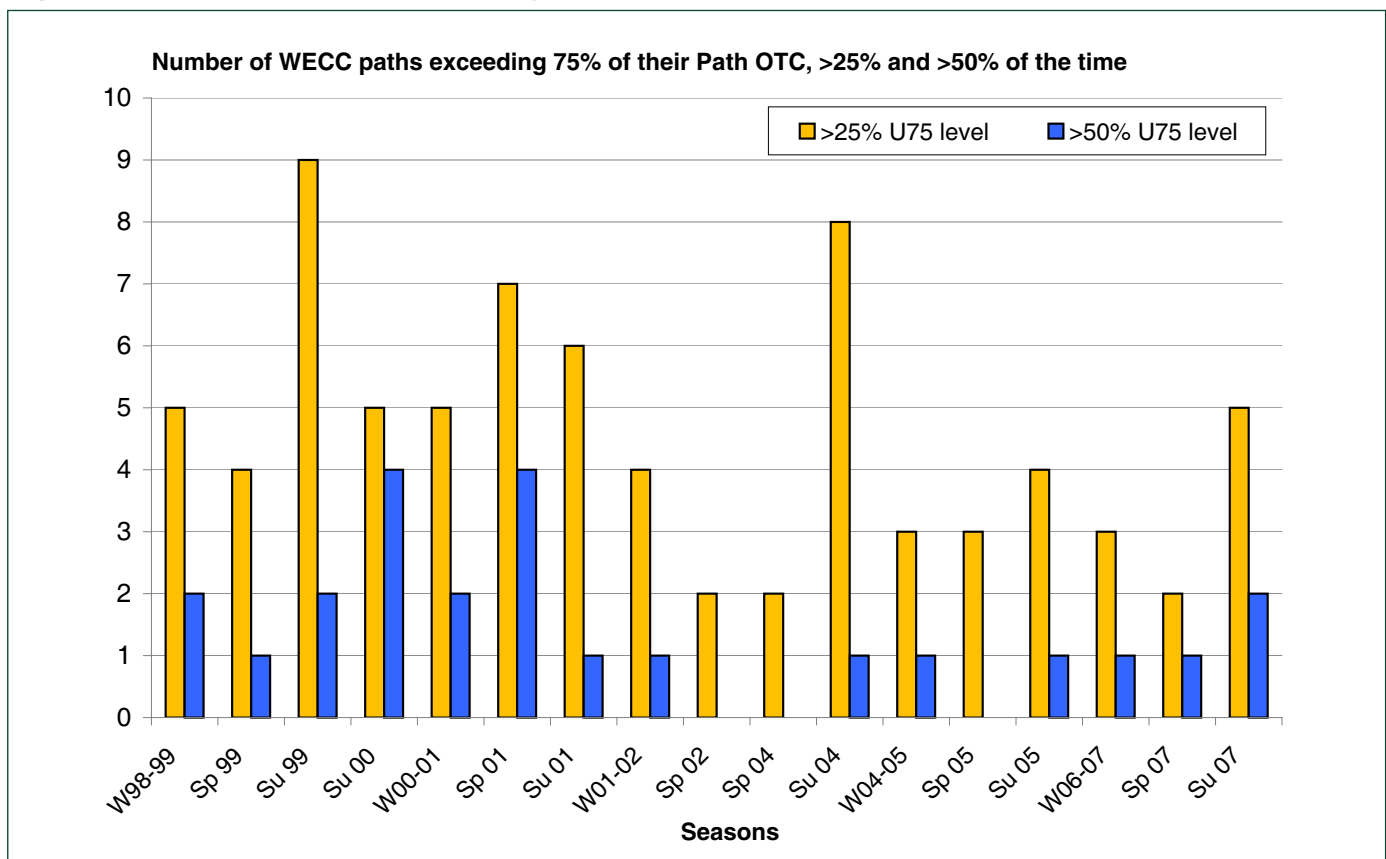

Source: TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee, Part 3 – Western Interconnection Transmission Path Utilization Study, Part 3—Western Interconnection Transmission Path Utilization Study*, at <http://congestion09.anl.gov/>, p. 44.

¹⁹⁶ *Ibid.*, p. 28.


Path 35 (TOT2C Utah-Nevada), Path 23 (the Four Corners 345/500 kV transformers), and Path 8 (Montana-Northwest). (See Figure 5-5 below.) These are several of the same paths that were identified as most heavily used in the analysis of 2007 transmission data.

As noted above, the TEPPC analytical approach focuses on the traditional transmission paths in the West, often aggregating several lines into a single path and representing large chunks of generation or load as single large nodes or bubbles. This approach limits the geographic resolution in the modeled results of generation, load, transmission flows, or transmission congestion. As a result TEPPC’s current modeling techniques do not look in depth at an area such as Southern California and the flows between Los Angeles and San Diego, or across the

Imperial Valley. To date TEPPC has not incorporated the Southern California Import Transfer nomogram into its models. Nor does TEPPC examine local area constraints, such as those that restrict the transmission import capability into the Los Angeles Basin to 10 GW, despite the fact that the combined thermal limit for the lines serving the Basin is 20 GW (and that this constraint would get even tighter if more generation is retired within the Los Angeles Basin). Thus TEPPC’s current modeling recognizes electricity flows and possible congestion across the interfaces from Nevada and Arizona into California, but does not recognize the additional constraints within California that limit flows between the large interfaces and Los Angeles.¹⁹⁷

TEPPC conducted a series of analyses, requested by the Western Interconnection Regional Advisory

Figure 5-5. Map of Principal Transmission Paths in the Western Interconnection

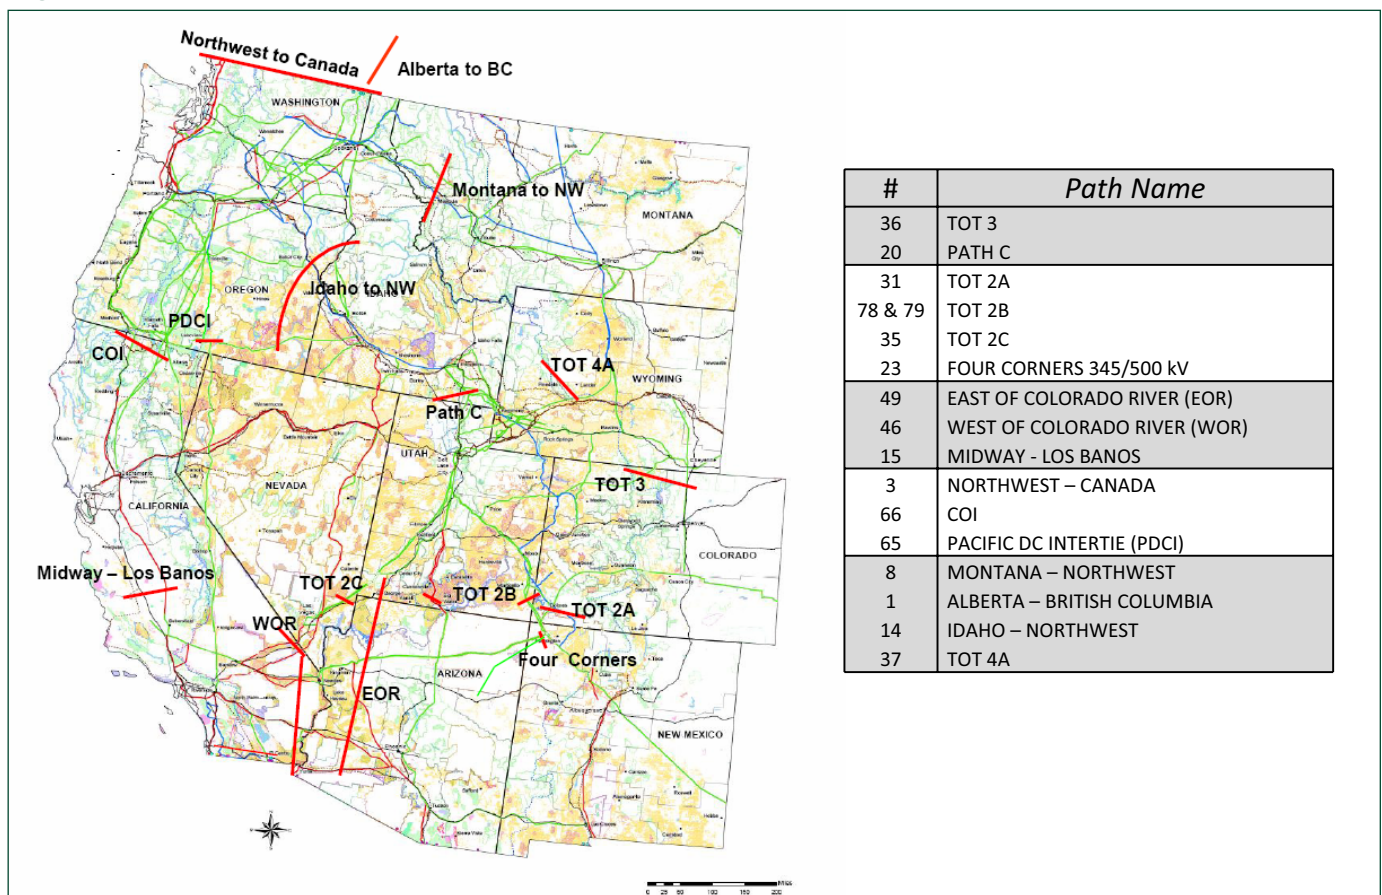

Source: TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee, Part 1 – Background, Study Plan and Simulation Analysis*, at <http://www.wecc.biz/committees/BOD/TEPPC/Shared%20Documents/Forms/AllItems.aspx?RootFolder=%2fcommittees%2fBOD%2fTEPPC%2fShared%20Documents%2fTEPPC%20Annual%20Reports%2f2008&FolderCTID=&View=%7b3FECCB9E%2d172C%2d41C1%2d9880%2da1CF02C537B7%7d>, Figure 5.6-2, p. 46.

¹⁹⁷ See <http://www.caiso.com/docs/2002/01/29/2002012909363927693.pdf>.

Body (WIRAB), to look at a series of resource portfolios associated with “resource mixes that are consistent with the goal of achieving a 15% reduction in carbon emissions by 2020 relative to 2005 levels.”¹⁹⁸ The fundamental assumption for this series of studies was that renewable energy would be increased to 15% of regional electricity production, located in both the United States and Canada. Several of the conclusions from the WIRAB series are notable here:

- Projected renewable energy production was spread broadly across the Western Interconnection, as shown in Figure 5-6 below.
- The most fully loaded U.S. transmission paths under these cases were Path 35 (TOT2C Southwest Utah to Nevada), Path 23 (Four Corners 345/500 kV Transformers), and Path 8 (Montana-Northwest), all of which are integral to the WECC transmission network; analysis suggests that these paths would operate at their limits more than 25% of the time for at least two of the four renewable scenarios plotted.
- With greater renewable generation, loading of major paths on the east side of the Western Interconnection network increases markedly above historical loading levels.¹⁹⁹
- As the level of energy efficiency increases (on top of 15% renewable energy production), natural gas-fired generation decreases far more than baseload coal generation. This is because coal remains the lowest-cost thermal resource in the generation stack while gas-fired generation is the marginal resource and absorbs the bulk of the efficiency-driven generation reduction.²⁰⁰
- With 15% renewables and high energy efficiency, flows and congestion increase on the paths moving energy from the northeast (MT, WY, ID and CO) toward the northwest (WA and OR) and toward the Desert Southwest (CA, AZ and NM). This is because there is more generation reduction in California, and higher energy efficiency savings in the interior states, which

allows increased generation in the interior states to flow west toward coastal population and load centers.²⁰¹

TEPPC transmission planning studies are conducted with minimal or no additional transmission facilities assumed to be built into the future network, specifically to enable planners to determine what additional transmission might be needed. A number of specific major new transmission projects (listed in Table 5-2) have been proposed for construction in the West that could help alleviate projected congestion if they are built. Many of these projects are designed to enable utilities serving large loads to access less expensive generation sources; a number are proposed specifically to open up new resource areas to bring new renewable and coal-fired generation to markets. Several of these proposed projects are shown in Figure 5-7.

The Department takes no position on the relative merits of or prospects for the individual projects listed in Table 5-2. The Department recognizes that a strong transmission grid (along with increased energy efficiency, demand response, and fuel-efficient dispatchable generation) is needed in the Western Interconnection to maintain reliability, increase development of renewables, and potentially displace petroleum-based fuels in the transportation sector. Accordingly, it will be important for many of these proposed transmission projects to move through the TEPPC planning process, gain state and federal regulatory and environmental approvals, secure appropriate financing and cost recovery assurances, and eventually get built and placed into service.

5.4. Southern California Critical Congestion Area

The Department’s 2006 Congestion Study identified Southern California (spanning the metropolitan areas of Los Angeles and San Diego) as a Critical Congestion Area, given the area’s persistent


¹⁹⁸ TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council’s Transmission Expansion Planning Policy Committee, Part 1—Background, Study Plan and Simulation Analysis*, p. 65.

¹⁹⁹ *Ibid.*, p. 89.

²⁰⁰ *Ibid.*, p. 74.

²⁰¹ *Ibid.*, p. 103.

Figure 5-6. Location of Renewable Resources by Region for TEPPC 15% Renewables Case

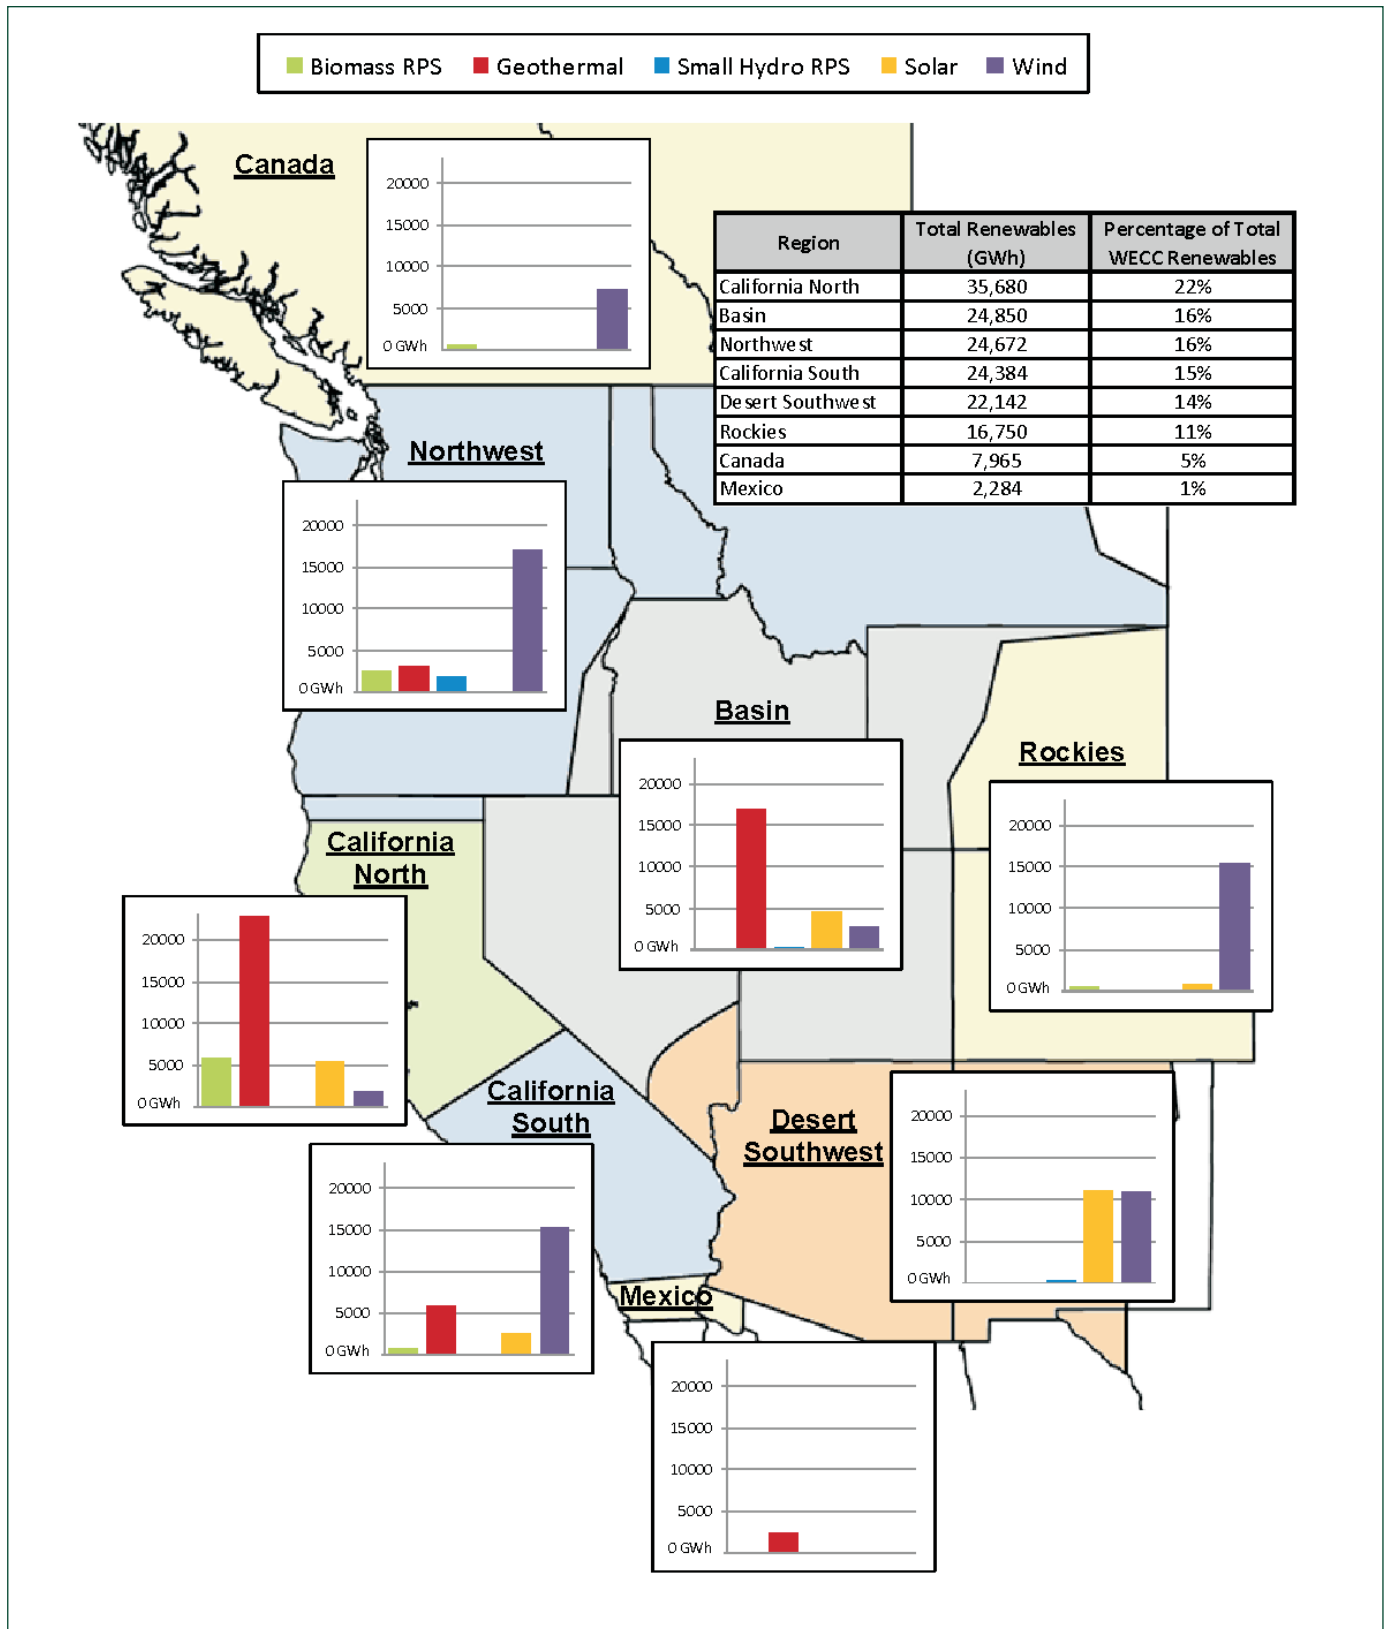

Source: TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee, Part 1 – Background, Study Plan and Simulation Analysis*, at <http://www.wecc.biz/committees/BOD/TEPPC/Shared%20Documents/Forms/AllItems.aspx?RootFolder=%2fcommittees%2fBOD%2fTEPPC%2fShared%20Documents%2fTEPPC%20Annual%20Reports%2f2008&FolderCTID=&View=%7b3FECCB9E%2d172C%2d41C1%2d9880%2dA1CF02C537B7%7d>, Figure 6.2-1, p. 70.

Table 5-2. Proposed Transmission Projects in the Western Interconnection

Project No.	Project Description	In-Service Date	WECC Status	Project Sponsors
1	Northern Lights – Celilo HVDC Project	2014	Phase 1	TransCanada Energy, Ltd.
2	Northern Lights Chinook (MT – NV) HVDC Line	2015	Phase 0	TransCanada Energy, Ltd.
3	Northern Lights Zephyr (WY – NV) HVDC Line	2015	Phase 0	TransCanada Energy, Ltd.
4	Juan de Fuca Sea HVDC Cable Sea	2010	Phase 2	Sea Breeze Pacific
5	West Coast HVDC Sea Cable	2010	Phase 1	Sea Breeze Pacific
6	Triton 2017 HVDC Sea Cable	???	Phase 1	Sea Breeze Pacific
7	Juan de Fuca II HVDC Sea Cable	???	Phase 1	Sea Breeze Pacific
8	TransWest Express Project	2015	Phase 1	Anschutz Corp, TransWest LLC, Arizona Public Service, PacifiCorp, Wyoming Infrastructure Authority
9	Gateway South Segment #1 – Mona – Crystal 500 kV	2013	Phase 2	PacifiCorp
10	Gateway South Segment #2 – Aeolus – Mona 500 kV	2013	Phase 2	PacifiCorp
11.1	Gateway Central – Populus – Terminal Transmission Project 345 kV	2010	Phase 3	PacifiCorp
11.2	Gateway Central – Mona – Oquirrh 500 kV	2012		PacifiCorp
11.3	Gateway Central – Sigurd – Red Butte – Crystal 345 kV	2013	Phase 1	PacifiCorp
12.1	SWIP North Transmission Project – Midpoint – Thirtymile 500 kV	2011	Phase 2	Great Basin Transmission LLC
12.2	SWIP South Transmission Project – Robinson Summit – Las Vegas 500 kV	2010	Phase 2	Great Basin Transmission LLC
13	Wyoming – Colorado Intertie Project (345 kV line)	2013	Phase 2	TransElect, Wyoming Infrastructure Authority
15	High Plains Express – Backbone path WY-CO-NM-AZ			Salt River Project, Tri-State G&T, Western Area Power Administration, Public Service Company of New Mexico, Xcel Energy, Trans-Elect, Colorado Springs Utilities, Platte River Power Authority, Colorado Springs Utilities, Platte River Power Authority, Wyoming Infrastructure Authority, New Mexico Renewable Transmission Authority, Colorado Clean Energy Authority
17	SunZia Project (Add to Path 47 for 1200 MW+ non-simultaneous capacity NM-AZ)	2013	Phase 1	Southwestern Power Group II, LLC, Salt River Project, Tucson Electric Power, Energy Capital Partner, Shell WindEnergy Inc.
19	Palo Verde Hub – North Gila Project 500 kV	2009	Phase 0	Arizona Public Service
20.1	Gateway West Segment #1A – Winstar – Aeolus – Jim Bridger 500 kV	2014	Phase 2	PacifiCorp, Idaho Power
20.2	Gateway West Segment #1B – Jim Bridger – SE Idaho (Bridger – Populus 2-500 kV)	2012	Phase 2	PacifiCorp, Idaho Power
20.3	Gateway West Segment #1C – SE Idaho – SC Idaho (Populous-Midpoint 500 kV)	2012	Phase 2	PacifiCorp, Idaho Power

Source: Transmission Expansion Planning Policy Committee (TEPPC) (2009). *Transmission Expansion Planning Policy Committee—2009 Synchronized Study Program*. Draft, at http://www.oatiaoasis.com/SPPC/SPPCdocs/Draft_TEPPC_2009_Study_Plan_05-12-09.pdf, Table 3.2, Transmission Projects for Consideration in Building Expansion Cases to Investigate Congestion Reduction, p. 20.

Table 5-2. Proposed Transmission Projects in the Western Interconnection (Continued)

Project No.	Project Description	In-Service Date	WECC Status	Project Sponsors
20.4	Gateway West Segment #1 – SC Idaho to SW Idaho (Midpoint – Hemmingway 500 kV)	2012	Phase 2	PacifiCorp, Idaho Power
21	Boardman – Hemmingway 500 kV (B2H)	2013	Phase 1	Idaho Power
22	Mountain States Transmission Intertie (MSTI) – Townsend – Borah – Midpoint 500 kV	2013	Phase 2	Northwestern Energy
23	COI Uprate Project – Non-simultaneous rating to 5100 MW	2008	Phase 0	Transmission Agency of Northern California
24	Canada – Northern California Transmission Project – Silkirk – Round Butte/Grizzly 500kV AC & Round Butte/Grizzly – Tesla/Tracy ±500kV DC	2015	Phase 1	Pacific Gas & Electric
25	Devils Gap Interconnection to Canada – Northern California Interconnection	2015	Phase 1	Avista Corp.
26	Central California Clean Energy Transmission Project (C3ET) Double circuit Midway – Fresno 500kV		Phase 1	Pacific Gas & Electric
27	Lake Elsinore Advance Pumped Storage Interconnection Talega – Escondido/Valley – Serrano 500kV	2007/2009	Phase 1	Nevada Hydro Company, Inc., The Lake Elsinore Valley Municipal Water District
28	San Francisco Bay Area Bulk Trans. Reinforcement Project		Phase 0	Pacific Gas & Electric
29	I-5 Corridor Reinforcement Troutdale – Alston/Paul 500 kV	2015	Phase 1	Bonneville Power Administration
30	West of McNary – McNary – John Day/Big Eddy – Station Z, OR/WA 500kV	2012 & 2013	Phase 1	Bonneville Power Administration
31	Hemmingway – Captain Jack 500kV	2014	Phase 1	PacifiCorp
32	Walla Walla – McNary/Boardman 230 kV	2010	Phase 0	PacifiCorp
33	Southern Crossing – Bethel – Boardman 500kV	2013	Phase 1	Portland General Electric
34	Increase Southern Navajo Path 51 Rating to 3200 MW	2010	Phase 2	Arizona Public Service
35	TOT3 Archer Interconnection Project	2019	Phase 2	Basin Electric Power Cooperative
36	Navajo Transmission Project Segment 1 – Four Corners – Navajo/Moenkopi – Mead/Marketplace 500kV	2010	Phase 2	Dine Power Authority
37	Ely Energy Center Project – Robinson Summit – Harry Allen 500kV	2011	Phase 2	Sierra Pacific Resources
38	Sunrise Powerlink Valley – Central 500kV & Central – Sycamore Canyon – Peasquitos 230kV	2010	Phase 2	San Diego Gas & Electric
39	Path 36 (TOT3) Upgrade – Miracle Mile – Ault 230kV	2010	Phase 3	Western Area Power Administration
41	Path 54 Uprate for Springerville #4	2009	Phase 3	Salt River Project

Source: Transmission Expansion Planning Policy Committee (TEPPC) (2009). *Transmission Expansion Planning Policy Committee—2009 Synchronized Study Program*. Draft, at http://www.oatiaoasis.com/SPPC/SPPCdocs/Draft_TEPPC_2009_Study_Plan_05-12-09.pdf, Table 3.2, Transmission Projects for Consideration in Building Expansion Cases to Investigate Congestion Reduction, p. 20.

Table 5-2. Proposed Transmission Projects in the Western Interconnection (Continued)

Project No.	Project Description	In-Service Date	WECC Status	Project Sponsors
42	Montana – Alberta Tie	2010 2Q	Phase 3	Montana Alberta Tie Ltd.
43	Path 27 Upgrade – IPP DC ±500kV	2009	Phase 3	Los Angeles Department of Water & Power
44	Green Path North Project – (Indian Hills – Upland)	2010	Phase 3	Los Angeles Department of Water & Power, Imperial Irrigation District
45	Devers – Palo Verde 500 kV No. 2	2011	Phase 3	Southern California Edison
46	Harcuvar Transmission Project (Devers – Harcuvar 230 kV)	2012-13	N/A	Central Arizona Water Cons District
47	Path 3 – Northwest – BC – S-N Rating Increase		Phase 1	British Columbia Transmission Corp.
48	Path 55 Brownlee East Increase to 1915 MW	2008	Phase 1	Idaho Power
49	Hughes Transmission Project	2009	N/A	Basin Electric Power Cooperative, Wyoming Infrastructure Authority
50	Wyodak South 230 kV Project			PacifiCorp
51	G3 500 kV Project			Vulcan Power Company

Source: Transmission Expansion Planning Policy Committee (TEPPC) (2009). *Transmission Expansion Planning Policy Committee—2009 Synchronized Study Program*. Draft, at http://www.oatiaoasis.com/SPPC/SPPCdocs/Draft_TEPPC_2009_Study_Plan_05-12-09.pdf, Table 3.2, Transmission Projects for Consideration in Building Expansion Cases to Investigate Congestion Reduction, p. 20.

transmission congestion problems, large population and important economic role within the nation. Factors influencing the identification as a Critical Congestion Area included the area’s growing electric demand, heavy dependence upon electricity imports, and difficulty in building new power plants and transmission lines. These factors are reviewed and updated below.

Southern California remains an important economic and population center for the nation. The region has three large electric utilities and several smaller non-investor-owned utilities:

- SCE serves over 13 million people in a 50,000 square mile area, located in the Los Angeles Basin and the Inland Empire. In 2008 its load peaked at 22,045 MW. The California Energy Commission (CEC) projects that the utility’s load will grow by 400 MW per year, with summer peak load forecast to reach 28,039 MW by 2013. Much of SCE’s generation is in-area from

nuclear, hydro, oil- and gas-fired and qualifying facilities,²⁰² with imports on AC and DC lines from the Pacific Northwest and Arizona.²⁰³

- SDG&E serves 1.4 million electric customers in San Diego and southern Orange counties over a 4,100 square mile area. SDG&E’s 2008 peak load reached 4,586 MW, and is projected to reach 5,227 MW by 2013.²⁰⁴ SDG&E imports a significant amount of its electricity supplies from outside its service area.
- The Los Angeles Department of Water and Power (LADWP) serves 1.4 million electric customers in the City of Los Angeles, with a peak load in 2008 over 6,160 MW, projected to rise to 6,469 MW by 2013.²⁰⁵

5.4.1. Changes in Load and Demand-Side Resources

Maximum actual peak load in southern California reached 28,669 MW during an extreme heat wave

²⁰²The federal Public Utilities Regulatory Policies Act of 1978 (PURPA) authorized states to establish regulatory regimes for cogeneration facilities, which were termed “qualifying facilities.”

²⁰³California ISO (CAISO) (2009b). *2009 California ISO Transmission Plan*. Amended June 2009, at <http://www.caiso.com/2354/2354f34634870.pdf>, p. 160.

²⁰⁴*Ibid.*, pp. 177, 180.


²⁰⁵California Energy Commission (CEC) (2007a). *California Energy Demand 2008-2018: Staff Revised Forecast*, at <http://www.energy.ca.gov/2007publications/CEC-200-2007-015/CEC-200-2007-015-SF2.PDF>, Table 3, p. 17.

in 2006. Recent state projections, based on expected average weather conditions, forecasted that peak demand will grow at a rate of 1.59% per year and reach 28,604 MW by 2013.²⁰⁶ That forecast, however, predates the current economic recession.

California has long been a leader in energy efficiency and demand response; the ACEEE ranked California as the foremost state in the nation in terms of the quality of its energy efficiency policies and accomplishments.²⁰⁷ ACEEE has also lauded California for its innovative energy efficiency

programs and policies, including decoupling and shareholder incentives for investor-owned utilities, designation of efficiency as the highest-priority new resource, large budgets for efficiency programs, and aggressive savings goals.²⁰⁸ The state adopted an ambitious Long Term Energy Efficiency Strategic Plan in 2008 that places energy efficiency as the highest priority for meeting California's energy needs, with the goal of transforming energy use and reducing greenhouse gas emissions through "Big, Bold Strategies."²⁰⁹

Figure 5-7. Proposed Major Transmission Projects in WECC

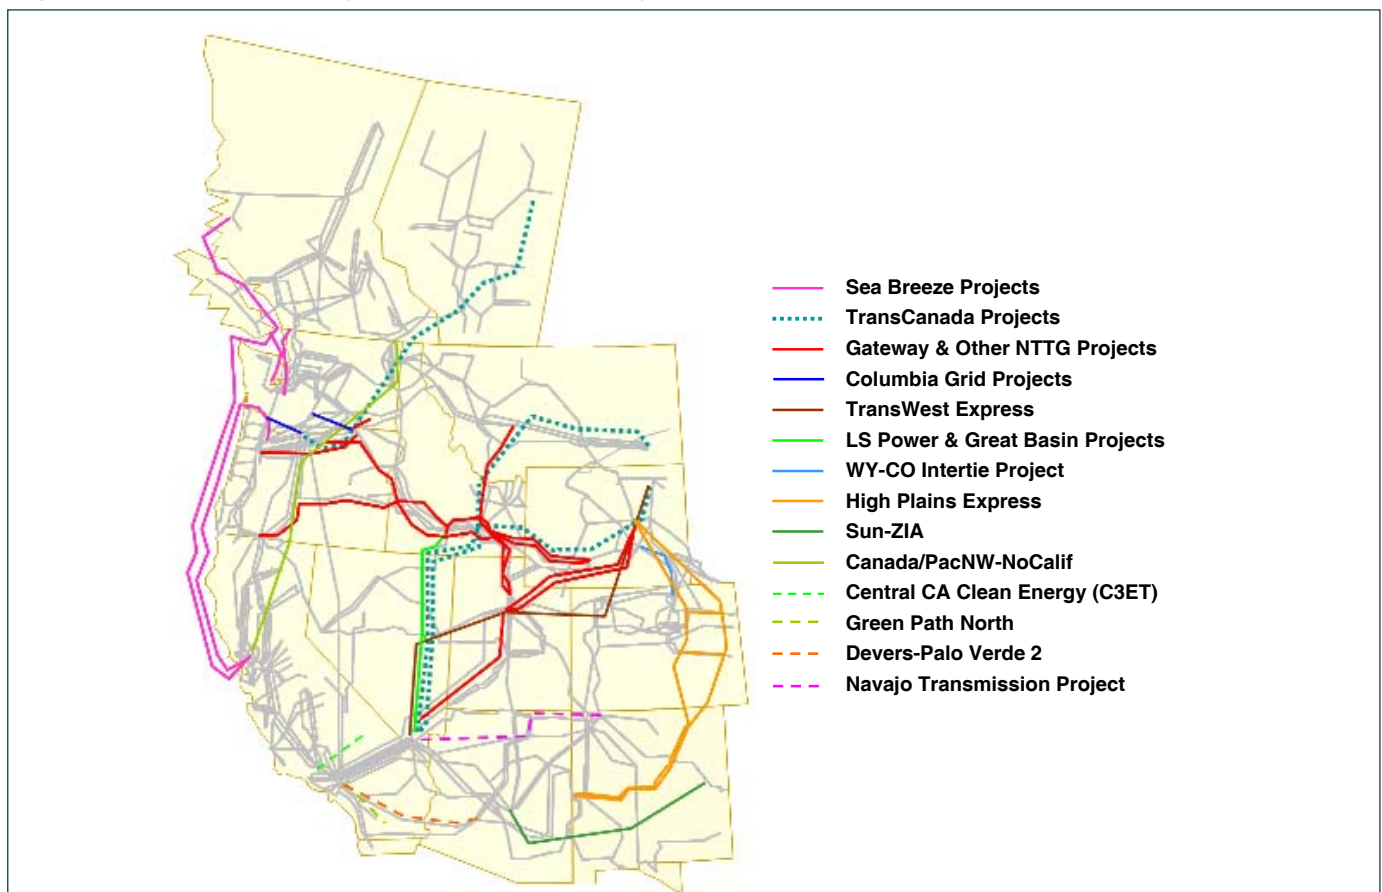

Notes: Plot includes selected projects from Table 3.2 of 2008 TEPPC Study Plan (v7). Projects have been grouped to simplify coding. Although this map shows the Devers-Palo Verde 2 line reaching all the way to the Palo Verde power plant, the permit request for that line was withdrawn from the Arizona Corporation Commission.

Source: Nickell, B. (2009). "Transmission Expansion Planning Policy Committee, 2008 Study Results." Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm>, slide 21.

²⁰⁶ *Ibid.*

²⁰⁷ Eldridge, M., et al. (2008) *The 2008 State Energy Efficiency Scorecard*, ACEEE Report Number E086, at http://www.aceee.org/pubs/e086_es.pdf, p.4.

²⁰⁸ Kushler, M., D. York and P. White (2009). *Meeting Aggressive New State Goals for Utility Sector Energy Efficiency: Examining Key Factors Associated with High Savings*. ACEEE Report Number U091, at <http://www.aceee.org/pubs/U091.pdf>, p. 111.

²⁰⁹ California Public Utilities Commission (CPUC) (2008a). *California Long Term Energy Efficiency Strategic Plan*, at <http://www.californiaenergyefficiency.com/docs/EEStrategicPlan.pdf>.

Between 2006 and 2008 state regulators authorized \$3 billion in energy efficiency investments by California’s investor-owned utilities, which produced a total of 10,341 MWh and 1,776 MW savings for the 2006-2008 period.²¹⁰ State agencies report significant savings in Southern California:

- SCE’s energy savings equaled 575 GWh in 2004, and grew to 1,638 GWh in 2008,
- SCE’s peak demand savings equaled 45 MW 115 MW in 2004, and grew to 329 MW in 2008,
- SDG&E’s energy savings equaled 225 GWh in 2004 and grew to 387 GWh in 2008, and
- SDG&E’s peak demand savings equaled 45 MW in 2004 and reached 69 MW in 2008.²¹¹

LADWP has a successful energy efficiency program that includes giving new energy-efficient refrigerators to low-income customers, giving out over 2.4 million compact fluorescent light bulbs to replace incandescent bulbs, and conducting

extensive customer education programs about the benefits of energy conservation and how to achieve them.²¹² LADWP reports saving 115 GWh with efficiency programs in fiscal year 2008, and expects to save 290 GWh in fiscal 2009.²¹³

The state has adopted rules that require major improvements in energy efficiency. These include the provision that new home energy use must be 35% better than 2005 energy code levels by 2011, and reach zero net energy levels by 2020; that new commercial buildings must attain zero net energy use by 2030; and that existing commercial buildings must reduce energy use by 20% by 2030.²¹⁴

California also relies upon aggressive utility and CAISO-managed demand response programs, as shown in Table 5-3.

California and its utilities are also leaders in installing distributed renewable generation. California dominates the nation’s photovoltaics market, aided

Table 5-3. Summary of Utility-Operated Demand Programs

Utility	Program	Enrolled MW			
		July 2007	July 2008	August 2007	August 2008
SCE	Price-Responsive	240	369	256	381
PG&E	Price-Responsive	608	735	623	752
SDG&E	Price-Responsive	117	150	121	154
Total		964	1,254	999	1,287
SCE	Reliability-Based	1,283	1,436	1,305	1,458
PG&E	Reliability-Based	322	451	323	466
SDG&E	Reliability-Based	93	89	98	83
Total		1,698	1,976	1,726	2,007
Combined Total		2,662	3,230	2,725	3,294

Source: CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, at <http://www.caiso.com/2390/239087966e450.pdf>, Table 2.4, p. 2.4, taken from monthly reports filed by the utilities with the CPUC.

²¹⁰ CPUC (2008c). *Energy Efficiency Groupware Application Standard Reports*. Program impacts tables, at <http://eega2006.cpuc.ca.gov/Reports.aspx>.

²¹¹ CPUC (2008b). *Energy Efficiency Groupware Application*. “Summary of 2006-2008 Energy Efficiency Programs–December 2008,” at <http://eega2006.cpuc.ca.gov/Default.aspx>, and 2005 data from California Energy Commission (CEC) (2007). *2007 Integrated Energy Policy Report*, at <http://www.energy.ca.gov/2007publications/CEC-100-2007-008/CEC-100-2007-008-CMF.PDF>.

²¹² See Los Angeles Department of Water & Power (LADWP) (2008). “L.A.’s Energy Demand Soars Toward All Time High.” LADWP Press release, at <http://www.ladwpnews.com/go/doc/1475/212546/>; LADWP (2009). “LADWP Gives Away 2 Million Compact Fluorescent Light Bulbs to Residential Customers.” LADWP Press release, at <http://www.ladwpnews.com/go/doc/1475/264244/>; and LADWP (2008). “LADWP Recognized as a Leader in Climate Change as the Recipient of 2008 Green California Leadership Award,” at <http://www.ladwpnews.com/go/doc/1475/198670/>.

²¹³ Raphael, C. (2009). “LADWP, Blooming Late, Reports Big Gains with Efficiency,” *California Energy Markets*, p. 12.

²¹⁴ Grueneich, D. (2008). “California Initiatives To Be Considered in DOE’s 2009 Congestion Study.” Presented at the U.S. Department of Energy Workshop on 2009 Congestion Study. San Francisco, California. See Materials Submitted at this Meeting, at <http://www.congestion09.anl.gov/pubschedule/index.cfm>, p. 3.

by the 10-year, \$3 billion California Solar Initiative with a rebate program for large renewables and the New Solar Home Partnership Program subsidizing new PV installations. In 2007 California had a total of 89 MW of grid-connected solar generation. At the end of 2007, LADWP alone had a total of 12.5 MW installed on the customer side of the meter in more than 1,400 solar installations. Statewide, California's Solar Initiative has approved over 10,000 applications representing 250 MW of new PV capacity, much of which is now awaiting installation.²¹⁵

California has also established standardized interconnection terms and feed-in tariffs to facilitate the development of non-solar distributed generation, including a Self Generation Incentive Program addressing wind and fuel cells up to 3 MW in size, a Small Renewable Generation Feed-in Tariff enabling distributed generation systems to sell to investor-owned utilities, and a similar program for combined heat and power facilities.²¹⁶

5.4.2. Changes in Generation and Transmission

The Department's concerns about the challenges and uncertainties facing Southern California are summarized by the California ISO's market monitor:

While seven consecutive years of stable and competitive market performance is encouraging, the industry must remain vigilant in addressing its ever-growing infrastructure needs, particularly for Southern California. Though approximately 7,500 MW of new generation has been added to Southern California since the energy crisis [of 2001], which enabled the

retirement of 4,300 MW of older inefficient generation, net generation additions for that region have only just kept pace with load growth. Consequently, reliability needs for that region continue to be met, in part, by older, less efficient generation, which cannot be sustained indefinitely. Moreover, major state environmental policies, such as greenhouse gas reductions, Renewable Portfolio Standards (RPS), and a potential ban on once-through cooling systems, will call for even more aggressive and coordinated action on addressing infrastructure issues.²¹⁷

The greenhouse gas (GHG) reduction policies mandate reductions in allowable carbon and other GHG emissions from power generation, and proposed cap-and-trade rules will increase the cost of new fossil generation options. The RPS requires that up to 33% of California's electricity consumption be generated from renewable sources by 2020, which will reduce Southern California's in-area generation options and increase transmission infrastructure and real-time grid operational challenges. The once-through cooling rules, driven by the federal Clean Water Act, require that power plant cooling water systems use the best available technology to minimize adverse environmental impact; this could mean that California's 21 aged power plants using once-through cooling would have to undergo costly modifications, be shut down, or be replaced. At present the final rules are not known and it is not possible to know what potential plant retirements may lie ahead.²¹⁸ The air quality rules established for Southern California require new power plants to acquire emission reduction credits through the offset market; these offsets are "almost non-existent and, even if available, expensive to buy."²¹⁹

²¹⁵ Grueneich, Commissioner Dian M. (2008). "California Initiatives To Be Considered in DOE's 2009 Congestion Study," p. 13.

²¹⁶ *Ibid.*, p. 14.

²¹⁷ CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, at <http://www.caiso.com/2390/239087966e450.pdf>, p. 19.

²¹⁸ Although a recent Supreme Court opinion (*Entergy Corp. v. Riverkeeper, Inc., et al.*, No. 07-588, decided April 1, 2009) gives the Environmental Protection Agency permission to use a cost-benefit analysis and balance benefits against costs in developing plans to implement the once-through cooling provisions (which may change federal once-through cooling requirements going forward), this ruling may have no impact on how California's environmental regulators treat once-through cooling generators. California's Senate Bill 42 was amended in March and April 2009 to require the State Water Resources Control Board to adopt and implement a schedule to phase out existing once-through cooling facilities, and prohibit a state agency from approving any new power plant that uses once-through cooling. See U.S. Supreme Court (2009). "*Entergy Corp. v. Riverkeeper, Inc., et al.*" No. 07-588, at <http://www.supremecourt.us/opinions/08pdf/07-588.pdf>; California Coastal Commission (2009). "Legislative Report for April 2009," at <http://documents.coastal.ca.gov/reports/2009/4/W25-4-2009.pdf>; and "Legislative Report for May 2009," at <http://documents.coastal.ca.gov/reports/2009/5/W28-5-2009.pdf>.

²¹⁹ CAISO (2009b). *2009 California ISO Transmission Plan*, p. 41.

The net result is that it is difficult and expensive to build new generation in Southern California, some existing generation may have to be retired, and new renewables may be hard to site close to load centers, thus increasing dependence on transmission imports and likely increasing transmission congestion within Southern California. Calculations by the CAISO's Market Monitor confirm the point, with Table 5-4's conclusions discussed in the quotation below:

[Table 5-4] . . . shows an annual accounting of generation additions and retirements since 2001, with projected 2009 changes included along with totals across the nine year period (2001-2009). Including estimates for 2009, the total net increase in installed generation in the CAISO Control Area over the nine years spanning 2001-2009 is projected to be approximately 12,600 MW. When accounting for an estimated 2 percent load growth over the same seven year period of approximately 8,600 MW, the net supply margin increased by roughly 4,000 MW since the energy crisis. Interestingly, [the table] indicates that

generation additions in Southern California (SP15) are projected to just keep pace with load growth and unit retirements, resulting in a minor net increase of approximately 30 MW, but in Northern California (NP26) there was approximately a 4,000 MW increase in new generation after accounting for load growth and generation retirement.²²⁰

New Generation

In the San Diego area:

- Palomar Energy is a 541 MW combined cycle plant owned by SDG&E that began operation in 2006 and was modified in 2008 to enable a rating of 558 MW during high temperature periods.
- The Otay Mesa combined cycle plant (561 MW) is completing construction and is expected to come on line in 2009.
- A 99 MW gas-fired peaker plant at Orange Grove is scheduled to be in operation in August 2009, and a 49 MW plant at the Margarita substation is under construction. The 49 MW Pala peaker plant was cancelled.

Table 5-4. CAISO Generation Additions and Retirements

	2001	2002	2003	2004	2005	2006	2007	2008	Projected 2009	Total Through 2009
SP15										
New Generation	639	478	2,247	745	2,376	434	485	45	1,650	9,099
Retirements	0	(1,162)	(1,172)	(176)	(450)	(1,320)	0	0	0	(4,280)
Forecasted Load Growth ^a	491	500	510	521	531	542	553	564	575	4,787
Net Change	148	(1,184)	565	48	1,395	(1,428)	(68)	(519)	1,075	32
NP26										
New Generation	1,328	2,400	2,583	3	919	199	112	0	1,491	9,035
Retirements	(28)	(8)	(980)	(4)	0	(215)	0	0	(26)	(1,261)
Forecasted Load Growth ^a	389	397	405	413	422	430	439	447	456	3,798
Net Change	911	1,995	1,198	(414)	497	(446)	(326)	(447)	1,009	3,976
ISO System										
New Generation	1,967	2,878	4,830	748	3,295	633	598	45	3,141	18,135
Retirements	(28)	(1,170)	(2,152)	(180)	(450)	(1,535)	0	0	(26)	(5,541)
Forecasted Load Growth ^a	880	897	915	934	953	972	991	1,011	1,031	8,585
Net Change	1,059	811	1,763	(366)	1,892	(1,874)	(394)	(966)	2,084	4,008

^aAssumes 2% peak load growth.

Source: CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, at <http://www.aiso.com/2390/239087966e450.pdf>, Table E.2, p. 6.

²²⁰CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, p. 5.

- New renewable generation sources include the 50 MW Kumeyaay Wind Farm that began commercial operation in late 2005, the 40 MW Lake Hodges pumped storage plant now under construction, and the 27 MW Bull Moose biomass plant that was scheduled to be in-service in April 2009.
- After both Otay Mesa and the Sunrise Powerlink line are in operation, the 689 MW South Bay power plant will be retired.²²¹

In the SCE area, the 45 MW Dillon wind plant began operation in 2008.

Table 5-5 shows the new generation south of Path 26 that the CAISO expects to become operational in 2009. The CAISO comments, “Only 45 MW of new generation began commercial operation within the CAISO control area in 2008 This figure is significantly below the 1,800 MW that was projected for 2008 New generation projects are complicated and costly, and consequently are subject to significant delays. Most of the projects projected to become commercial in 2008 were delayed”²²²

The CAISO anticipates no power plant retirements in Southern California in 2009.

Looking ahead, there is reason to question how much new generation will be built in California in the near term. The CAISO’s market monitor calculates each year how much in revenues a new generation facility could have earned in California’s spot market; the market monitor reports that in 2008, for the sixth year, estimated spot market revenues fell short of a new combined cycle unit’s annual fixed costs—in other words, without a long-term power purchase contract and/or public subsidies assuring above-spot market revenues, a new generator would lose money.²²³ Added to the public and regulatory challenges of building new power infrastructure in California, this result helps to explain why there is not more fossil-fired generation being built in Southern California.

New Transmission

SCE’s Devers-Palo Verde transmission line expansion (once expected to be on line in 2009) was delayed due to a siting denial in 2007 by the Arizona

Table 5-5. New Generation Expected On Line in Southern California in 2009

Generating Unit	Resource Capacity (MW)	Expected Operational Date
Inland Empire Energy Center Unit 1	405.0	01-Oct-09
Inland Empire Energy Center Unit 2	405.0	01-Oct-09
Fontana RT Solar*	2.0	01-May-09
Garnet Energy Center*	3.0	15-May-09
Garnet Energy Center Expansion*	3.5	01-Jun-09
Chiquita Canyon Landfill	9.2	
Kittyhawk Renewable Energy Facility	2.2	01-Jun-09
Sierra Solar Generating Station*	5.0	01-Jun-09
Toland Landfill G-T-E Project	1.0	01-Jun-09
Otay Mesa Energy Center	615.0	01-Oct-09
Miramar Energy Facility II	49.0	31-Jul-09
Orange Grove	99.0	01-Nov-09
Coram Brodie Wind Project*	51.0	01-Dec-09
SP26 Planned New Generation in 2009	1,650.0	

*Renewable generation.

Source: CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, Table 1.3, p. 1.3.

²²¹ CAISO (2009b). *2009 California ISO Transmission Plan*, p. 184.

²²² CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, p. 5.

²²³ *Ibid.*, p. 3.

Corporation Commission (ACC). In May 2009, SCE announced that it would not refile a request for line approval with the Arizona Commission to build the eastern portion of the line, because “the economic benefits to California customers to build the Arizona portion of the project are now reduced significantly.”²²⁴ SCE’s updated analysis “shows significant economic, resource and load changes” since 2006 that reduce the need and value of the line and its associated southwest generation.²²⁵ These changes include the development of in-state renewable generation that will reduce the need for imports, increased generation along the path of the line, lower fuel prices and power price differentials between California and Arizona, and reduced load growth in California. SCE indicates, however, that it intends to pursue expansion of the California portion of the line to facilitate additional renewable energy development in Southern California.

SDG&E’s Sunrise Powerlink project, a 500 kV line from the Imperial Valley to San Diego, will be the largest upgrade to SDG&E’s system in over 20 years. The line received its Certificate of Public Convenience and Necessity from the CPUC in December 2008 and is scheduled to come on line in summer 2012. The line is expected to “increase SDG&E’s import capability and provide access to needed generation resources to meet load growth.”²²⁶

CAISO began conducting formal transmission studies and approving major transmission projects in 2007. A review of past years of transmission projects approved in previous study cycles indicates that SCE and SDG&E submitted and received few project approvals in those cycles, accounting for only 10 of the 86 projects approved. Most of those Southern California projects—capacitor banks, voltage support, reconductoring, transformers and switchyard improvements—are scheduled to come

on line in 2009 through 2011.²²⁷ The 2010 CAISO Transmission Plan indicates that of the 141 new transmission projects being studied in the ISO Reliability Assessment, only 30 of those projects are in Southern California.²²⁸

SCE is now building the first of three phases of transmission projects to bring 4,500 MW of wind generation from the Tehachapi region into the Los Angeles Basin. The CPUC approved the first phase (three transmission lines) in March 2007, with an expected in-service date of 2010; a decision on approval for the second phase is expected in 2009.

A significant proportion of the electricity consumed in Southern California is generated in Arizona and Nevada and delivered across an extensive high voltage transmission network, as shown in Figure 5-8 below. There are a number of transmission upgrades planned or under construction that will increase throughput and reduce congestion along these paths.

Figure 5-9, a map from the CAISO, shows the principal points of transmission congestion within the state and the costs of that congestion in 2007 and 2008. The bottom half of the map, below Path 26, includes the bulk of the Southern California Critical Congestion Area. Although the individual path and total costs of congestion are relatively low for these two years relative to the total value of the electricity flows, the figure displays the key transmission constraints within the state and region.

CAISO reports that sources of intra-zonal congestion within Southern California included these points shown in Figure 5-10:

- The Southwest Powerlink corridor, which includes the Imperial Valley and Miguel transmission stations. Miguel is the choke point for transmission from Mexico and Arizona to load in Southern California.

²²⁴Southern California Edison (2009). “Devers-Palo Verde No. 2 Project Update,” at http://www.sce.com/NR/rdonlyres/0A5F8FEB-5357-4C11-BD93-07387DE4B2C1/0/090515_DPV2ProjectUpdate_May2009.pdf.

²²⁵*Ibid.*

²²⁶*Ibid.*, p. 179.

²²⁷*Ibid.*, pp. 32-33.


²²⁸CAISO (2009a). *2010 ISO Transmission Plan, Final Study Plan*, at <http://www.caiso.com/2374/2374ed1b83d0.pdf>, Table 2-3, pp. 14-18. Note that the CAISO analyzes SCE and SDG&E project proposals but does not formally report on transmission projects undertaken by LADWP and other municipal power companies in Southern California.

- The area near the San Onofre Nuclear Generation Station while one of the generation units was shut down for a transmission upgrade.
- The Lugo area, a transmission choke point between generation in Nevada (around Las Vegas and Hoover Dam) and load centers in Southern California.
- There is also a reliability constraint on the Victorville-Lugo Nomogram that is affected by flows between the CAISO areas and LADWP (although CAISO notes that this is technically not congestion).

In a recent assessment of the electric infrastructure challenges the state faces, the California State Auditor concluded:

Since the [2001] energy crisis, California has adopted targets to increase the use of renewable sources of electricity. However, the State is at risk of failing to meet these targets because various obstacles are preventing the construction of the infrastructure needed to generate and transmit electricity from such renewable sources as wind and solar.²²⁹

Figure 5-8. Transmission Linking Arizona and Nevada to Southern California and Planned Upgrades

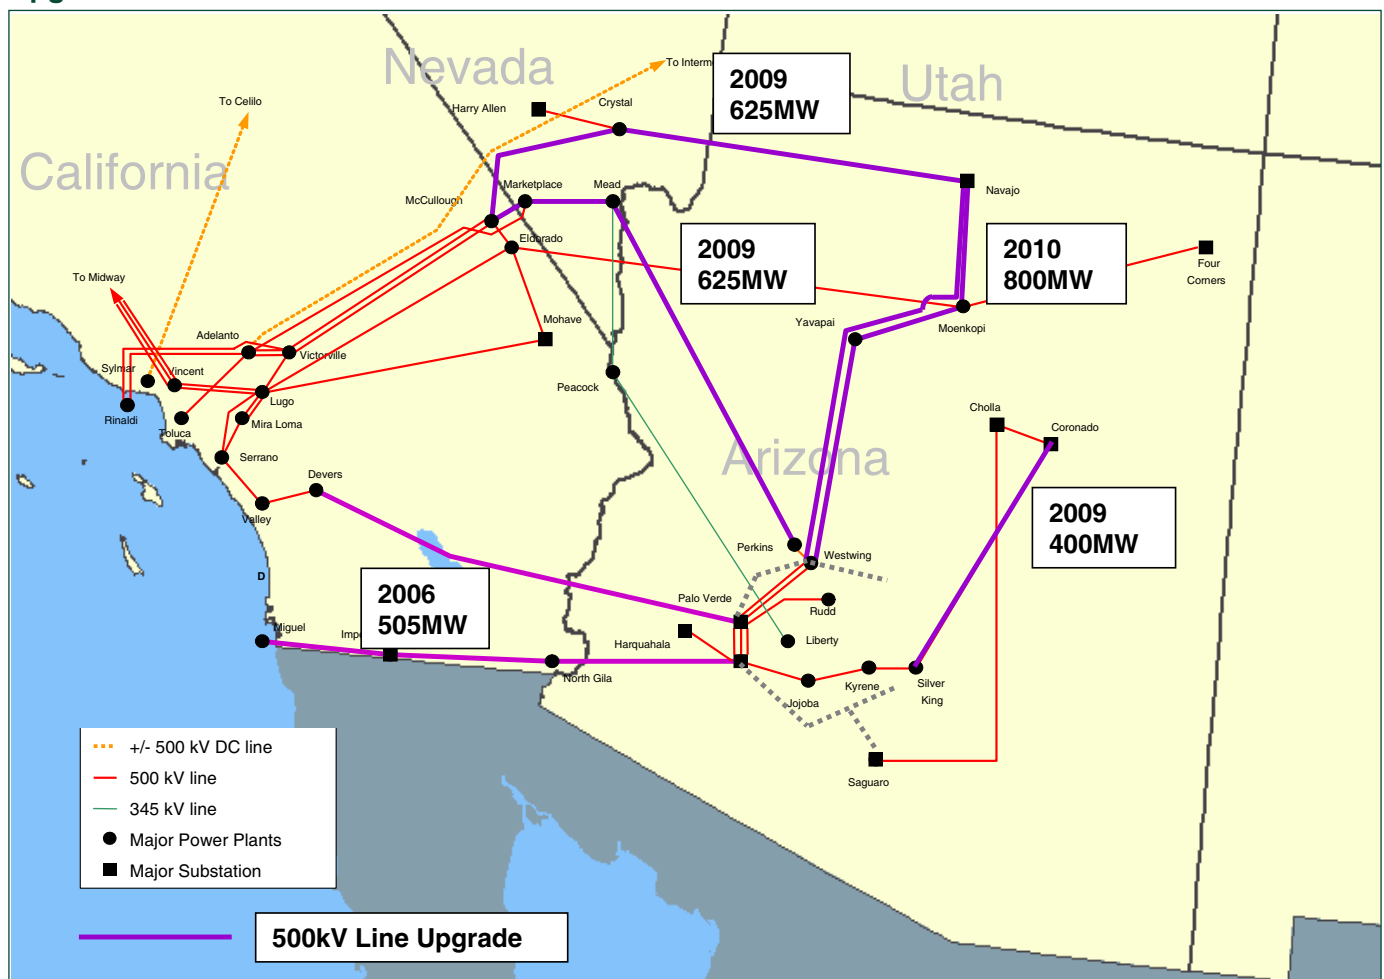

Source: Kondziolka, R. (2009). "Western Interconnection Subregional Planning and Development." Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm>, slide 12. Although this map shows the planned Palo Verde-Devers 2 transmission line stretching all the way to the Palo Verde power plant, SCE has withdrawn its permit application for the Arizona portion of the line.

²²⁹ California State Auditor (2009). *High Risk: The California State Auditor's Updated Assessment of High-Risk Issues the State and Select State Agencies Face*, at <http://www.bsa.ca.gov>.

5.4.3. Conclusions for Southern California


This review leads the Department to reach several conclusions about past and future transmission congestion in Southern California:

- Although the state of California has made major progress in moderating electric load growth and increasing distributed generation and in-region

generation, the Southern California region remains challenged.

- New transmission and generation projects in Southern California have barely kept pace with load over the past few years. Although many promising generation and transmission projects are now in the planning or regulatory approval stages, experience shows that few such projects come in on schedule in California.


Figure 5-9. Major Congested Interties and Congestion Costs in California

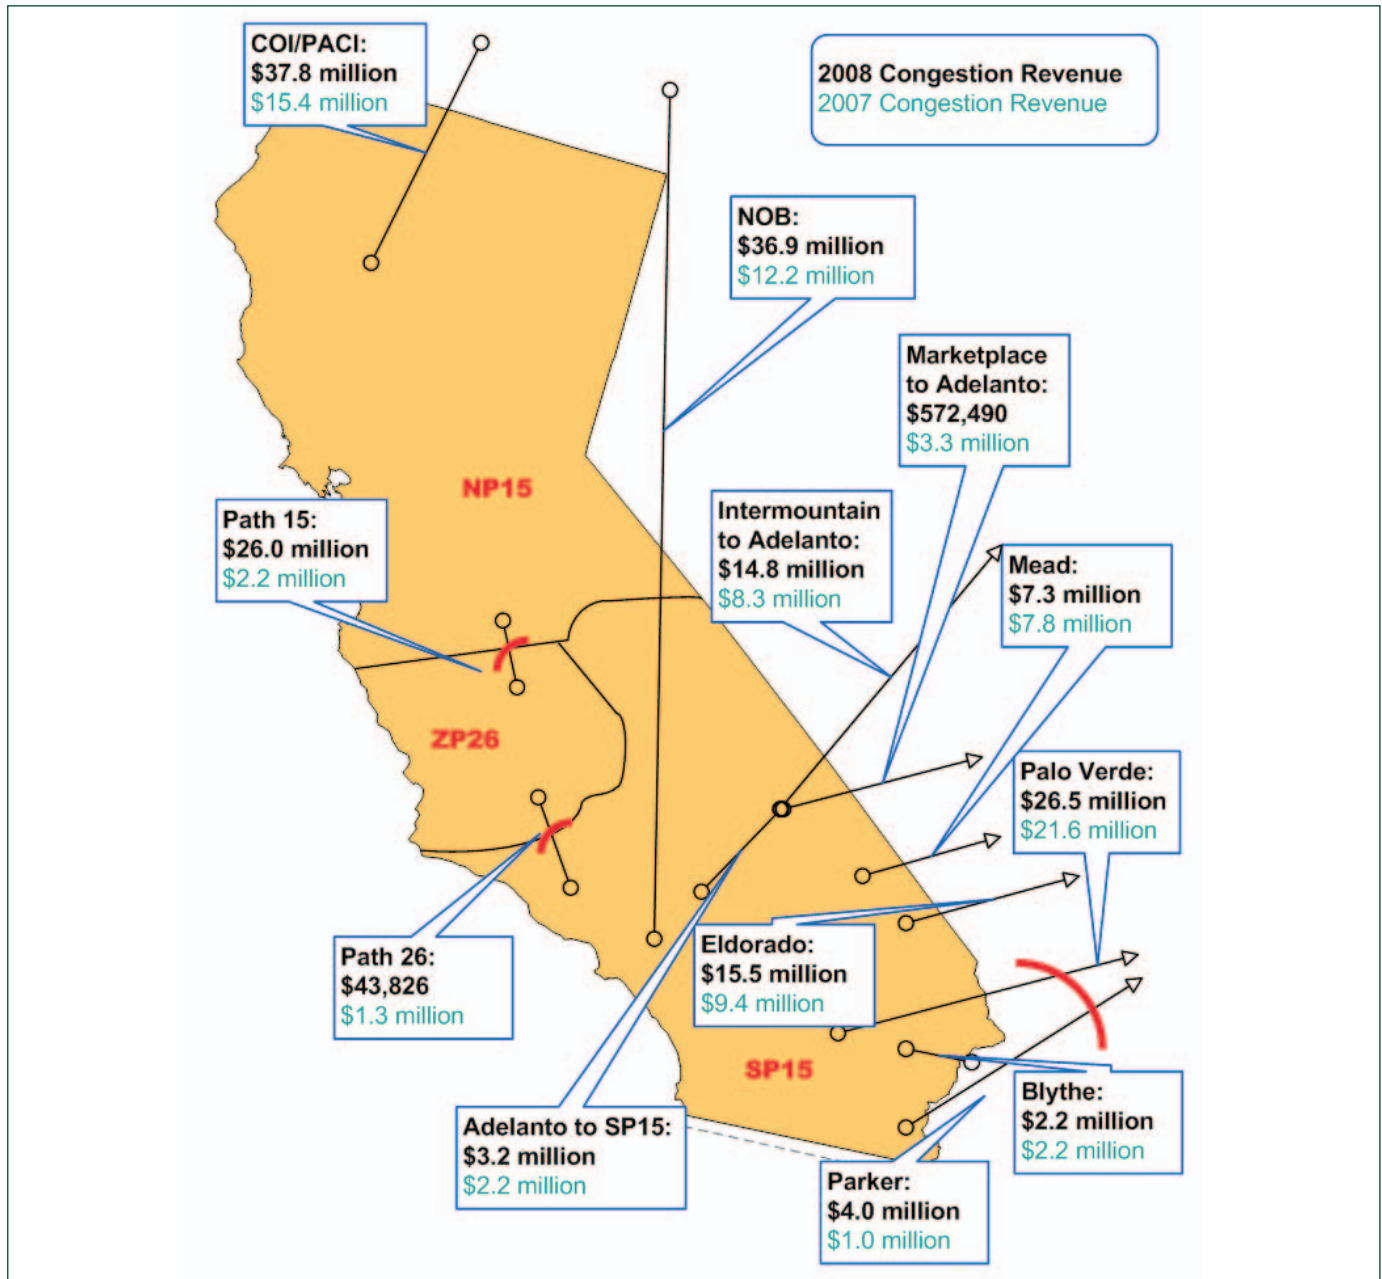

Source: CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, at <http://www.caiso.com/2390/239087966e450.pdf>, Figure E-12, p. 18.

- Slow development of new generation and transmission facilities could compromise near-term grid reliability in Southern California, despite growing demand response and smart grid capabilities.
- The state has ambitious plans to increase renewable energy use, but that will require additional transmission development.

Figure 5-10. Key Points of Intra-Zonal Congestion in California

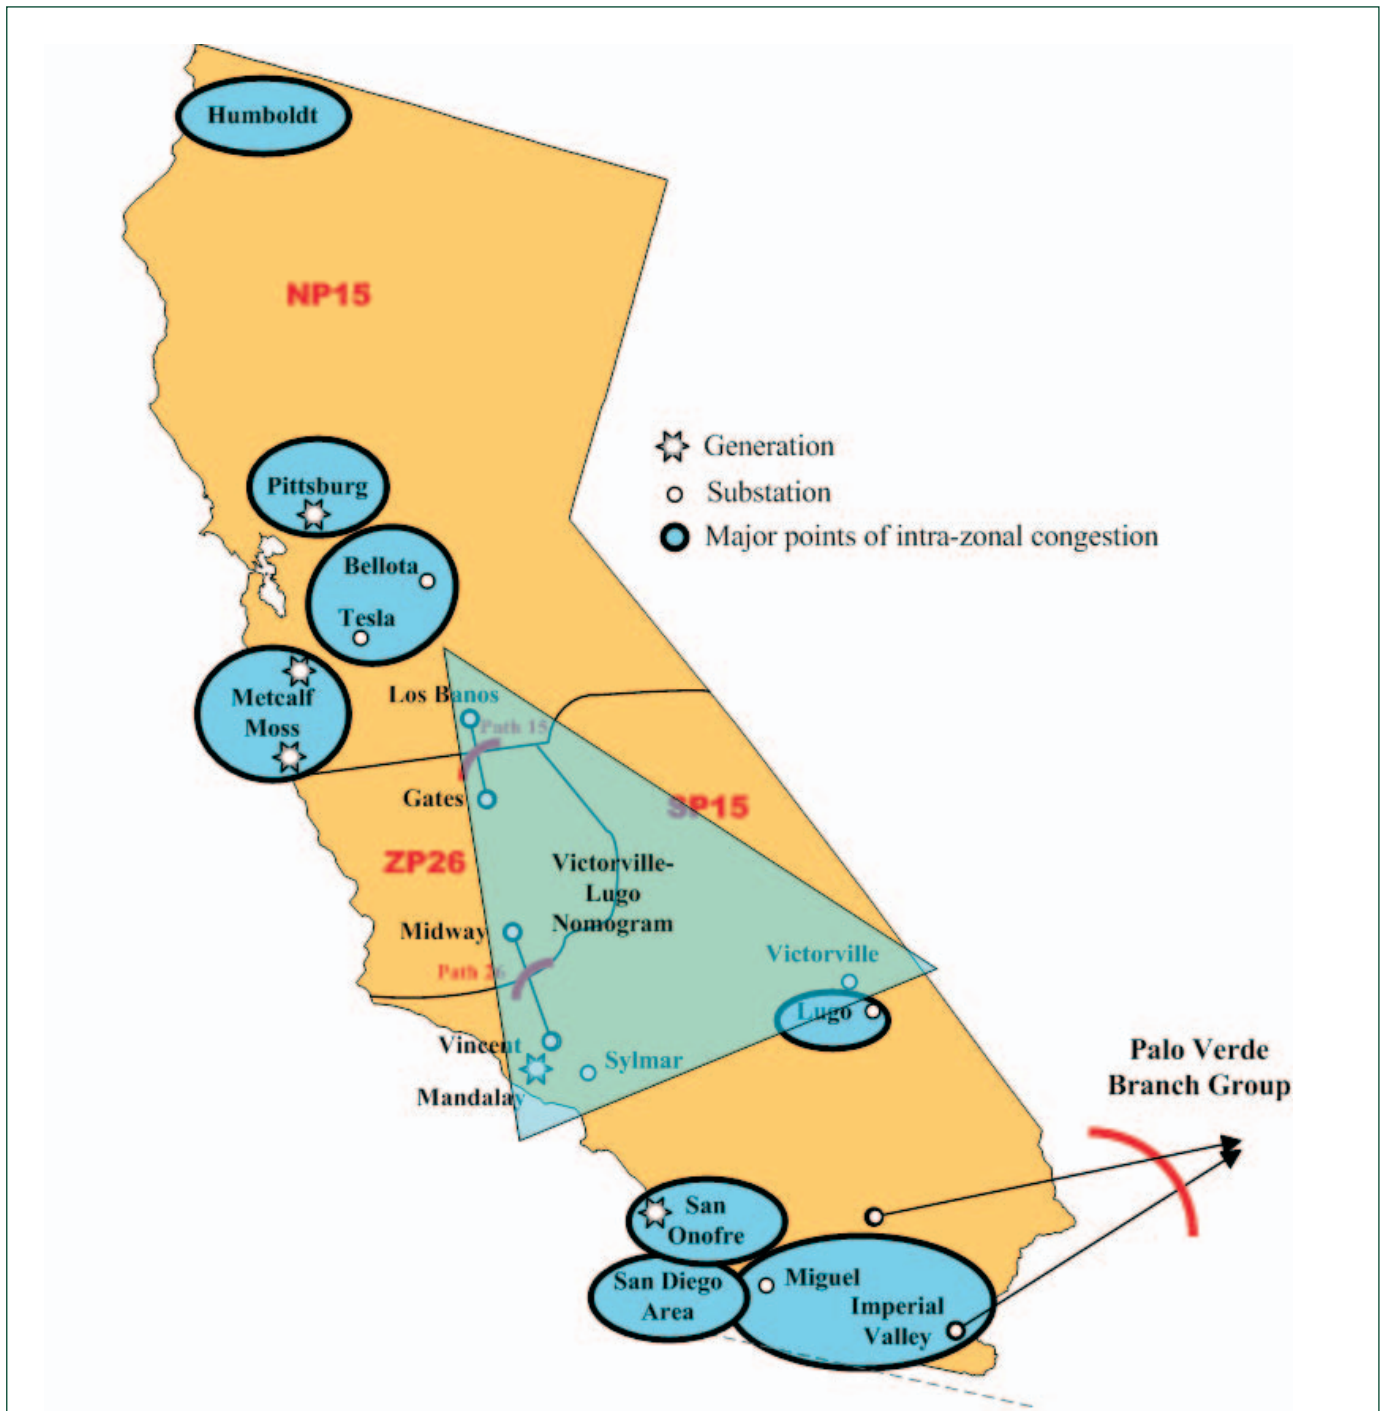

Source: CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, at <http://www.caiso.com/2390/239087966e450.pdf>, Figure 6.1, p. 6.4.

- Although the economic costs of transmission congestion in Southern California are relatively low compared to the value of electricity deliveries, there are significant unresolved threats to the reliability of the area's electricity infrastructure.

For these reasons, the Department concludes that Southern California remains a congested area, and that it should continue to be identified as a Critical Congestion Area.

5.5. San Francisco Peninsula Congestion Area of Concern

The 2006 *National Transmission Congestion Study* identified the San Francisco Bay Area as an Area of Concern because of the reliability challenge posed by serving the area between San Jose and San Francisco with a single set of lines across the San Francisco Peninsula. In addition, the area had high local generation costs due to local high-cost reliability must-run requirements, and little in-area generation. The San Francisco City and Peninsula—then and now—depend upon import capabilities and generation in the East Bay and South Bay areas and the levels of demand and generation dispatch in those areas.²³⁰ The greater Bay Area is shown in Figure 5-11; this report's area of principal concern (as in 2006) is the San Francisco Peninsula, which includes the City of San Francisco.

5.5.1. Changes in Load and Demand-side Resources

It is difficult to estimate the actual load for the San Francisco Peninsula from public information. A CAISO local capacity analysis estimated that for 2008, the Greater Bay Area (which extends beyond the City of San Francisco and the San Francisco Peninsula proper) had a peak load of 9,870 MW

(1 in 10 probability) and local capacity requirements of 4,688 MW, but 6,214 MW of total dependable local area generation.²³¹ A companion analysis for 2009 showed consistent results for 2013, with a load increase of 1.5%, 6,992 MW of qualifying capacity available compared to 5,344 MW of local capacity needed.²³² These estimates suggest that it is reasonable to expect continued load growth on the Peninsula.

Electric load has continued to grow in Northern California. The CEC projected that peak demand for the control area north of Path 15 would grow from 22,168 MW in 2006 to weather-normalized 21,671 MW in 2008 and 23,158 MW by 2013—a short-term drop followed by a 1.3% annual increase.²³³ The CAISO's 2009 reliability assessment used a summer load forecast that showed San Francisco City and Peninsula loads growing from 2,006 MW in 2008 to 2,111 MW in 2013, a 5% increase.²³⁴

Both the state of California and the largest serving utility in the Bay Area, Pacific Gas & Electric (PG&E), have run aggressive demand-side management programs in the area for many years. PG&E estimates that its efficiency programs saved 375 GWh in 2004, growing to 800 GWh in 2007, and peak demand savings of 80 MW in 2004 growing to 135 MW in 2007.²³⁵ It is reasonable to assume that at least a portion of these savings came from San Francisco (although California's largest energy savings come from portions of the state with hot weather, high rates of new construction, and high potential air conditioning savings, all of which are less achievable in the Peninsula and City).

Since 2005, California has been offering more demand response programs to more customers; PG&E has been aggressively rolling out advanced meters to its customers since 2007 to facilitate time-of-use rate offerings. For August 2007, PG&E reported

²³⁰ CAISO (2009b). *2009 California ISO Transmission Plan*, p. 113.

²³¹ CAISO (2008b). *2009 Local Capacity Technical Analysis: Final Report and Study*, at <http://www.caiso.com/1fba/1fbace9b2d170.pdf>, Table 6, p. 22.

²³² *Ibid.*, Table 4, p. 22.

²³³ California Energy Commission (CEC) (2007a). *California Energy Demand 2008-2018: Staff Revised Forecast*, at <http://www.energy.ca.gov/2007publications/CEC-200-2007-015/CEC-200-2007-015-SF2.PDF>, p. 17.

²³⁴ CAISO (2009b). *2009 California ISO Transmission Plan*, derived from Table 4-37, p. 115.

²³⁵ California Energy Commission (CEC) (2007). *2007 Integrated Energy Policy Report*, at <http://www.energy.ca.gov/2007publications/CEC-100-2007-008/CEC-100-2007-008-CMF.PDF>, Figures 3-8 and 3-9.

that there were 623 MW enrolled in its price-responsive demand response programs, and 323 MW enrolled in reliability-based demand response.²³⁶ The California PUC has ordered PG&E to put dynamic pricing electric rates in place by

May 2010 for large commercial and industrial customers, with optional Critical Peak Pricing rates for medium and small commercial and industrial customers and residential customers, but implementation of those rates could be delayed.²³⁷

Figure 5-11. Electric System of the Greater San Francisco Bay Area



Source: California Energy Commission (CEC), Cartography Office (2008). "Electric System of the Greater San Francisco Bay Area."

²³⁶ CAISO (2009c). *Market Issues & Performance: 2008 Annual Report*, Table 2.4, p. 2.5.

²³⁷ Corrigan, H. (2009). "Utility Dynamic Pricing Case Starts With Questions on Costs, Timing." *California Energy Markets*.

5.5.2. Changes in Generation and Transmission

Little new generation has come on-line in the San Francisco area since 2005. The 10.7 MW landfill gas-fired Ox Mountain power plant came on-line on the west side of the Peninsula in December 2008; Unit 3 of Mirant's Potrero 362 MW power plant is scheduled for retirement when the TransBay Cable becomes operational. Small amounts of distributed photovoltaic generation have been installed along the Peninsula, but they are not enough to have a material impact upon local reliability.

The CAISO's 2009 reliability assessment found that the Greater Bay Area system has "adequate internal generation resources and import capability to serve its future load reliably under normal operating conditions," but "many transmission lines and transformers were found overloaded under Category B and Category C contingency conditions."²³⁸

However, that analysis relied on power plants on the Peninsula and in the City that may not be on line during the time frame modeled.

PG&E has completed transformer upgrades at the Martin Substation and a 115 kV cable upgrade from Martin into the City. The utility has plans for various cable reconductoring, upgrades and switch upgrades scheduled for 2010-2012 that would expand Peninsula and City transmission capacity and reliability.²³⁹

The TransBay Cable Project will make a significant difference to the reliability and cost of electricity in San Francisco. The project is a 59-mile underwater HVDC merchant transmission line (shown in Figure 5-12) that will carry power from PG&E's Pittsburg substation to a converter station in San Francisco. Project construction began in 2007, cable-laying under the San Francisco Bay will begin in fall 2009, and the project is expected to be

Figure 5-12. TransBay Cable Route



Source: Trans Bay Cable. "The TBC Project," at <http://www.transbaycable.com/>.

²³⁸ CAISO (2009b). *2009 California ISO Transmission Plan*, p. 111.

²³⁹ California (CAISO) (2008c). *2008 California ISO Transmission Plan—A Long-Term Assessment of the California ISO's Controlled Grid (2008-2017)*, at <http://www.caiso.com/1f52/1f52d6d93a3e0.pdf>; and CAISO (2009b), *2009 California ISO Transmission Plan*, pp. 43, 130, 153.

energized and begin commercial operations in 2010. Once the cable is operational, it will bring an additional 400 MW of electricity into the city through an alternate route that does not pass through San Jose or the Peninsula, reducing San Francisco's reliance on in-city fossil generation.²⁴⁰

The CAISO is currently studying the generation and transmission system serving the Greater Bay Area for the period after completion of the TransBay Cable. This analysis, slated for release in the fall of 2009, is examining demand-side opportunities, generation, including retirement and/or continued operation of plants located within the City, as well as additional transmission projects.²⁴¹

5.5.3. Conclusion for San Francisco Peninsula

As noted in the discussion above of Southern California, energy development within California remains a complex and challenging process. Supply expansion and demand modification projects alike can experience delays due to cost, regulatory, environmental and litigation causes. A combination of supply and demand relief are likely to be needed to reduce congestion and maintain reliability on the San Francisco Peninsula, but only a few of the needed measures are making substantive progress over the near term. Until there is a clearer picture of how and when all the needed supply and demand-side elements will materialize and improve conditions on the San Francisco Peninsula, the Department will continue to identify the San Francisco Peninsula as a Congestion Area of Concern.

5.6. Seattle-Portland Congestion Area of Concern

The 2006 Congestion Study identified the area from south of Seattle to Portland as a congested area with both reliability and economic implications. This problem reflected both high loading in winter and summer and increasing wind generation to the east, combined with significantly increased generation in the area between the two cities.

5.6.1. Changes in Load

Load in the entire Pacific Northwest region increased by 3.9% from 2006 to 2008, at an average annual growth rate of 1.9%. In Puget Sound Energy's service territory, peak load increased 1.2% from 4,847 MW in 2006 to 4,906 MW in 2008. Portland General Electric's peak load increased by 0.5% per year, from 3,706 MW in 2006 to 3,743 in 2008.²⁴² Overall, the Northwest Power and Conservation Council (NPCC) forecasts continuing growth in residential and commercial sector demand, with 1.7% annual average winter demand growth in Oregon and Washington between 2010 and 2020.²⁴³ At the same time, summer demand, driven by air conditioning loads in new construction, is growing more than 2% per year and may overtake winter peak demand in the not too distant future.

Washington and Oregon are recognized for the high quality of their energy efficiency programs. The ACEEE ranked Oregon second and Washington sixth among the 50 states in the "2008 State Energy Efficiency Scorecard,"²⁴⁴ and cites those

²⁴⁰Trans Bay Cable. "The TBC Project," at <http://www.transbaycable.com/>.

²⁴¹CAISO (2009a). *2010 ISO Transmission Plan, Final Study Plan*.

²⁴²Portland General Electric (2008). *Form 8-K (Current Report Filing): Filed 09/17/08 for the Period Ending 09/16/08.*, at <http://investors.portlandgeneral.com/secfiling.cfm?filingID=1193125-08-196887>, slide 7; Portland General Electric (2007). *Form 8-K (Current Report Filing): Filed 5/31/2007 for Period Ending 5/25/2007*, at <http://investors.portlandgeneral.com/secfiling.cfm?filingID=784977-07-54>, slide 7; Open Access Technology International, Inc. (OATI) (2008). "PSEI Portion of the westTrans OASIS." *Peak Load Data December 2008*, at <http://www.oatioasis.com/psei/>; and Puget Sound Energy (2008). "2007 Form 10-K Annual Report - Part 1," at <http://www.secinfo.com/d113uv.t9.htm#2c3q>.

²⁴³Northwest Power & Conservation Council (NPCC) (2009a). "Appendix C: Preliminary Draft Demand Forecast." *Northwest Sixth Power Plan*. Council Document 2009-04, at <http://www.nwcouncil.org/library/2009/2009-04.pdf>.

²⁴⁴Eldridge, M., et al. (2008) *The 2008 State Energy Efficiency Scorecard*, ACEEE Report Number E086, at http://www.aceee.org/pubs/e086_es.pdf, p. 4.

states' efficiency performance and programs as exemplary for the high level of funding and utility incentives.²⁴⁵ The Pacific Northwest continued to deliver sustained energy efficiency savings, reducing electricity use by 200 MW in 2007 (about half the typical annual electricity demand growth for the region). The NPPC reports that the region has cumulatively reduced peak load by 3,700 MW since 1978.²⁴⁶ Despite these programs, electricity demand continues to grow.

The impact of these efficiency programs on congestion in the Seattle-Portland corridor is complex and sometimes counter-intuitive. For example, under some conditions, reducing demand in the Seattle area frees up generation that could flow south as far as California—if not obstructed by the transmission constraints between Seattle and Portland—thus increasing the congestion in the area.

5.6.2. Changes in Generation, Transmission and Operations

Nearly 1000 MW of gas-fired, combined cycle generation has been added between Seattle and Portland over the past few years, complicating congestion management in the area.²⁴⁷ Additional new generation has been developed in Oregon and Washington over the past three years, chiefly new wind assets.

No major transmission assets (greater than 230 kV) were placed in service in the Seattle-Portland region between 2005 and 2008, although a number of significant projects were completed in the broader Pacific Northwest region in the years just prior to 2005.

The Bonneville Power Administration (BPA) has developed several operational and institutional

measures that reduce transmission congestion to some degree:

- BPA is using a new redispatch plan to relieve congestion at specific flowgates by using voluntary changes in generation in lieu of curtailments. This pilot program began in 2008 and is now underway at 10 congested flowgates with a wider community of participating generators.²⁴⁸
- Improved wind monitoring and production forecasting methods are helping BPA improve its wind generation forecasts.²⁴⁹
- Western utilities are working to develop sub-hourly power supply and transmission schedules, to deal with in-hour variations in load and generation.
- In May 2009, BPA began offering conditional-firm transmission service, which allows customers to obtain long-term access to BPA wires with the risk of curtailments during occasional network reliability events. This is consistent with FERC Order 890, which required transmission owners to offer conditional firm service to improve transmission access for intermittent generators. Conditional firm service will increase grid utilization by a new group and class of generators, but by design, it should not increase congestion—it is to use available capacity in periods when there is no congestion.²⁵⁰

The Pacific Northwest utilities, working together through the ColumbiaGrid and Northern Tier Transmission Group planning processes, have proposed a number of major transmission projects that could have significant or possible benefit on transmission congestion and reliability in the Seattle to Portland area; these projects include the I-5 Corridor Reinforcement, the Canada-Pacific Northwest

²⁴⁵ Kushler, M., D. York and P. White (2009). *Meeting Aggressive New State Goals for Utility Sector Energy Efficiency: Examining Key Factors Associated with High Savings*. ACEEE Report Number U091, at <http://www.aceee.org/pubs/U091.pdf>, p.111.

²⁴⁶ NPCC (2008). "Northwest energy conservation hit all-time high in 2007." NPCC press release, at <http://www.nwcouncil.org/library/releases/2008/0514.htm>.

²⁴⁷ NPCC (2009b). "Generating Project Development Activity," at <http://www.nwcouncil.org/energy/powersupply/Default.htm>.

²⁴⁸ Bonneville Power Administration (2008a). "2008-2009 Reliability Redispatch Pilot and Curtailment Calculator Prototype, July 2008 through September 2009." "Congestion Management Update," at http://www.transmission.bpa.gov/customer_forums/Congestion_Management/docs/July10_RRP_CCP_Update.pdf.


²⁴⁹ BPA (2009a). "How BPA supports wind power in the Pacific Northwest," at http://www.bpa.gov/corporate/pubs/fact_sheets/09fs/BPA_supports_wind_power_for_the_Pacific_Northwest_-_Mar_2009.pdf.

²⁵⁰ BPA (2009b). "New BPA transmission product helps customers move power, including wind energy." *BPA News*, at <http://www.piersystem.com/go/doc/1582/269425>.

to California project, the West Coast Cable, the West of McNary Reinforcement, and the Southern Crossing and Northern Lights projects.²⁵¹ These are shown in Figure 5-13 below. Although only the I-5 Corridor Reinforcement project directly increases capacity between the two cities, the other projects would affect the area because they would provide alternate paths (parallel capacity) to move power now flowing on the congested lines.

The transmission project that will have the most immediate impact on this area is the proposed I-5 Corridor Reinforcement Project, which would construct a new 500-kV substation about 100 miles south of Seattle and a new 500 kV yard at a substation near Portland, and build a new 500 kV, 70-mile transmission line between them to increase path capacity by about 1,300 MW. This project would relieve congestion along the existing transmission path and enable BPA to serve point-to-point

Figure 5-13. Major Regional Transmission Projects Proposed in the Pacific Northwest

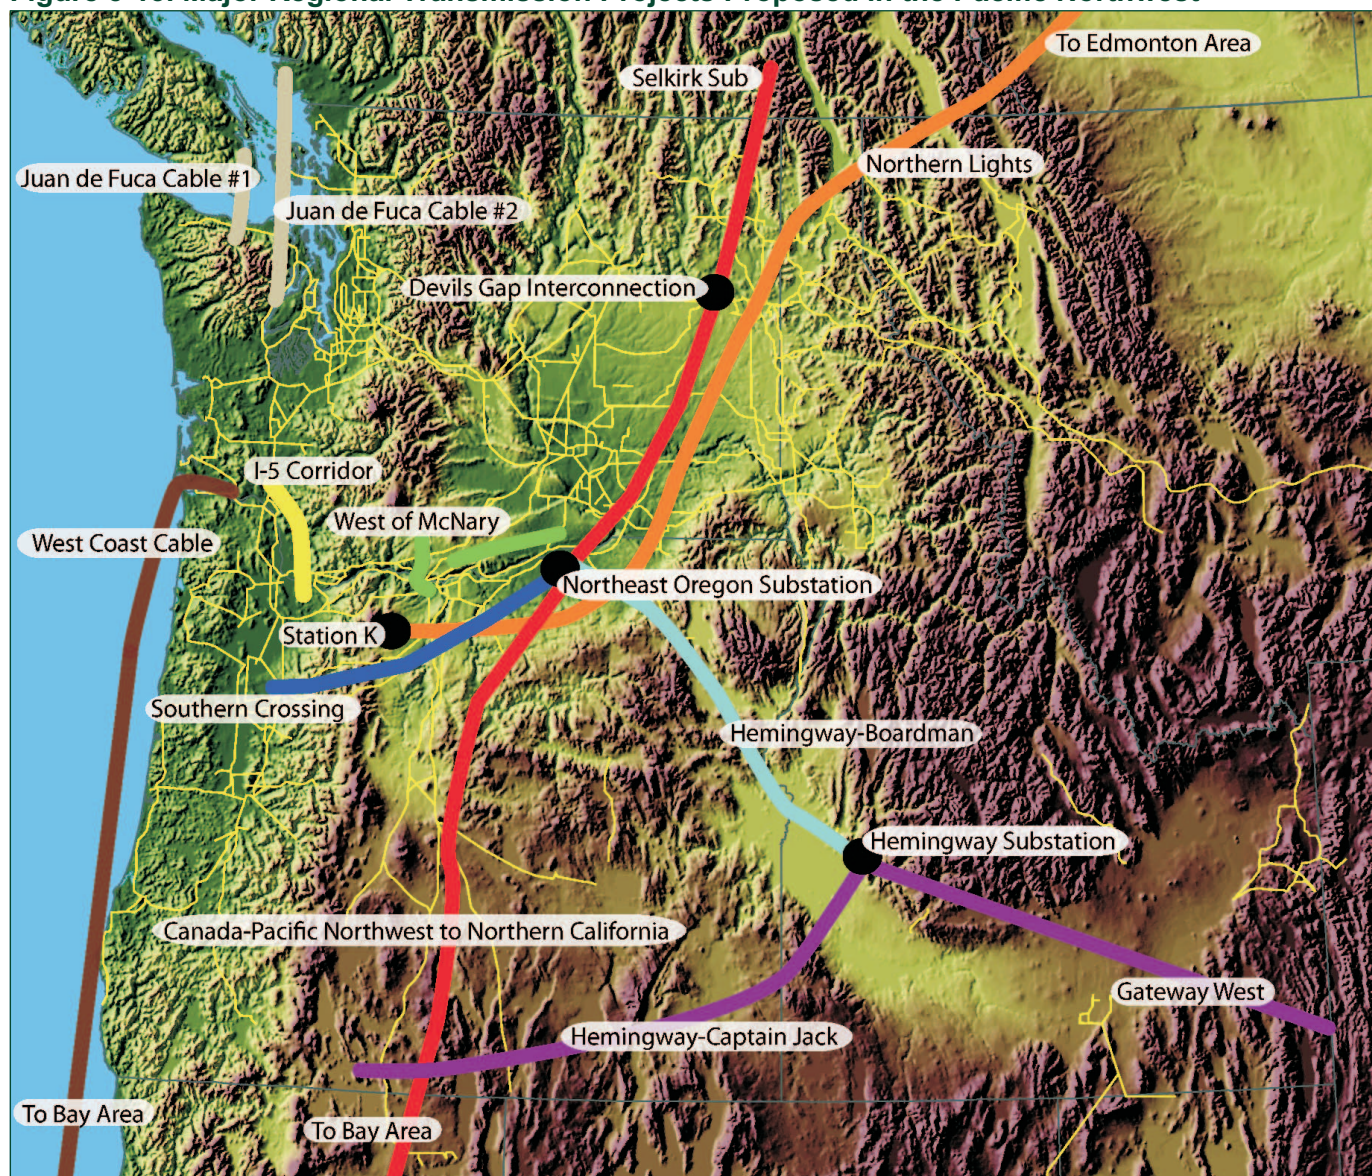

Source: ColumbiaGrid (2009a). *2009 Biennial Transmission Expansion Plan*, at <http://www.columbiagrid.org/biennial-transmission-overview.cfm>, Figure 5-a, p. 19.

²⁵¹ ColumbiaGrid (2009a). *2009 Biennial Transmission Expansion Plan*, at <http://www.columbiagrid.org/biennial-transmission-overview.cfm>, p. 21.

transmission requests along this path (including requests from gas-fired generators). It would enable firm transmission service to 1,500 MW of new generation being planned along the Corridor, help Portland General Electric maintain reliable service with

improved voltage stability to growing loads, and let BPA avoid potential load curtailments in the Portland area.²⁵² This is primarily a summer problem, when there are high transfers from Canada and the Northwest to California. However, this project is not expected to come on line before 2014 or 2015.

To the east, there is a growing problem with congestion in the Columbia River Gorge, where there is more wind generation planned in eastern Washington and Oregon than the existing transmission system to the west can accommodate. Over 2,400 MW of wind has already been installed in eastern Oregon and Washington, and another 7,300 MW of wind generation projects are lined up in transmission queues in those states (with another 12,000 MW built or proposed in Idaho, Montana and Wyoming).²⁵³ This generation is either already developed or in transmission queues for interconnection east of the Cascades Mountains and intended to serve loads on the west coast. At least three new transmission projects have been proposed by BPA and Portland General Electric to serve this new wind generation and deliver it to Portland and the western interties (to move south to California); when completed, these lines will relieve the present modest additional loading due to loop flow from wind on the current transmission facilities connecting Portland and Seattle. Over a longer term, however, continued build-out of wind generation in the region is likely to re-introduce loop flow from the generation resources into this area.

5.6.3. Conclusion for Seattle-Portland Area

Completion of all the above projects would probably solve most of the problems that led the

Department in 2006 to identify the area between Seattle and Portland as a Congestion Area of Concern. Completion, however, is several years away. Accordingly, the Department will continue to identify the area as a Congestion Area of Concern.

5.7. Phoenix-Tucson Congestion Area of Concern

The 2006 Congestion Study identified the Phoenix-Tucson region as an area of concern because this metropolitan region was seeing explosive population and load growth with significant transmission loading and congestion. Arizona Public Service (APS) and the Arizona Corporation Commission noted that Arizona had additional reliability and congestion problems, notably with respect to the Tucson to Nogales corridor linking south central Arizona to generation in Nogales, and the Southwest's still-limited ability to obtain additional bulk generation from resources in Montana and Wyoming.

The Phoenix metropolitan area is served by APS and the Salt River Project, with additional transmission owned by the Western Area Power Administration. The Tucson area is served by Tucson Electric Power (TEP). A majority of the Phoenix area load is served by imports via transmission. The ACC's 2008 Biennial Transmission Assessment (BTA) for 2008-2017 found that for Phoenix, "the projected local generation reserve margin [1,758 MW] exceeds the required reserve margin (865 MW) for those hours during which RMR [reliability must run] conditions exist."²⁵⁴ The 2008 BTA found that a RMR condition may continue to exist through 2016, with peak load (3,010 MW) exceeding the reported simultaneous import limits, and maximum load-serving capacity (3,125 MW)

²⁵² WECC, 2008, "WECC Phase 1 Rating Process Coordinated Planning and Technical Studies," at http://www.oatioasis.com/AVAT/AVATdocs/WECC_Corodinated_PGE_Project.ppt#23; Miller, J. (2008), "Letter to WECC Planning Coordination Committee on I-5 Corridor Reinforcement Project Regional Planning Compliance Report;" and letter from Stephen J. Wright, BPA Administrator and CEO, to Customers, Constituents, tribes and other Stakeholders, February 16, 2009, Attachment C, "Description of 2008 Network Open Season Projects Moving Forward with NEPA I-5 Corridor Reinforcement."

²⁵³ ColumbiaGrid (2009a). *2009 Biennial Transmission Expansion Plan*, at <http://www.columbiagrid.org/biennial-transmission-overview.cfm>, p. 37.

²⁵⁴ Arizona Corporation Commission (2008c). *Fifth Biennial Transmission Assessment 2008-2017*, Docket No. E-00000D-0376," p. 38.

barely exceeding projected peak load.²⁵⁵ Overall, however, these findings indicate that the load pocket concerns that led to the Department's identification of Phoenix-Tucson as a Congestion Area of Concern are on the way to being resolved.

5.7.1. Changes in Load and Demand-Side Resources

Population and electric load have continued to grow in Arizona over the past three years, although moderated from their earlier pace by the current economic recession. Arizona's population grew by over 26% between 2000 and 2008, with Phoenix and Scottsdale growing at 14% and Tucson growing at 6.5% over that period.²⁵⁶ Load in the area is expected to nearly double between 2006 and 2025;²⁵⁷ before the current recession, the utilities expected peak demand to grow at about 3.5% per year.²⁵⁸

As recently as 2008, Arizona's overall energy efficiency efforts were ranked as only middling by efficiency experts, with a report by the ACEEE ranking Arizona 28th among the 50 states for its energy efficiency programs.²⁵⁹ However, the region's utilities are becoming more aggressive in delivering energy efficiency and demand response. Between 2005 and June 2008, APS reports achieving cumulative annual savings of 531,889 MWh from demand-side management programs.²⁶⁰ In a recent rate case settlement, APS agreed to establish energy savings

goals, along with performance incentives, to use energy efficiency to reduce total energy consumed by 1% by 2010 and 1.5% by 2012.²⁶¹ The Environmental Protection Agency has recognized APS as Energy Star Partner of the Year for its successful Energy Star Homes program.²⁶² The Salt River Project announced in April 2009 that it will increase its energy efficiency and load management budget from \$11 million in fiscal year 2008 to \$30 million in 2010 and \$55 million in 2012, with expected energy savings to reach nearly 1% of annual electricity sales by 2011.²⁶³

APS awarded a contract in 2008 to acquire and deliver 800,000 advanced meters to its residential, commercial and industrial customers, to help them better manage their electricity usage.²⁶⁴ APS has hired Comverge to acquire and deliver up to 125 MW of "virtual peaking capacity" (peak demand response) beginning in 2010 for 15 years, primarily from commercial and industrial customers.²⁶⁵ Similarly, Salt River Project has hired EnerNOC to provide up to 50 MW of demand response capacity from commercial, institutional and industrial customers, under a 3-year contract beginning in 2009.²⁶⁶

Arizona's utilities are leaders in solar electric generation. TEP had 6.4 MW of photovoltaic generation on-line by the end of 2007, including a 4.6 MW utility-owned array and 1.2 MW of

²⁵⁵ *Ibid.*, pp. 37-39.

²⁵⁶ U.S. Census Bureau (2009). "State and County Quick Facts: Arizona," at <http://quickfacts.census.gov/qfd/states/04000.html>.

²⁵⁷ Southeast Arizona Transmission Study (SATS) (2008). *Southeast Arizona Transmission Study Report*, at http://www.westconnect.com/filestorage/SATS%20ReportFinal%20Report_120508.pdf, p. 9.

²⁵⁸ Southwest Energy Efficiency Project (SWEET) (2009a). "Arizona Utility Energy Efficiency Programs," at <http://www.swenergy.org/programs/arizona/utility.htm>.

²⁵⁹ Eldridge, M., et al. (2008) *The 2008 State Energy Efficiency Scorecard*, ACEEE Report Number E086, at http://www.aceee.org/pubs/e086_es.pdf, p. 4.

²⁶⁰ Arizona Public Service Company (APS) (2009a). *Arizona Public Service Company's Comments on Investigation of Regulatory and Rate Incentives for Gas and Electric Utilities*. Docket Nos. E-00000J-08-0314 & G-00000C-08-0314, at <http://images.edocket.azcc.gov/docketpdf/0000093901.pdf>, p. 2.

²⁶¹ Southwest Energy Efficiency Project (SWEET) (2009d). "Settlement Reached in APS Rate Case, Will Expand Energy Efficiency Programs," at <http://www.swenergy.org/news/index.html#2009-05-01>.

²⁶² Arizona Public Service Company (APS) (2009b). "APS Earns National Energy Star Partner of the Year Award for Third Consecutive Year," at http://www.aps.com/main/news/releases/release_516.html.

²⁶³ Southwest Energy Efficiency Project (SWEET) (2009a). "Arizona Utility Announces Plans for Expanding Energy Efficiency Programs."

²⁶⁴ Metering International (2008). "Arizona Public Service contracts with Elster for 800,000 smart meters." *Metering.com*, at <http://www.metering.com/node/12858>.

²⁶⁵ CleanTech Group (2008). "Comverge in Arizona demand response contract." *CleanTech Group*. September 17, 2008, at <http://cleantech.com/news/3454/comverge-arizona-demand-response-contract>.

²⁶⁶ Business Wire (2009b). "EnerNOC Signs 50 MW Contract with Salt River Project." *Business Wire*, at <http://www.pr-inside.com/enernoc-signs-50-megawatt-contract-with-r999276.htm>.

customer-owned rooftop PV owned by hundreds of TEP customers, with assistance from the SunShare and GreenWatts incentive programs.²⁶⁷ In 2007, 8.1 MW of photovoltaic cells and modules were shipped to Arizona customers,²⁶⁸ encouraged by generous state and utility tax exemption, net metering and incentive payment policies.²⁶⁹ By the end of 2007, Arizona had 18.9 MW of cumulative installed photovoltaic capacity statewide;²⁷⁰ these numbers are probably increasing, given the state's solar-friendly policies.

The cumulative effect of these and similar energy efficiency, demand response, and distributed generation measures indicate that the utilities, policy-makers and communities of the Phoenix-Tucson area are now working to manage and limit loads through customer-oriented, non-wires solutions.

5.7.2. Changes in Generation and Transmission

For years a primary focus of western transmission planning efforts was to increase transfer capability from Arizona westward into Southern California; recently, with many of those westbound solutions planned or in development, the focus has shifted to solving the growing in-state reliability-related congestion problems.

Arizona utilities and regulators have engaged in the BTA process for a decade. The BTA is a rigorous, well-organized planning process looking out over a 10-year horizon at resource and transmission adequacy for the near- and longer-term. It has been open to stakeholders and members of the public for several years, working closely with regional partners from the transmission and generation communities. Over this period, the ACC has granted permit

approval to numerous high-voltage transmission projects, many of which are now beginning or completing construction (Figure 5-14).

Plans for transmission upgrades, expansions and new projects include reinforcements within and between the metropolitan areas, new construction to open up rich in-state wind and solar resource areas, and projects outbound to Southern California to strengthen exports from and through Arizona.

Arizona utilities are also working with neighbors and merchant transmission developers to develop several interstate lines to the northeast and northwest to increase imports from Wyoming and Montana; the latter are shown in Figure 5-15.

Table 5-6 lists the major transmission projects now under development that will affect transmission congestion in and around the Phoenix-Tucson area. This list is notable for the large scale and number of the projects included, and the fact that most have completed the study phase and have advanced to siting and permitting or construction. The chair of the ACC states that over the past 10 years, Arizona has approved 700 miles of high-voltage lines, denying only 3 out of 143 line applications.²⁷¹

It is possible that not every transmission line in this list will proceed through planning to construction to service. Arizona's new Renewable Energy Standard requires 15% of the state's total electricity consumption to come from renewable resources by 2025, with 30% of that amount to be generated from distributed sources such as rooftop solar installations.²⁷² This change in future generation patterns and effective load could reduce the need for and economics of long-distance transmission imports, as SCE recently discovered with the Devers-Palo Verde 2 project.

²⁶⁷ Tucson Electric Power (TEP) (2008). "TEP Ranked among Top 10 Solar Electric Utilities in United States." Tucson Electric Power Press release, at <http://www.tucsonelectric.com/Company/News/PressReleases/ReleaseTemplate.asp?idRec=295>.

²⁶⁸ Energy Information Administration (EIA) (2007b). "Table 3.10: Shipments of Photovoltaic Cells and Modules by Destination, 2006 and 2007." *Solar Photovoltaic Cell/Module Manufacturing Activities, 2007*, at http://www.eia.doe.gov/cneaf/solar.renewables/page/solarreport/table3_10.pdf.

²⁶⁹ DSIRE. Arizona Incentives for Renewable Energy, at <http://www.dsireusa.org/library/includes/map2.cfm?CurrentPageID=1&State=AZ&RE=1&EE=0>.

²⁷⁰ Sherwood, L. (2008). *U.S. Solar Market Trends 2007*, at http://www.irecusa.org/fileadmin/user_upload/NationalOutreachDocs/SolarTrendsReports/IREC_Solar_Market_Trends_Revision_11_19_08-1.pdf, Appendix C.

²⁷¹ Edwards, J. (2009). "Edison Calls Off Pursuit of Devers-Palo Verde No. 2 Line." *California Energy Markets*, p. 15.

²⁷² *Business Wire* (2009a). "APS Pilot Envisions Interconnected Solar Rooftops." *Business Wire*, at http://www.businesswire.com/portal/site/google/?ndmViewId=news_view&newsId=20090511005274&newsLang=en.

5.7.3. Conclusions for the Phoenix-Tucson Area


The ACC concluded in its order approving the Fifth Biennial Assessment that “The existing and planned transmission systems serving the Phoenix, Santa Cruz County, Tucson and Yuma areas are adequate and should reliably meet the local energy needs of the respective areas through 2017.”²⁷³ The Department agrees with this conclusion and no longer identifies the Phoenix-Tucson area as a Congestion Area of Concern.

Although not all of the transmission and demand-side projects that will resolve current congestion problems have been completed, several factors support this decision:

- The region’s new transmission projects are reaching out to many new generation sources— both in terms of geography and fuel sources— that will enhance redundancy and reliability for the area.
- The recent history of transmission development in Arizona indicates that projects developed through the BTA are approved by the ACC and built on schedule with limited complications or uncertainty due to permitting, routing or cost recovery. It is likely that most of these projects will become operational by their scheduled dates.

The Department will continue monitoring the status of transmission congestion in the Phoenix and Tucson region and the status of the items discussed above.

Figure 5-14. Planned Extra High Voltage Transmission Facilities for the Phoenix and Tucson Area

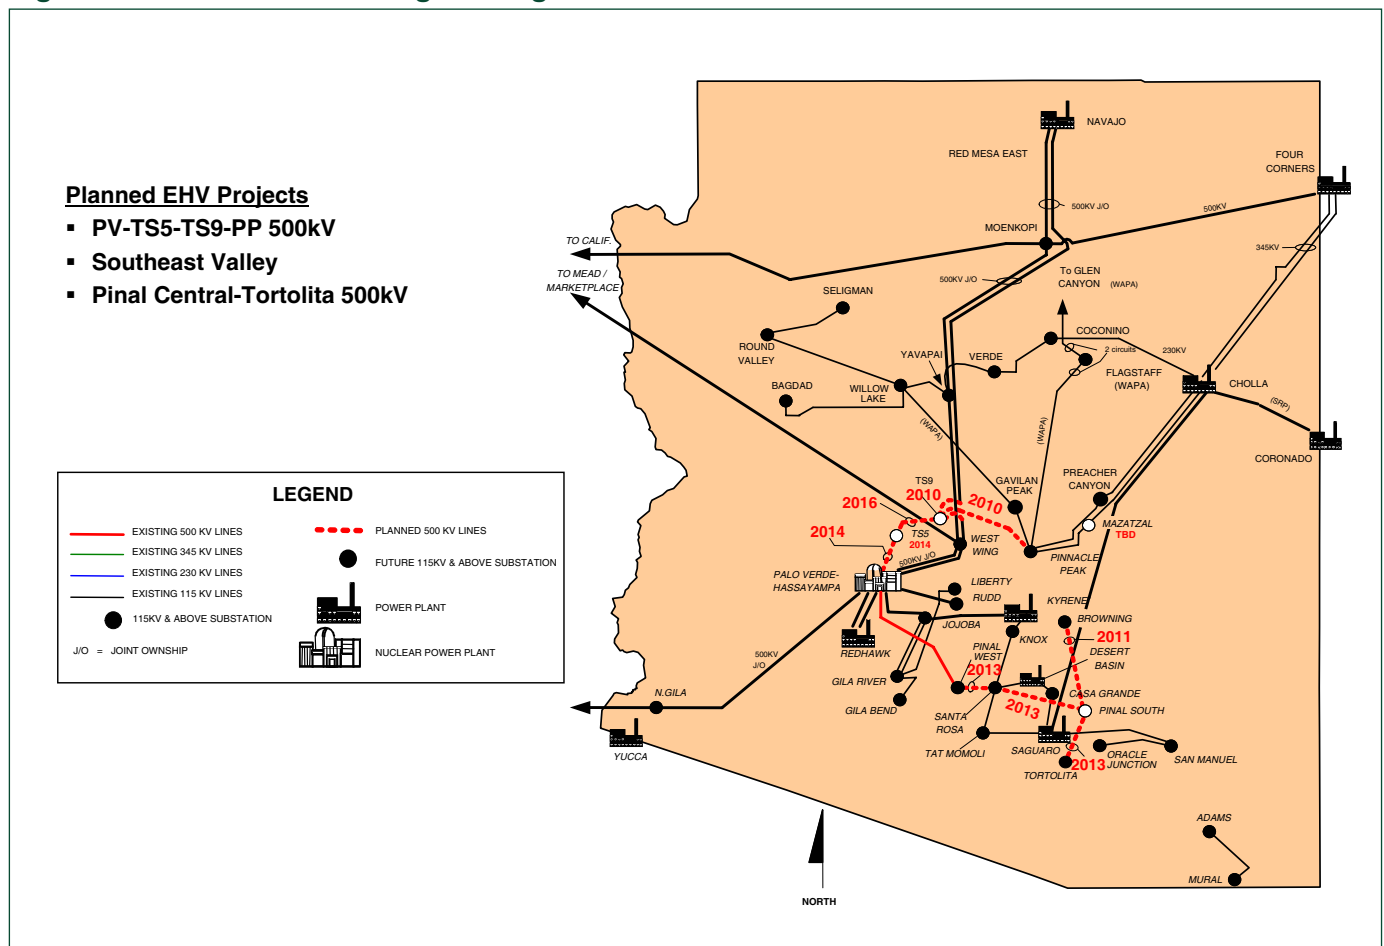

Source: Smith, B. (Arizona Public Service Company) (2009). “Color Commentary for WestConnect Paths.” Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm>, slide 8.

²⁷³ Arizona Corporation Commission (ACC) (2008b). “Decision No. 70635” Docket No. E-00000D-07-0376, at <http://images.edocket.azcc.gov/docketpdf/0000091783.pdf>, p. 2.

5.8. 2009 Western Congestion Areas

The sections above review the western congestion areas identified in the 2006 National Congestion Study and determine that all but one continue to merit identification as Congestion Areas in 2009. Figure 5-16 shows the Southern California Critical Congestion Area and the Seattle-Portland and San Francisco Congestion Areas of Concern for 2009.


The current TEPPC analysis identifies several other major transmission paths that were highly congested in 2006 and remain highly congested today:

- Bridger West (Path 19)
- Montana to Northwest (Path 8)

- Southwest of Four Corners (Path 22)
- Four Corners 345/500 kV Transformer (Path 23)
- Pacific AC Intertie (California-Oregon Interface, Path 66)
- Pacific DC Intertie (Path 65)
- TOT 2C (Utah-Nevada, Path 35)
- West of Borah (Path 17)
- Southern New Mexico (Path 47)
- TOT 2A (Path 31).

ColumbiaGrid analysis has also identified the paths from British Columbia to the Northwest and Northwest to California as interfaces that are regularly congested (whether seasonally or episodically due to high transfers).²⁷⁴

Figure 5-15. Major Transmission Projects Under Study that will Affect Arizona Transmission Congestion

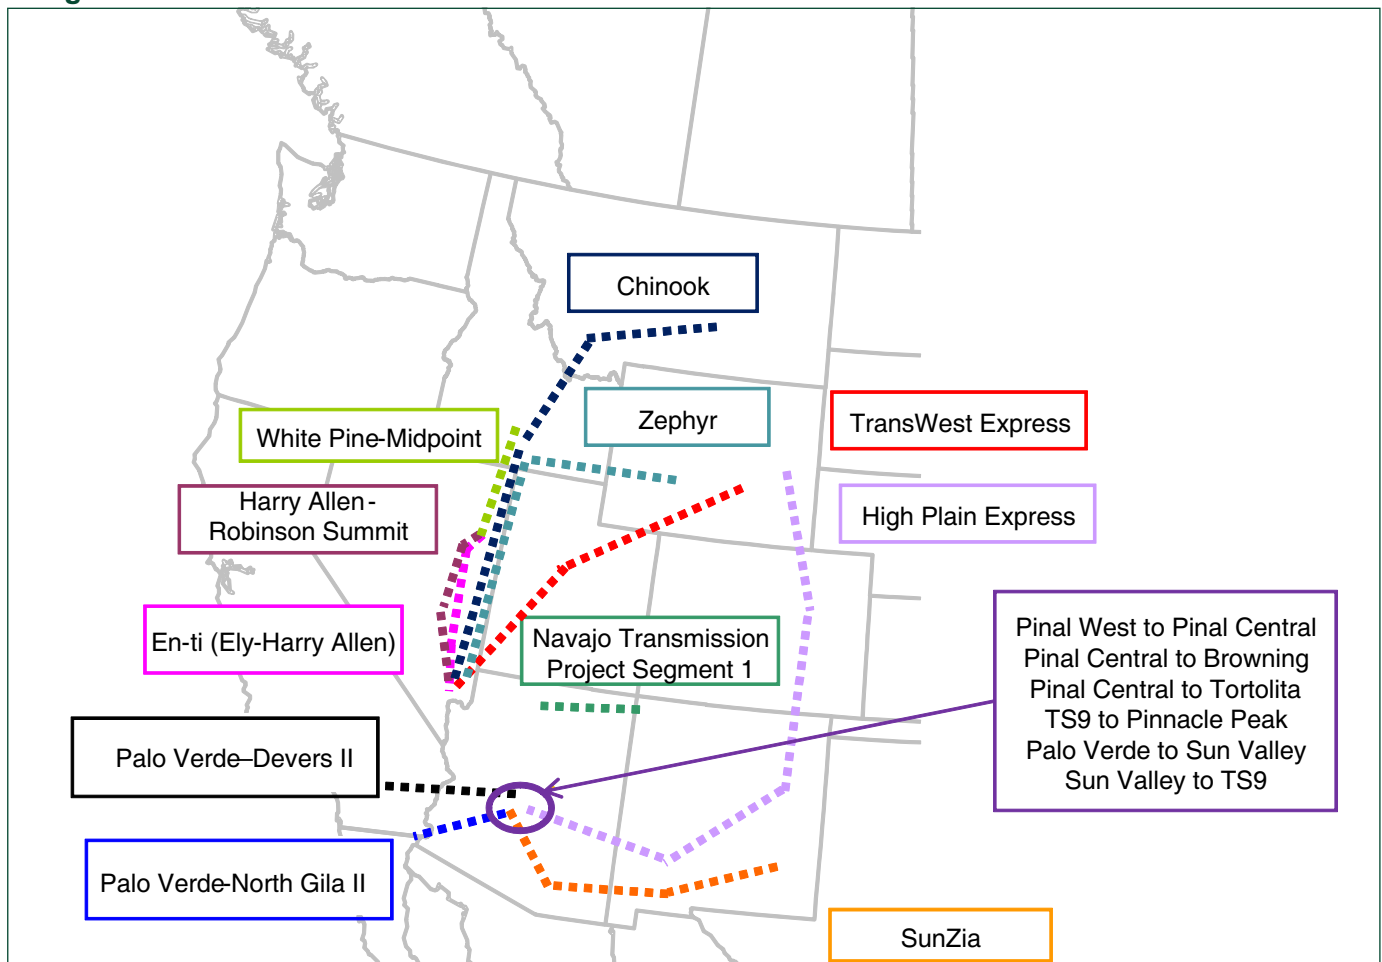

Source: Kondziolka, R. (2009). "Western Interconnection Subregional Planning and Development," Presented at the U.S. DOE Office of Electricity Delivery and Energy Reliability Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study, at <http://congestion09.anl.gov/techws/index.cfm/>, slide 13.


²⁷⁴ ColumbiaGrid (2009a). *2009 Biennial Transmission Expansion Plan*, at <http://www.columbiagrid.org/biennial-transmission-overview.cfm>.

Table 5-6. Status of Major Transmission Projects Affecting Arizona Transmission and Resource Availability

Project Name	Voltage	Capacity	Proposed In-Service	Sponsor	Status
Pinal Central to Browning	500 kV	1400 MW	2011 - 2nd Qtr	SRP	In Design & Material/ROW Acquisition
Pinal West to Pinal Central	500 kV	1400 MW	2013 - 2nd Qtr	SRP	In Design & ROW Acquisition
Palo Verde to TS5 (Sun Valley)	500 kV	650 MW	2012 - 2nd Qtr	APS	In Design & ROW Acquisition
TS5 (Sun Valley) to TS9	500 kV	1200 MW	2014 - 2nd Qtr	APS	Siting & Permitting Completed
TS9 (Raceway) to Pinnacle Peak	500 kV	1000 MW	2010 - 2nd Qtr	APS	In Construction
Arizona Gateway South (Double Circuit)	345 kV	2000 MW	2011	TEP	In Siting & Permitting
Navajo Transmission Project	500 kV	1500 MW	2011	DPA	In Path Rating Study Process
Palo Verde to North Gila II	500 kV	1250 MW	2012 - 2nd Qtr	APS	In Design & ROW Acquisition
Palo Verde to Devers II	500 kV	1200 MW	2011 - 4th Qtr	SCE	In Siting & Permitting
TransWest Express (Bi-Pole DC)	500 kV	3000 MW	2015	Anschutz	In Path Rating Process
Chinook and Zephyr (Bi-Pole DC)	500 kV	6000 MW	2015	TransCan	In Siting & Permitting
Pinal Central to Tortolita	500 kV	1200 MW	2013 - 2nd Qtr	TEP	In Siting & Permitting
Eastern Nevada Transmission Intertie	500 kV	2000 MW	2011 - 4th Qtr	NVEnergy	In Siting & Permitting & Path Rating
Great Basin Energy Project	500 kV	1650 MW	2012 - 4th Qtr	LS Power	In Siting & Permitting & Path Rating
Eastern Plains Transmission Project	500 kV	1700 MW	2011	TriState	In Siting & Permitting
SunZia Southwest Trans Project (2 Circuits)	500 kV	3000 MW	2013	SW Power	In Path Rating Process
High Plains Express Initiative (2 Circuits)	500 kV	3500 MW	2016-2017	Xcel	Feasibility Studies

Source: Kondziolka, R. (2009). "Western Interconnection Subregional Planning and Development," slide 14.

Figure 5-16. Western Interconnection Congestion Areas, 2009

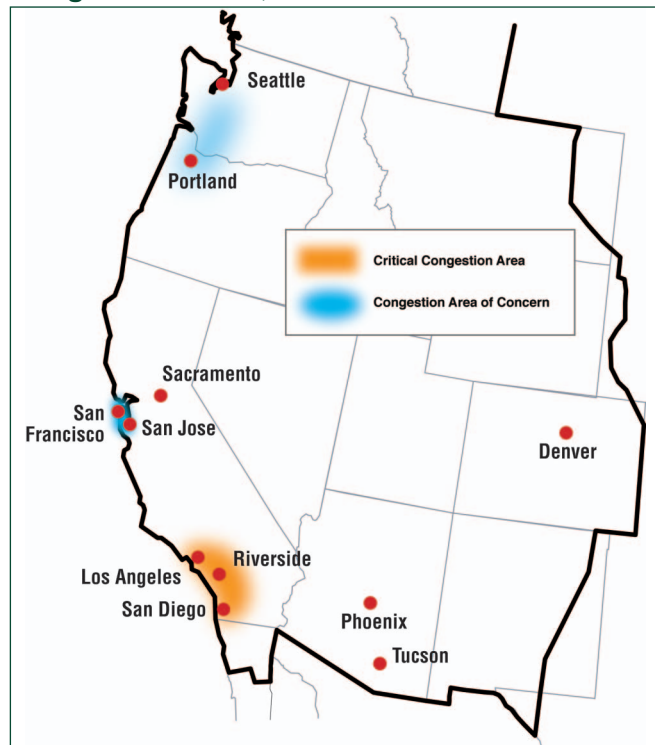

This study recognizes the importance of these lines to the reliability and delivered cost of electricity in the western bulk power system. However, the Department has decided not to identify the areas affected by these constraints formally as congestion areas at this time for the following reasons:

- Several of these paths serve either the Phoenix-Tucson area and/or the Southern California corridor (TOT2C, Four Corners transformer, Southwest of Four Corners, and the Pacific DC Intertie), so they have been implicitly addressed in the discussion above of those two recognized congestion areas.
- Similarly, congestion on the Pacific AC Intertie, British Columbia to the Northwest, and Northwest to California will be affected by actions taken to relieve congestion in the Seattle-Portland area as well as by other proposed transmission projects.

As noted above, a wealth of new transmission is being considered for development in the Western

Interconnection. This new transmission will affect future western congestion patterns, as will efforts to develop new renewable resources to meet state renewable portfolio requirements and increased energy efficiency to meet resource and carbon emissions management goals. The Department will

continue monitoring these developments, and the paths and congestion areas identified above, to determine whether levels of congestion and usage are becoming better or worse as load, generation and transmission infrastructure change over time.

6. Public Comments, Next Steps Regarding Transmission Planning, and Achieving Transmission Adequacy

This chapter provides information about how to file comments on this study, discusses future work by DOE and others that may affect the Congestion Areas and the Conditional Constraint Areas, and provides DOE's perspective concerning achieving adequate transmission capacity.

6.1. Request for Comments on This Study

The Department invites public comments on this study. Comments may address any aspect of the study's methods and findings. Comments will be particularly useful if they address the following questions concerning improvements for this or future congestion studies:

1. Did this study accurately identify appropriate areas as Critical Congestion Areas, Congestion Areas of Concern, and Conditional Constraint Areas? Are there additional areas that should have been so identified?
2. How should the methods and approach for analyzing historical and future congestion on the grid be improved?
3. Are there better ways to define, identify, and measure congestion, the impacts of congestion, and transmission constraints?

Comment Period and Addresses for Filing Comments

The comment period for this study will be for 60 days, beginning with the day a notice of the availability of the study for public comment is published in the *Federal Register*. As soon as the closing date has been determined, the Department will post the closing date on its Congestion Study web site, congestion09@anl.gov. Comments must be submitted in writing to the Department no later than 5:00 p.m. EST on the closing date, if possible by e-mail to congestion09@anl.gov.

Comments may also be submitted by conventional mail to this address:

Comments on DOE 2009 Transmission
Congestion Study
c/o Adriana Kocornik-Mina
Office of Electricity Delivery and Energy
Reliability (OE)
U.S. Department of Energy
1000 Independence Avenue SW
Washington DC 20585

All comments received will be made publicly available on the website DOE has created for this study, www.congestion09.anl.gov. The Department will consider all comments received and take them into account in making decisions based in part on the findings of this study.

6.2. Next Steps Regarding Transmission Analysis and Planning

Several important activities and analyses are pending or already under way that are likely to show more clearly where the case for building additional transmission capacity is especially strong. The Department will provide funds for this work under the Recovery Act. These activities and analyses include:

1. *Stronger and more inclusive regional and inter-connection-level transmission analysis and planning.* The Department believes that analytic entities in each of the Nation's interconnections should develop a broad portfolio of possible electricity supply futures and identify their associated transmission requirements. These analyses should address, for example, the extent to which energy efficiency programs can reduce or forestall the need for additional transmission capacity, as well as the merits of developing high-potential renewables in remote areas vs.

the merits of developing other renewable resources closer to load centers.

After these analyses have been developed and made available for public review, transmission experts from the electricity industry, the states, federal agencies, and other stakeholder groups are expected to collaborate in the development of interconnection-level transmission plans. Thus, to the extent feasible these plans will identify a coherent core set of transmission projects regarded by a diverse group of experts as needed under a wide range of futures.

2. *Designation by states of geographic zones with concentrated, high-quality renewable resource potential*, or other physical attributes especially relevant to reducing overall carbon emissions at reasonable cost. See, for example, *Western Renewable Energy Zones—Phase 1 Report*,²⁷⁵ which identifies renewable resource “hubs.” These hubs are the approximate centers of high-value resources areas that have also been screened to avoid park lands, wilderness areas, wetlands, military lands, steeply sloped areas, etc. DOE has announced that it seeks proposals from eastern state-based organizations to undertake similar analyses in the eastern United States. Identification of zones of particular interest for the development of additional low-carbon electric generating capacity will be valuable as input to the long-term planning processes described in the preceding paragraph.
3. *Regional or sub-regional renewable integration studies*. The output from wind and solar generation sources is inherently variable, at least over shorter periods of time. Therefore, in a given region, transmission planners must determine how higher levels of renewable generation could be used in combination with other generation sources, demand-side resources, and storage facilities while maintaining grid reliability. Completion of these integration studies,

along with careful transmission planning, is essential to enable planners to make informed decisions about how to integrate large amounts of new generation effectively and economically.

6.3. Achieving Adequate Transmission Capacity

Section 409 of the Recovery Act directs the Secretary of Energy to include in this congestion study recommendations for achieving “adequate transmission capacity.”

The obstacles to developing transmission capacity have been widely discussed in recent years. Much of this discussion has focused on problems in key subject areas, such as wide-area transmission analysis and planning, cost allocation, and transmission siting. Several legislative proposals have been put forward recently that address these problems, engendering vigorous debate among the Congress, executive branch agencies, regulatory agencies, the electricity industry, and other stakeholders about how best to go forward.

The Department and the Administration are participating actively in this legislative process. This study, however, is not the most appropriate vehicle for presenting the Administration’s views on these topics. The Administration will do so at appropriate times in other public documents.

Determining what will constitute future transmission “adequacy” is no simple matter. We are entering a period in which it will be technically feasible to drive transmission systems harder and obtain more services from them, without endangering reliability—provided certain critical conditions are met.²⁷⁶

These include:

1. The availability of detailed, near-real-time information about second-to-second changes in the state of the bulk power supply systems.²⁷⁷

²⁷⁵ Western Governors’ Association (WGA) and U.S. Department of Energy (DOE) (2009). “Western Renewable Energy Zones – Phase 1 Report,” at <http://www.westgov.org/wga/initiatives/wrez/>.

²⁷⁶ For an early but prescient analysis of these concerns, see Hauer, J., T. Overbye, J. Dagle and S. Widergren (2002). “Advanced Transmission Technologies,” *National Transmission Grid Study: Issue Papers*, U.S. Department of Energy, at <http://www.oe.energy.gov/transmission.htm>.

²⁷⁷ See *Steps To Establish A Real-Time Transmission Monitoring System For Transmission Owners and Operators Within the Eastern and Western Interconnects. A Report To Congress Pursuant To Section 1839 Of The Energy Policy Act Of 2005* (2006). Prepared by DOE and FERC, at http://www.oe.energy.gov/DocumentsandMedia/final_1839.pdf. See also, for example, North American Synchrophasor Initiative (NASPI), at www.naspi.org.

2. The availability of effective control devices that will respond extremely quickly to correct or avert potentially hazardous operating conditions.²⁷⁸
3. The availability of appropriately trained workforces needed to design, build, operate, and maintain such complex systems.²⁷⁹

Clearly, determining how much transmission capacity we will “need” in a given region by a given date will be affected by the planners’ expectations and assumptions about these and other important conditions. This congestion study is not an appropriate place for a detailed review of these subjects and the next steps to be pursued regarding them. Interested readers should consult the works cited in the footnotes below, and the reports the Department and others will publish in the months to come detailing the results of the initiatives supported under the Recovery Act.

Given the rising importance of electric infrastructure planning, however, there is a clear need to facilitate better and more transparent planning and policy decisions by improving the quality and availability of data concerning the use of existing transmission facilities. More systematic and consistent data are needed on several transmission subjects, such as:

1. The prices and quantities of short- and long-term transactions in wholesale electricity markets.
2. Scheduled and actual flows on the bulk power system. At present, OASIS data are scattered across many websites, are neither edited nor archived, and not presented in a consistent format. Clearer direction from FERC on how such data are to be presented would be very helpful. Special attention is required to depict more clearly the flows across inter-regional seams.
3. The economic value of curtailed transactions.

²⁷⁸See *Title XIII, Smart Grid, Energy Independence and Security Act of 2007*, at http://www.oe.energy.gov/DocumentsandMedia/EISA_Title_XIII_Smart_Grid.pdf. See also, *DOE Office of Electricity Delivery and Energy Reliability, Visualization and Controls Program*, at <https://events.energetics.com/v&c08/agenda.html>.

²⁷⁹See *Workforce Trends In The Electric Utility Industry. A Report To Congress Pursuant To Section 1101 Of The Energy Policy Act Of 2005* (2006b). Prepared by DOE, at http://www.oe.energy.gov/DocumentsandMedia/Workforce_Trends_Report_090706_FINAL.pdf. See also, *U.S. Power and Energy Engineering Workforce Collaborative*, at <http://www.ieee-pes.org/workforce/workforce-collaborative>.

Glossary

Ancillary services: Services necessary to support the transmission of electric energy from resources to loads, while maintaining reliable operation of the transmission system. Examples include spinning reserve, supplemental reserve, reactive power, regulation and frequency response, and electricity demand and supply in balance.

Available flowgate capacity: The total potential throughput of combinations of electrically related transmission elements along a defined path, subject to reliability requirements.

Available transfer capability (ATC): A measure of the transfer capability remaining in the physical transmission network for further commercial activity over and above already committed uses. It is defined as Total Transfer Capability less existing transmission commitments (including retail customer service), less a Capacity Benefit Margin, less a Transmission Reliability Margin.

Binding hours: Those hours when a transmission element is operating at its maximum operating safe limit; as a congestion metric, the % of time annually that the element is loaded to its limit.

Binding hours shadow price: A congestion metric that equals the average value of the shadow prices in those hours when a transmission element operates at its limit; the shadow price equals zero when the element is below its limit.

Biomass: In the context of electric energy, any organic material that is converted to electricity, including wood, cane, grass, farm, manure, and sewage.

Bulk power system: All electric generating plants, transmission lines and equipment.

CAISO: California Independent System Operator, serving most of the state of California.

Congestion: The condition that occurs when transmission capacity in a specific location is not

sufficient to enable safe delivery of all scheduled or desired wholesale electricity transfers simultaneously.

Congestion rent: As used in this report, congestion rent equals the shadow price per MWh times the MWh flowing through a transmission element, summed over all the hours when that element is operating at its maximum (binding) limit.

Constrained facility: A transmission facility (line, transformer, breaker, etc.) that is loaded near, at, or beyond its system operating limit (SOL) or interconnection reliability operating limit (IROL).

Contingency: An unexpected failure or outage of a system component, such as a generator, transmission line, circuit breaker, switch or other electrical element.

Control area: A geographic and electrical area managed by a transmission or integrated utility, ISO or RTO, the manager of which is responsible for ensuring a continuous real-time balance of electrical supply and demand.

Curtailement: A reduction in service made necessary because all demand cannot be served safely.

Demand: The physical rate at which electric energy is delivered to or by a system or part of a system, generally expressed in kilowatts or megawatts, at a given instant or averaged over any designated interval of time; also, the total amount of electricity customers' use at a given moment, including line losses during delivery.

Demand response: Demand response programs are used to reduce consumers' use of electricity during times of peak demand, with incentives to curtail electricity demand and reduce load during targeted times in response to price signals or incentives indicating system reliability or market conditions.

Demand-side management: Activities or programs undertaken by a retail electricity provider,

utility, energy service company to influence the amount or timing of electricity used by customers.

Dispatch: The injection of a generator's output onto the transmission grid by an authorized scheduling utility, or the activity of managing the production of electricity and transmission of it across the grid.

Distributed generation: Small-scale electric generation that feeds into the distribution grid, rather than the bulk transmission grid, whether on the utility side of the meter or on the customer side.

EIA: Energy Information Administration, an organization within the U.S. Department of Energy.

Element: An electrical device with terminals that may be connected to other electrical devices, such as generators, transformers, circuit breakers, bus sections, or transmission lines; an element may be comprised of one or more components.

Energy: A capacity for doing work; electrical energy is measured in watt-hours (kilowatt-hours, megawatt-hours or gigawatt-hours).

Energy efficiency: Refers to programs that are aimed at reducing the energy used by specific end-use devices and systems, typically without affecting the services provided. These programs reduce overall electricity consumption (reported in megawatt-hours), often without explicit consideration for the timing of program-induced savings. Such savings are generally achieved by substituting technically more advanced equipment to produce the same level of end-use services (e.g. lighting, heating, motor drive) with less electricity. Examples include high-efficiency appliances, efficient lighting programs, high-efficiency heating, ventilating and air conditioning (HVAC) systems or control modifications, efficient building design, advanced electric motor drives, and heat recovery systems.

ERCOT: Electric Reliability Council of Texas, an ISO serving 80% of Texas' load.

Facility rating: The maximum or minimum voltage, current, frequency, or real or reactive power flow through a facility that does not violate the applicable equipment rating of any equipment comprising the facility.

Flowgate: An individual or a group of transmission facilities (e.g., transmission lines, transformers) that are known or anticipated to be limiting elements in providing transmission service. This term is used principally in the Eastern Interconnection.

Generation: The process of transforming existing stored energy into electricity; also, an amount of electric energy produced, expressed in kilowatt-hours (kWh) or megawatt-hours (MWh).

Interconnection: When capitalized, any one of the five alternating current (AC) electric system networks in North America (Eastern, Western, ERCOT, Quebec, and Alaska).

ISO: Independent System Operator, an independent, federally regulated entity that coordinates regional transmission in a non-discriminatory manner and ensures the safety and reliability of the electric system within its footprint and in coordination with neighboring entities.

ISO-NE: Independent System Operator for New England, covering the states of Maine, Vermont, New Hampshire, Connecticut, Rhode Island and Massachusetts.

Limiting element: An electrical element that is either 1) operating at its appropriate maximum rating, or 2) would operate at its maximum rating given a limiting contingency; a limiting element establishes a system limit.

LMP: Locational Marginal Price, a method for pricing wholesale power based on actual grid conditions. The LMP at a specific point on the grid reflects the full cost of supplying the next MWh of electricity at that location, including the marginal cost of generating the electricity, the cost of delivering it across the grid, and the value of energy lost in delivery. Differences at a given time in LMPs at different locations reflect the impact of transmission congestion—LMPs at two points will be the same when the congestion they face is the same, but diverge if transmission congestion obstructs delivery of less expensive energy to one of them, raising LMP in the constrained area by the cost of the congestion.

Load: An end-use device (or a customer operating such device) that receives power from the electric system.

Load flow model: A detailed model, also referred to as a power flow model, that represents the interdependencies of energy flow along different paths in the system.

Load pocket: A load center (such as a large metropolitan area) that has limited local generation relative to the size of the load, and must import much of its electricity via transmission from neighboring areas.

Loop flow: The unscheduled use of transmission as electricity moves across the grid on multiple lines (following paths of least resistance).

MISO: The Midwest ISO, the Regional Transmission Operator serving all or portions of Arkansas, Illinois, Indiana, Iowa, Kentucky, Minnesota, Montana, Nebraska, North Dakota, Ohio, Pennsylvania, South Dakota, Virginia, Wisconsin, and West Virginia.

MMWG: NERC's Multi-regional Modeling Working Group, which develops a dataset of information about grid elements (power plants and transmission facilities) and their ratings for use in regional reliability modeling.

Nodal price: See LMP.

Node: A node is used in simulation modeling to represent an aggregation of significant amounts of electrical demand and/or supply, to simplify the modeling calculations (relative to modeling each power plant or load center individually). Each Interconnection is broken down into a set of nodes connected to each other by transmission paths.

Nomogram: A graphic representation that depicts operating relationships between generation, load, voltage, or system stability in a defined network. On lines where the relationship between variables does not change, a nomogram can be represented simply as a single transmission interface limit; in many areas, the nomogram indicates that an increase in transfers into an area across one line will require a decrease in flows on another line.

NYISO: New York Independent System Operator, serving New York State.

Operating transfer capability (OTC): The amount of power that can be transferred in a reliable manner, meeting all NERC contingency requirements, considering the current or projected operational state of the system. OTC is sometimes referred to as TTC, or Total Transfer Capability.

Outage: A period of time during which a generating unit, transmission line, or other facility is out of service.

Peak demand: Maximum electric load during a specified period of time.

PJM: The RTO serving parts or all of the states of Delaware, Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia, West Virginia and the District of Columbia.

Rating: The safe operational limits of a transmission system element under a set of specified conditions.

Redispatch: When transmission constraints or reliability requirements indicate that specific levels of generation across a set of power plants cannot be maintained reliably, the grid operator redispatches (changes the dispatch or operating instructions) for one or more power plants (increasing generation on one side of the constraint and reducing generation on the other side) to restore a safe operational pattern across the grid.

Reliability: Electric system reliability has two components—adequacy and security. Adequacy is the ability of the electric system to supply customers' aggregate electric demand and energy requirements at all times, taking account scheduled and unscheduled outages of system facilities. Security is the ability of the electric system to withstand sudden disturbances, such as electric short circuits or unanticipated loss of system facilities. The degree of reliability can be measured by the frequency, duration and magnitude of adverse effects on electricity delivery to customers.

Renewable resources: Flow-limited resources that can be replenished through natural processes. They are assumed to be virtually inexhaustible over long periods of time but limited in the amount of energy that is available per unit of time. Some (such as geothermal and biomass) may be stock-limited in that stocks can be depleted by use, but on a time scale of decades or perhaps centuries, they can probably be replenished. Renewable energy resources include: biomass, hydro, geothermal, solar, wind, ocean thermal, tidal, and wave energy.

RTO: Regional Transmission Operator, an independent, federally regulated entity that coordinates regional transmission in a non-discriminatory manner and ensures the safety and reliability of the electric system.

Seams: The interface between regional entities and/or markets at which material external impacts may occur. The regional entities' actions may have reliability, market interface, and/or commercial impacts (some or all).

Shadow price: The shadow price equals the value of the change in all affected generation if one more MWh could flow across a constrained facility then loaded to its maximum limit; the marginal cost of generation redispatch required to obey the transmission constraint.

Spot market: A market characterized by short-term (e.g., hourly and daily) contracts for specified volumes of a given commodity.

SPP: The Southwest Power Pool, serving portions of Arkansas, Kansas, Louisiana, Missouri, New Mexico, Oklahoma, and Texas.

Stability: The ability of an electric system to maintain a state of equilibrium during normal and abnormal conditions or disturbances.

Stability limit: The maximum power flow possible through some particular point in the system while maintaining stability in the entire system or the part of the system to which the stability limit refers.

System: A combination of generation, transmission, and distribution components.

System operating limit: The value (such as MW, MVar, amperes, frequency, or volts) that satisfies the most limiting of the prescribed operating criteria for a specified system configuration to ensure operation within acceptable reliability criteria. System operating limits (SOLs) are based upon certain operating criteria. These include, but are not limited to, pre- and post-contingency ratings for facilities, transient stability, voltage stability, and system voltage.

System operator: An individual or entity at a control center for a balancing authority (BA), transmission operator (TO), generator operator (GO), or reliability coordinator (RC), whose responsibility it is to monitor and control that electric system in real time.

Thermal rating: The maximum amount of electrical current that a transmission line or electrical facility can conduct over a specified time period before it sustains permanent damage by overheating or sags to the point that it violates public safety requirements.

TLR: See entry for "transmission loading relief."

Transfer capability: The measure of the ability of interconnected electric systems to move or transfer power in a reliable manner from one area to another over all transmission lines (or paths) between those areas under specified system conditions. The units of transfer capability are in terms of electric power, generally expressed in megawatts (MW). The transfer capability from area "A" to area "B" is generally *not* equal to the transfer capability from area "B" to area "A."

Transformer: An electrical device for changing the voltage of alternating current.

Transmission: An interconnected group of lines and associated equipment for moving electric energy at high voltage between points of supply and points at which it is delivered to other electric systems or transformed to a lower voltage for delivery to customers.

Transmission constraint: A limitation on one or more transmission elements that may be reached

during normal or contingency system operations. The term “transmission constraint” can refer to a piece of equipment that restricts power flows, to an operational limit imposed to protect reliability, or to a lack of adequate transmission capacity to deliver potential sources of generation without violating reliability requirements.

Transmission loading relief: Procedures developed by NERC to deal with a situation in which a transmission facility or path is at or beyond its safe operating limit. In a TLR event, the grid operator can redispatch generation, reconfigure transmission, or curtail loads to restore the system to secure operating conditions.

Transmission path: A transmission path may consist of one or more parallel transmission elements. The transfer capability of the transmission path is the maximum amount of actual power that can flow over the path without violating reliability criteria. The net scheduled power flow over the transmission path must not exceed the path’s transfer capability or operating nomogram limits at any time, even during periods when the actual flow on the path is less than the path’s transfer capability.

U90: The number of hours or percentage of a year when a transmission path is operated at or above 90% of its safe operating limit.

U75: The number of hours or percentage of a year when a transmission path is operated at or above 75% of its safe operating limit.

Voltage: Voltage is the difference in electrical potential between two points of an electrical network, expressed in volts. The North American grid is operated using alternating current at 120 volts and 60 Hertz frequency.

WECC: Western Electricity Coordinating Council, the reliability coordinator serving the western interconnection.

Wholesale power market: The purchase and sale of electricity from generators to resellers (that sell to retail customers) along with the ancillary services needed to maintain reliability and power quality at the transmission level.

APPENDIXES

Appendix A

List of Entities Submitting Comments to DOE Website as Input to the 2009 National Electric Transmission Congestion Study

Alabama Public Service Commission	North Carolina Utilities Commission
American Wind Energy Association	Northeast Power Coordinating Council, Inc.
Arcuri, Michael A.	Old Dominion Electric Cooperative
Arizona Corporation Commission	PacifiCorp
Arkansas Public Service Commission	Pennsylvania Land Trust Association
California Public Utilities Commission	Pennsylvania Public Utilities Commission/ Department of Environment
Davis, Jr., William E.	Piedmont Environmental Council
eLucem	PSEG Companies
Entergy Services, Inc.	PSEG Services Corporation
Hansen, Amy	Public Service Commission of Wisconsin
Imperial Irrigation District	San Diego Gas and Electric
ISO New England	SERC Reliability Corporation
Kentucky Public Service Commission	Southern California Edison Co.
Maryland Public Service Commission	Southern Company Services, Inc.
Montana Department of Commerce	The Wind Coalition
National Association of Regulatory Utility Commissioners	Utah Governor's Office
New England Conference of Public Utilities Commissioners	Vermont Department of Public Service and Vermont Public Service Board
New Jersey Board of Public Utilities	Virginia, Commonwealth of
New Jersey Highlands Coalition	WIRES
New York State Public Service Commission	

Appendix B

Organizations Participating in Congestion Study Workshops and Workshop Agendas

Alabama Public Service Commission	Connecticut Municipal Electric Energy Cooperative
Allegheny Energy	ConocoPhillips
American Electric Power	Curtis, Goodwin, Sullivan, Udall & Schwab, PLC
American Public Power Association	Day Pitney LLP, for NEPOOL Participants Commission
American Transmission Company	Delaware Public Service Commission
Argonne National Laboratory	Deloitte Consulting
Arizona Corporation Commission	District of Columbia Public Service Commission
Arizona Public Service	DTE Energy
Arkansas Electric Cooperative Association	Duke Energy
Arkansas Public Service Commission	Duquesne Light Company
Balch & Bruhn LLD	E/ip
Bangor Hydro-Electric Company	Ecology & Environment
Basin Electric Power Cooperative	Electric Power Supply Association
Bonneville Power Administration	ELETROBRÁS
Bracy Tucker Brown & Valanzano	Energy Connect
British Columbia Transmission Corporation	Energy East
British Petroleum	EntegraPower Grp
Brookfield Renewable Power	Entergy Services, Inc.
California Department of Water Resources	enXco Development Corp
California Energy Commission	EPIC Merchant Energy
California Public Utilities Commission	Exelon Corporation
CenterPoint Energy	Federal Energy Regulatory Commission
Central Minnesota Municipal Power Agency	FirstEnergy
City of Tallahassee, Florida	Florida Governor's Energy Office
City Water, Light & Power	Florida Power & Light Company
Colorado Public Utilities Commission	Florida Public Service Commission
ColumbiaGrid	Florida Reliability Coordinating Council, Inc.
Commonwealth Edison Company	Flynn Resource Consultants Inc.
Comprehensive Power Solutions	FPL Energy
Con Edison	
Connecticut Department of Public Utility Control	

FUNDRIVE.ORG
 General Electric Wind
 Georgia Public Service Commission
 Georgia Transmission Corporation
 Horizon Wind Energy
 Idaho Power
 Idaho Public Service Commission
 Illinois Commerce Commission
 Imperial Irrigation District
 Inside Washington Publishers
 Invenergy
 Iowa Utilities Board
 Ironbound Capital
 ISO New England
 ITC Holdings
 ITC Transmission
 K.R. Saline, Inc., representing West Connect
 Kansas City Power & Light Co
 Kansas House of Representatives
 Kentucky Department of Energy Development and Independence
 Kentucky Public Service Commission
 La Capra Associates
 Lafayette Utilities System
 Lansing Board of Water & Light
 LS Power Development, LLC
 Madison Gas & Electric Company
 Maine Public Utilities Commission
 MAPPCOR
 Maryland Energy Report
 Maryland Public Service Commission
 Massachusetts Attorney General
 Massachusetts Department of Public Utilities
 Massachusetts Municipal Wholesale Electric Company
 Michigan Public Service Commission
 Midwest ISO
 Minnesota Power
 Minnesota Public Utilities Commission
 Missouri Public Service Commission
 Municipal Electric Authority of Georgia
 National Association of Regulatory Utility Commissioners
 National Grid
 National Rural Electric Cooperative Association
 Nebraska Energy Office
 Nebraska Public Power District
 NERC Interchange Distribution Calculator Working Group
 Nevada Power Company/Sierra Pacific Power Company
 Nevada Public Utilities Commission
 New England Power Generators Association
 New Jersey Board of Public Utilities
 New Mexico Renewable Energy Transmission Authority
 New York City Economic Development Corporation
 New York ISO
 New York State Department of Public Service
 New York State Public Service Commission
 NextLight Renewable Power, LLC
 North American Electric Reliability Corporation
 North Carolina Utilities Commission
 North Dakota Public Service Commission
 Northeast Power Coordinating Council
 Northeast Utilities
 Northern Indiana Public Service Company
 Northern Tier Transmission
 Northwest Power and Conservation Council
 NorthWestern Energy
 NRG Energy
 Ohio Public Utilities Commission
 Oklahoma Attorney General's Office
 Oklahoma Corporation Commission
 Oklahoma Gas/Electric Company
 Old Dominion Electric Cooperative
 Open Access Technology International, Inc.

Oregon Public Utility Commission	Southeastern Electric Reliability Council
Organization of MISO States	Southern California Edison
Organization of PJM States	Southern Company
Pacific Gas & Electric Company	Southwest Power Pool
PacifiCorp	Southwestern Power Administration
Paschall Strategic	State of Utah
Patton Boggs LLP	State Utility Forecasting Group
Pennsylvania Public Utility Commission	Sustainable Energy Strategies
Pepeco Holdings	Tampa Electric
PJM Interconnection, LLC	Tennessee Valley Authority
Platts	Terra-Gen Power, LLC
PNM	Texas CHP Initiative
Progress Energy	The Journal Record
Public Service Commission of South Carolina	The Wilderness Society
Public Service Commission of Wisconsin	TRC Solutions
Public Service Electric & Gas	Tucson Electric Power Company
Public Service Enterprise Group	U.S. Department of Homeland Security
RBC Energy Services, LP	U.S. National Grid
RBS-Sempra Commodities	U.S. Senate
RES Americas Inc	Usinternetworking
Richmond Montessori School	Ventyx
Sacramento Municipal Utility District	Vermont Department of Public Service
Salt River Project	Vermont Public Service Board
San Diego Gas and Electric Company	Virginia State Corporation Commission
Science Applications International Corporation	West Virginia Public Service Commission
Sea Breeze Pacific Regional Transmission System	Western Area Power Administration
Shell Energy	Western Electricity Coordinating Council
Signal Hill Consulting (representing Hydro Quebec Energy Services United States)	Western Grid Group
Silicon Valley Power	Western Interstate Energy Board
South Carolina Public Service Commission	Western Resource Advocates
South Dakota Public Utility Commission	Wisconsin Public Service Corporation
South Mississippi Electric Power Association	Xcel Energy



**U.S. Department of Energy
Transmission Congestion Study Workshop
Hyatt Regency San Francisco
San Francisco, California
June 11, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre_2009_Congestion_Study_San_Francisco.pdf

8:00 – 9:00 am Registration

9:00 – 9:20 am DOE Presentation
Plans for the 2009 Congestion Study and Objectives of Workshop

9:20 – 10:30 am Panel I

Panelists:

Dave Areghini, Associate General Manager, Power, Construction & Engineering Services, Salt River Project

Tom Carr, Attorney and Economist, Western Interstate Energy Board

The Honorable Dian Grueneich, Commissioner, California Public Utilities Commission

The Honorable Kristin Mayes, Commissioner, Arizona Corporation Commission

Jeff Miller, Vice President & Manager of Planning, ColumbiaGrid

John Roukema, Assistant Director, Silicon Valley Power

10:30 – 10:45 am Break

10:45 – 12:00 pm Panel II

Panelists:

Wally Gibson, Manager, System Analysis & Generation, Northwest Power and Conservation Council

Ravi Aggarwal, Electrical Engineer, Bonneville Power Administration

Dana Cabbell, Manager, Transmission & Distribution, Southern California Edison

Kurt Granat, Business Development Consultant, PacifiCorp

Tom Darin, Staff Attorney, Energy Transmission, Western Resource Advocates

Jonathan Stahlhut, Transmission Planning Engineer, Arizona Public Service

12:00 – 12:30 pm Comments from other attendees

12:30 pm Adjourn



**U.S. Department of Energy
Transmission Congestion Study Workshop
Skirvin Hilton Hotel
Oklahoma City, Oklahoma
June 18, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre_2009_Congestion_Study_Oklahoma_City.pdf

- 12:00 – 1:00 pm Registration**
- 1:00 – 1:05 pm Welcome**
The Honorable Bob Anthony, Commissioner
Oklahoma Corporation Commission
- 1:05 – 1:15 pm DOE Presentation:** Plans for the 2009 Congestion Study and Objectives of
Workshop
- 1:15 – 2:30 pm Panel I**
- Panelists:**
The Honorable Tom Sloan, Representative, 45th District, Kansas House of Representatives
The Honorable Susan Wefald, President, North Dakota Public Service Commission
The Honorable Lauren Azar, Commissioner, Public Service Commission of Wisconsin
Sandy Hochstetter, Vice President, Arkansas Electric Cooperative Corporation
Mike Proctor, Chief Utility Economist, Missouri Public Service Commission
- 2:30 – 2:45 pm Break**
- 2:45 – 4:00 pm Panel II**
- Panelists:**
Jay Caspary, Director of Engineering, Southwest Power Pool
Jennifer Curran, Director, Transmission Infrastructure Strategy, Midwest ISO
Dan Klempel, Manager, Transmission Compliance, Basin Electric Power Cooperative
Greg Peiper, Director, Transmission Systems Operations Center, Xcel Energy
Manny Rahman, Manager, Transmission Interstate Planning, AEP
- 4:00 – 4:30 pm Comments from other attendees**
- 4:30 pm Adjourn**



**U.S. Department of Energy
Transmission Congestion Study Workshop
Hartford Marriott Downtown Hotel
Hartford, Connecticut
July 9, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre2009_Congestion_Study_Hartford.pdf

8:00 – 9:00 am Registration

9:00 – 9:15 am DOE Presentation
Plans for the 2009 Congestion Study and Objectives of Workshop

9:15 – 10:30 am Panel I

Panelists:

The Honorable Garry Brown, Chairman, New York State Public Service Commission
The Honorable Donald Downes, Chairman, Connecticut Department of Public Utility Control
Phil Fedora, Assistant Vice President, Reliability Services, Northeast Power Coordinating Council, Inc.
Lisa Fink, Senior Staff Attorney, Maine Public Utilities Commission
Tom Simpson, Vice President, Energy, New York City Economic Development Corporation
John Keene, Counsel, Division of Regional and Federal Affairs, Massachusetts Department of Public Utilities

10:30 – 10:45 am Break

10:45 – 12:00 pm Panel II

Panelists:

Laurie Alyswoth, Vice President Transmission Projects Engineering and Maintenance, Northeast Utilities
John Buechler, Executive Regulatory Policy Advisor, New York Independent System Operator
Brian Forshaw, Director of Energy Markets, Connecticut Municipal Electric Energy Cooperative
Angela O'Connor, President, New England Power Generators Association
Steve Rourke, Vice President, System Planning, Independent System Operator of New England
Mary Ellen Paravalos, Vice President, Transmission Regulation and Commercial, National Grid

12:00 – 12:30 pm Comments from other attendees

12:30 pm Adjourn



**U.S. Department of Energy
Transmission Congestion Study Workshop
Westin Peachtree Plaza Hotel
Atlanta, Georgia
July 29, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre_2009_Congestion_Study_Atlanta.pdf

8:00 – 9:00 am Registration

9:00 – 9:15 am DOE Presentation
Plans for the 2009 Congestion Study and Objectives of Workshop

9:15 – 10:30 am Panel I

Panelists:

Cindy Miller, Senior Attorney, Office of General Counsel, Florida Public Service Commission

The Honorable Jim Sullivan, President, Alabama Public Service Commission

Charles Terreni, Executive Director, South Carolina Public Service Commission

Burl D. Till, III, Manager, Transmission Planning Department, Tennessee Valley Authority

The Honorable Stan Wise, Commissioner, Georgia Public Service Commission

10:30 – 10:45 am Break

10:45 – 12:00 pm Panel II

Panelists:

George Bartlett, Director, Transmission Planning and Operations, Entergy Services

Nathan Brown, Chief Operating Officer, South Mississippi Electric Power Association

Ed Ernst, Director, Transmission Planning, Duke Energy

Terry Huval, Director, Lafayette Utilities System

Ron Carlsen, Project Manager, Senior Vice President, Planning and Policy, Transmission, Southern Company

Jennifer Vosburg, Director, Regulatory and Government Affairs, NRG Energy, Inc. South Central Region

12:00 – 12:30 pm Comments from other attendees

12:30 pm Adjourn



**U.S. Department of Energy
Transmission Congestion Study Workshop
Atomic Testing Museum
Las Vegas, Nevada
August 6, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre_2009_Congestion_Study_LasVegas.pdf

8:00 – 9:00 am Registration

9:00 – 9:15 am DOE Presentation: Plans for the 2009 Congestion Study and Objectives of Workshop

9:15 – 10:30 am Panel I

Panelists:

Dave Shelton, Transmission Business Unit, Western Area Power Administration

Lisa Szot, Executive Director, New Mexico Renewable Energy Transmission Authority

The Honorable Rebecca Wagner, Commissioner, Nevada Public Utilities Commission

Lou Ann Westerfield, Director of Policy, Idaho Public Service Commission

10:30 – 10:45 am Break

10:45 – 12:00 pm Panel II

Panelists:

David Barajas, General Superintendent, System Planning, Imperial Irrigation District

Jim Filippi, Director of Transmission, NextLight Renewable Power and Co-Chair, TEPPC Technical Advisory Subcommittee

Laura Manz, Director, FERC and CAISO Regulatory Affairs, San Diego Gas & Electric Company

Jerry Smith, K.R. Saline, Inc., representing West Connect

Brian Whalen, Manager of Transmission Planning for Nevada Power and Sierra Pacific Power Company

12:00 – 12:30 pm Comments from other attendees

12:30 pm Adjourn



**U.S. Department of Energy
Transmission Congestion Study Workshop
Wyndham Chicago Hotel
Chicago, Illinois
September 17, 2008**

AGENDA

Transcript available:

http://www.congestion09.anl.gov/documents/docs/Transcript_Pre_2009_Congestion_Study_Chicago.pdf

7:30 – 8:30 am Registration

8:30 – 8:45 am DOE Presentation
Plans for the 2009 Congestion Study and Objectives of Workshop

8:45 – 10:00 am Panel I

Panelists:

Honorable Fred Butler, Commissioner, New Jersey Board of Public Utilities
Dan Cleverdon, Technical Advisor, Public Service Commission of the District of Columbia
Honorable Sherman Elliott, Commissioner, Illinois Commerce Commission
Michael J. Kormos, Senior Vice President-Operations, PJM Interconnection
Honorable Douglas Nazarian, Chairman, Maryland Public Service Commission

10:00 – 10:15 am Break

10:15 – 11:30 am Panel II

Panelists:

Lisa Barton, Vice President of Transmission Strategy and Business Development, American Electric Power
James Haney, Vice President, Transmission, Allegheny Power
Paul Napoli, Director, Transmission Business Strategy, Public Service Electric & Gas Company
Steve Naumann, Vice President, Wholesale Market Development, Government & Environmental Affairs and Public Policy, Exelon Corporation
Ed Tatum, Vice President, Transmission, Old Dominion Electric Cooperative

11:30 – 12:00 pm Comments from other attendees

12:00 pm Adjourn



Spring 2009 Technical Workshop in Support of U.S. Department of Energy 2009 Congestion Study

Webcast, transcript, and presentations available at: <http://www.congestion09.anl.gov/techws/index.cfm/>

*Crowne Plaza Chicago O'Hare Hotel & Conference Center
March 25-26, 2009*

Agenda

Day 1 – Wednesday, March 25, 2009

- 9:00 a.m. Registration Check-In & Continental Breakfast
- 10:00 a.m. **DOE Welcome/Purpose of Workshop**
- David Meyer**, *Senior Policy Advisor, Office of Electricity Delivery and Energy Reliability, U.S. Department of Energy (DOE-OE)*
- 10:15 a.m. **Session 1 – Historic Congestion in the Western Interconnection**
- The Western Electric Coordinating Council Transmission Expansion Planning and Policy Committee has conducted an analysis of historic congestion in the Western Interconnection. This panel will present TEPPC's findings, discuss the metrics used to assess congestion, and review the implications of the findings with sub-regional transmission experts.
- Speakers:
- Wally Gibson**, *Manager, System Analysis and Generation, Northwest Power and Conservation Council, and Co-Chair, Transmission Expansion Policy and Planning Committee, Western Electric Coordinating Council*
- Dean Perry**, *Consultant, Western Electricity Coordinating Council*
- Kurt Granat**, *Principal Transmission Planning Consultant, PacifiCorp*
- Bob Smith**, *Director, Energy Delivery Asset Management and Planning, Arizona Public Service*
- Moderator: **Joe Eto**, *Staff Scientist, Lawrence Berkeley National Laboratory*
- 12:00 p.m. Lunch – on your own

1:00 p.m. **Session 2 – Historic Congestion in the Eastern Interconnection**

DOE sponsored an analysis of historic congestion in the Eastern Interconnection based on a combination of OASIS and IDC data, and LMP data for the centrally-organized markets. This panel will present the finding from this work and hear the views of eastern transmission experts about interpretation of the study findings.

Speakers:

Jagjit Singh, *VP/Director, Open Access Technology International, Inc.*
Farrokh Rahimi, *VP/Director, Open Access Technology International, Inc.*
Jim Busbin, *Supervisor, Bulk Power, Southern Company Transmission, and Chair, North American Electric Reliability Corporation Interchange Distribution Calculator Working Group*
Mike Walsh, *Senior Director—UDS, EMS, Compliance, and Training, Midwest ISO*
Steve Herling, *Vice President, Planning, PJM Interconnection, LLC*

Moderator: **Joe Eto**, *Staff Scientist, Lawrence Berkeley National Laboratory*

3:00 p.m. Break

3:15 p.m. **Session 3 – Studies of Future Congestion in the Western Interconnection**

WECC TEPPC has recently completed forward-looking studies of congestion in the Western Interconnection. This panel will discuss the process through which these studies were prepared, the findings from the most recent round of studies, the relationship between TEPPC and sub-regional transmission planning processes, and the linkage between TEPPC and longer-range regional resource and transmission planning processes.

Speakers:

Scott Cauchois, *Co-Chair, Transmission Expansion Policy and Planning Committee, and Board Member, Western Electricity Coordinating Council*
Brad Nickell, *Renewable Integration & Planning Director, Western Electricity Coordinating Council*
Rob Kondziolka, *Manager, Transmission Planning, Salt River Project*
Doug Larson, *Executive Director, Western Interstate Energy Board*

Moderator: **John Schnagl**, *Director, Transmission Adequacy, DOE-OE*

5:00 p.m. Adjourn

Day 2 – Thursday, March 26, 2009

7:30 a.m. Continental Breakfast

8:30 a.m. **Session 4 – Studies of Future Congestion in the Eastern Interconnection**

Pursuant to FERC Order 890, a variety of regional transmission planning activities is emerging in the Eastern Interconnection. This panel will discuss aspects of selected planning activities that are taking place, including recent findings on future congestion, the planning approach, and issues related to coordination among these activities.

Speakers:

John Lawhorn, *Director, Midwest ISO*

John Buechler, *Executive Regulatory Policy Advisor, New York ISO*

Ron Carlsen, *Planning Manager, Southern Company Transmission*

David Till, *Senior Manager, Transmission Planning, Tennessee Valley Authority*

Moderator: **David Meyer**, *Senior Policy Advisor, DOE-OE*

10:30 a.m. Break

10:45 a.m. **Session 5 – Status Report on DOE 2009 Congestion Study**

David Meyer, *Senior Policy Advisor, DOE-OE*

11:30 a.m. Adjourn

Appendix C

Documents and Data Reviewed for the 2009 National Electric Transmission Congestion Study

1. 95th US Congress (1978). *Public Utilities Regulatory Policies Act of 1978 (PURPA)*. Public Law 95-617, 16 U.S.C. 2601 et seq.
2. 109th US Congress (2005). *Energy Policy Act of 2005, Section 1221 (a)*. Public Law 109-58, at [http://thomas.loc.gov/cgi-bin/query/F?c109:6:./temp/~c109rq\\$flq:e1139788](http://thomas.loc.gov/cgi-bin/query/F?c109:6:./temp/~c109rq$flq:e1139788).
3. 110th US Congress (2007). *Energy Independence and Security Act (EISA) of 2007, Title XIII – Smart Grid*. December 19, 2007, at http://www.oe.energy.gov/DocumentsandMedia/EISA_Title_XIII_Smart_Grid.pdf.
4. 111th US Congress (2009). *American Recovery and Reinvestment Act (ARRA) of 2009, Section 409*. January 6, 2009, at http://frwebgate.access.gpo.gov/cgi-bin/getdoc.cgi?dbname=111_cong_bills&docid=f:h1enr.pdf.
5. American Wind Energy Association (AWEA) (2008). *Annual Wind Industry Report, Year Ending 2008*. Washington DC: AWEA, at <http://www.awea.org/publications/reports/AWEA-Annual-Wind-Report-2009.pdf>.
6. Arizona Corporation Commission (ACC) (2007). *Fourth Biennial Transmission Assessment, 2006-2015*. Docket No. E-00000D-05-0040. Prepared by ACC Staff and KEMA, Inc., January 30, 2007, at http://www.cc.state.az.us/divisions/utilities/electric/BTA%202006%20Final%20Report%20_07-Jan-30_.pdf.
7. _____ (2008a). “2008-2017 Biennial Transmission Assessment Workshop II.” Docket No. E-00000D-07-0376. September 18, 2008, at <http://www.cc.state.az.us/Divisions/Utilities/Electric/Biennial/2008%20BTA/BTA%20Workshop%20II%20Presentation%209-18-2008.ppt>.
8. _____ (2008b). “Decision No. 70635.” Docket No. E-00000D-07-0376. Phoenix, AZ: ACC. December 11, 2008, at <http://images.edocket.azcc.gov/docketpdf/0000091783.pdf>.
9. _____ (2008c). *Fifth Biennial Transmission Assessment 2008-2017*. Prepared by ACC Staff and K.R. Saline & Associates, PLC. October 15, 2008.
10. _____ (2008d). *Renewable Energy Standard & Tariff*, at <http://www.azcc.gov/divisions/utilities/electric/environmental.asp>.
11. Arizona Department of Commerce (2008). *State Agency Annual Energy Usage Report FY08*. Phoenix, AZ: Arizona Department of Commerce, at <http://www.azcommerce.com/doclib/energy/2008%20state%20agency%20annual%20energy%20usage%20final%20rt%20%20sept%2030%202008.pdf>.
12. Arizona Public Service Company (APS) (2009a). *Arizona Public Service Company’s Comments on Investigation of Regulatory and Rate Incentives for Gas and Electric Utilities*. Docket Nos. E-00000J-08-0314 & G-00000C-08-0314. February 20, 2009, at <http://images.edocket.azcc.gov/docketpdf/0000093901.pdf>.
13. _____ (2009b). “APS Earns National Energy Star Partner of the Year Award for Third Consecutive Year.” April 2, 2009, at http://www.aps.com/main/news/releases/release_516.html.
14. Bacon, R. (2009). “Second Forward Capacity Auction (FCA #2): Results Summary.” Presented at ISO-NE PAC Meeting. January 21, 2009, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/pac/mtrls/2009/jan212009/fca2_results.pdf.

15. Bartridge, J., J. Grau, M. Hesters, D. Kondoleon and C. Najarian (2007). *2007 Strategic Transmission Investment Plan*. California Energy Commission, Engineering Office. CEC-700-2007-018CMF, at <http://www.energy.ca.gov/2007publications/CEC-700-2007-018/CEC-700-2007-018-CMF.PDF>.
16. Beck, R. W. (2009). *Distributed Renewable Energy Operating Impacts and Valuation Study*. Prepared for Arizona Public Service. Phoenix, AZ: R.W. Beck, Inc. January 2009, at http://www.aps.com/_files/solarRenewable/DistRenEnOpImpactsStudy.pdf.
17. Beveridge & Diamond, P.C. (2009). “Cost-Benefit Analysis in Regulations for Cooling Water Intake Structures Upheld.” April 7, 2009, at <http://www.bdlaw.com/news-536.html>.
18. Bird, L., D. Hurlbut, P. Donohoo, K. Cory and C. Kreycik (2009). *An Examination of the Regional Supply and Demand Balance for Renewable Electricity in the United States through 2015*. Technical Report NREL/TP-6A2-45041. Golden, CO: National Renewable Energy Laboratory. March 2009, at <http://www.nrel.gov/docs/fy09osti/45041.pdf>.
19. Blair, N. (no date). “Concentrating Solar Deployment Systems (CSDS) – A New Model for Estimating U.S. Concentrating Solar Power Potential.” Golden, CO: National Renewable Energy Laboratory, at http://www1.eere.energy.gov/solar/review_meeting/pdfs/p_55_blair_nrel.pdf.
20. Bonneville Power Administration (BPA) (2006a). *Challenge for the Northwest: Protecting and Managing an Increasingly Congested Transmission System (White Paper)*. Portland, OR: BPA. April 2006, at http://www.bpa.gov/corporate/pubs/Congestion_White_Paper_April06.pdf.
21. _____ (2006b). *Conservation Resource Energy Data: The RED Book, Fiscal Year 2005*. Portland, OR: BPA.
22. _____ (2006c). *2006 Pacific Northwest Loads & Resources Study: Operating Years 2007 through 2016 (2006 White Book)*. Portland, OR: BPA. March 2006, at <http://www.bpa.gov/power/pgp/whitebook/2006/>.
23. _____ (2007a). *Conservation Resource Energy Data: The RED Book, Fiscal Year 2006*. Portland, OR: BPA, at http://www.bpa.gov/Energy/N/reports/publications/pdf/fy06_red_book.pdf.
24. _____ (2007b). *2007 Pacific Northwest Loads & Resources Study: Operating Years 2008 through 2017 (2007 White Book)*. Portland, OR: BPA. March 2007, at <http://www.bpa.gov/power/pgp/whitebook/whitebook.shtml>.
25. _____ (2008a). “2008-2009 Reliability Redispatch Pilot and Curtailment Calculator Prototype, July 2008 through September 2009.” *Congestion Management Update*. Portland, OR: BPA. July 10, 2008, at http://www.transmission.bpa.gov/customer_forums/Congestion_Management/docs/July10_RRP_CCP_Update.pdf.
26. _____ (2008b). *Conservation Resource Energy Data: The RED Book, Fiscal Year 2007*. Portland, OR: BPA, at http://www.bpa.gov/energy/n/reports/publications/pdf/RED_Book_FY07.pdf.
27. _____ (2008c). “McNary-John Day Transmission Line Project.” Portland, OR: BPA, at http://www.transmission.bpa.gov/PlanProj/Transmission_Projects/mcnary/documents/map_-_McNary-John_Day_-_October_2008.pdf.
28. _____ (2009a). “How BPA supports wind power in the Pacific Northwest.” Portland, OR: BPA. March 2009, at http://www.bpa.gov/corporate/pubs/fact_sheets/09fs/BPA_supports_wind_power_for_the_Pacific_Northwest_-_Mar_2009.pdf.
29. _____ (2009b). “New BPA transmission product helps customers move power, including wind energy.” *BPA News*. Portland, OR: BPA. April 23, 2009, at <http://www.piersystem.com/go/doc/1582/269425>.
30. Brattle Group (2007). *Quantifying Demand Response Benefits in PJM*. Prepared for PJM and the Mid-Atlantic Distributed Resources Initiative. Cambridge, MA: The Brattle Group. January 2007, at <http://www.pjm.com/~media/committees-groups/task-forces/tf719/20081219-item-03b-brattle-group-report-pjm-dr-benefits.ashx>.
31. Breslin, M. (2008). “New York’s HVDC Line Takes a Step Forward.” *Renewable Energy Transmission*. November 2008, at http://nyri.us/pdfs/News/NYRI_Article-RenewableEnergyMagazine.pdf.

32. Brown, E. and S. Busche (2008). *State of the States 2008: Renewable Energy Development and the Role of Policy*. Technical Report NREL/TP-670-43021. Golden, CO: National Renewable Energy Laboratory. October 2008, at <http://www.nrel.gov/docs/fy09osti/43021.pdf>.
33. Brown, Matthew (2008). "Ill Winds for Montana Wind Power Project as Developer Eyes Different Site in California." September 27, 2007, Associated Press.
34. Buechler J. (2005). "Northeast Coordinated System Plan: 2005." Presented at the Inter-Area Planning Advisory Stakeholder Committee Meeting. June 17, 2005. Albany, NY, at http://www.interiso.com/public/meeting/20050617/20050617_IPSAC_NCSP_2005.pdf.
35. Burgin, A. (2007). "Concerns reignite over Lake Elsinore power project." *The Press-Enterprise*. November 9, 2007, at http://www.pe.com/localnews/inland/stories/PE_News_Local_C_leaps10.3e333f3.html.
36. Business Wire (2009a). "APS Pilot Envisions Interconnected Solar Rooftops." *Business Wire*. May 11, 2009, at http://www.businesswire.com/portal/site/google/?ndmViewId=news_view&newsId=20090511005274&newsLang=en.
37. _____ (2009b). "EnerNOC Signs 50 MW Contract with Salt River Project." *Business Wire*. January 11, 2009, at <http://www.pr-inside.com/enernoc-signs-50-megawatt-contract-with-r999276.htm>.
38. Cabinet Committee on Energy (2006). *Ensuring Delaware's Energy Future: A Response to Executive Order Number 82*. March 8, 2006, at <http://www.delaware-energy.com/Download/Governors%20EO%2082%20Energy%20Report%20-%20Final.pdf>.
39. California Coastal Commission (2009a). "Legislative Report for May 2009." W-28. San Francisco, CA: California Coastal Commission. May 6, 2009, at <http://documents.coastal.ca.gov/reports/2009/5/W28-5-2009.pdf>.
40. _____ (2009b). "Legislative Report for April 2009." W-25. San Francisco, CA: California Coastal Commission. April 8, 2009, at <http://documents.coastal.ca.gov/reports/2009/4/W25-4-2009.pdf>.
41. California Energy Commission (CEC) (2005). *Strategic Transmission Investment Plan: Prepared in Support of the 2005 Integrated Energy Policy Report Proceeding (04-IEP-1K)*. CEC 100-2005-006-CMF. Sacramento, CA: CEC. November 2005, at <http://www.energy.ca.gov/2005publications/CEC-100-2005-006/CEC-100-2005-006-CMF.PDF>.
42. _____ (2006). *Staff Forecast of 2007 Peak Demand*. Draft Staff Report. CEC-400-2006-008-SD. Sacramento, CA: CEC, at <http://www.energy.ca.gov/2006publications/CEC-400-2006-008/CEC-400-2006-008-SD.PDF>.
43. _____ (2007a). *California Energy Demand 2008-2018: Staff Revised Forecast*. CEC-200-2007-015-SF2. Sacramento, CA: CEC. November 2007, at <http://www.energy.ca.gov/2007publications/CEC-200-2007-015/CEC-200-2007-015-SF2.PDF>.
44. _____ (2007b). *2007 Integrated Energy Policy Report*. CEC-100-2007-008-CMF. Sacramento, CA: CEC, at <http://www.energy.ca.gov/2007publications/CEC-100-2007-008/CEC-100-2007-008-CMF.PDF>.
45. _____ (2007c). *Staff Forecast of 2008 Peak Demand*. Final Staff Report. CEC-200-2007-006-SF. Sacramento, CA: CEC, at <http://www.energy.ca.gov/publications/displayOneReport.php?pubNum=CEC-200-2007-006-SF>.
46. _____ (2008a). *Cost-Benefit Analysis of the Self-Generation Incentive Program*. CEC-300-2008-010-F. Prepared by TIAX LLC. Sacramento, CA: CEC. October 2008, at <http://www.energy.ca.gov/2008publications/CEC-300-2008-010/CEC-300-2008-010-F.PDF>.
47. _____ (2008b). *2008 Integrated Energy Policy Report Update*. CEC-100-2008-008-CMF. Sacramento, CA: CEC, at <http://www.energy.ca.gov/2008publications/CEC-100-2008-008/CEC-100-2008-008-CMF.PDF>.
48. _____ (2008c). *Renewable Resource Integration Project: Scoping Study of Strategic Transmission Operations and Reliability Issues*. CEC-500-2008-081. Prepared by Consortium for Electric Reliability Technology Solutions/Electric Power Group. Sacramento, CA: CEC. December 2008, at <http://www.energy.ca.gov/2008publications/CEC-500-2008-081/CEC-500-2008-081.PDF>.

49. _____ (2008d). “Retired and Mothballed California Power Plants 2002-2006.” *Energy Almanac*, at http://energyalmanac.ca.gov/powerplants/retired_plants.html.
50. _____ (2008e). *Understanding Entrainment at Coastal Power Plants: Informing a Program to Study Impacts and their Reduction*. CEC-500-2007-120. Prepared by Moss Landing Marine Laboratories. Sacramento, CA: CEC. March 2008, at <http://www.energy.ca.gov/2007publications/CEC-500-2007-120/CEC-500-2007-120.PDF>.
51. California Energy Commission (CEC), Cartography Office (2008). “Electric System of the Greater San Francisco Bay Area.” May 2008.
52. California ISO (CAISO) (2006a). *Local Capacity Technical Analysis: Overview of 2006 Local Area Reliability Needs Study Report and Updated Results*. Folsom, CA: CAISO. March 27, 2006, at <http://www.caiso.com/17c6/17c6f7e55e990.pdf>.
53. _____ (2006b). *2005 Transmission Initiatives Summary*. Folsom, CA: CAISO, at <http://www.caiso.com/17cd/17cd6d4259960.pdf>.
54. _____ (2007a). *2006 Annual Report on Market Issues and Performance*. Folsom, CA: CAISO. April 2007, at <http://www.caiso.com/1bb7/1bb776216f9b0.pdf>
55. _____ (2007b). *2007 Transmission Plan: 2007 through 2016*. Folsom, CA: CAISO. January 2007, at <http://www.caiso.com/1b6b/1b6bb4d51db0.pdf>.
56. _____ (2008a). *2011-2013 Local Capacity Technical Analysis: Report and Study Results*. Folsom, CA: CAISO. December 29, 2008, at <http://www.caiso.com/20ad/20ad77d04d70.pdf>.
57. _____ (2008b). *2009 Local Capacity Technical Analysis: Final Report and Study*. Folsom, CA: CAISO. May 1, 2008, at <http://www.caiso.com/1fba/1fbace9b2d170.pdf>.
58. _____ (2008c). *2008 CAISO Transmission Plan – A Long-Term Assessment of the California ISO’s Controlled Grid (2008-2017)*. Folsom, CA: CAISO. January 2008, at <http://www.caiso.com/1f52/1f52d6d93a3e0.pdf>.
59. _____ (2008d). *Market Issues & Performance: 2007 Annual Report*. Folsom, CA: CAISO. April 2008, at <http://www.caiso.com/1f9c/1f9c8b49e9f0.pdf>.
60. _____ (2008e). *2009 CAISO Transmission Plan: Final Study Plan*. Folsom, CA: CAISO. July 2008, at <http://www.caiso.com/1f80/1f809d7723f70.pdf>.
61. _____ (2008f). *CAISO Transmission Plan, A Long-Term Assessment of the California ISO’s Controlled Grid (2008-2017)*. Folsom, CA: CAISO. January 2008, at <http://www.caiso.com/1f52/1f52d6d93a3e0.pdf>.
62. _____ (2009a). *2010 ISO Transmission Plan, Final Study Plan*. Folsom, CA: CAISO. May 2009, at <http://www.caiso.com/2374/2374ed1b83d0.pdf>.
63. _____ (2009b). *2009 California ISO Transmission Plan*. Folsom, CA: CAISO. Amended June 2009, at <http://www.caiso.com/2354/2354f34634870.pdf>.
64. _____ (2009c). *Market Issues & Performance: 2008 Annual Report*. Folsom, CA: CAISO. April 2009, at <http://www.caiso.com/2390/239087966e450.pdf>.
65. California Public Utilities Commission (CPUC) (2004). “Opinion Granting a Certificate of Public Convenience and Necessity.” A.04-12-008 COM/DGX/tcg. Decision 07-03-045. San Francisco, CA: CPUC. March 15, 2007, at http://docs.cpuc.ca.gov/word_pdf/FINAL_DECISION/65666.pdf.
66. _____ (2008a). *California Long Term Energy Efficiency Strategic Plan*. San Francisco, CA: CPUC. September 2008, at <http://www.californiaenergyefficiency.com/docs/EEStrategicPlan.pdf>.
67. _____ (2008b). *Energy Efficiency Groupware Application*. “Summary of 2006-2008 Energy Efficiency Programs–December 2008.” San Francisco, CA: CPUC. December 2008, at <http://eega2006.cpuc.ca.gov/Default.aspx>.

68. ____ (2008c). *Energy Efficiency Groupware Application Standard Reports*. Program impacts tables. San Francisco, CA: CPUC. December 2008, at <http://eega2006.cpuc.ca.gov/Reports.aspx>.
69. ____ (2009). *Energy Efficiency 2006-2007 Verification Report and Appendices*. San Francisco, CA: CPUC. February 5, 2009, at <http://eega2006.cpuc.ca.gov/PEBCalcs2.aspx>.
70. California Renewable Energy Transmission Initiative (RETI) (2008). *Renewable Energy Transmission Initiative (RETI), Phase 1A, Final Report*, prepared by Black and Veatch. April 2008, at <http://www.energy.ca.gov/2008publications/RETI-1000-2008-002/RETI-1000-2008-002-F.PDF>.
71. ____ (2009). *Renewable Energy Transmission Initiative (RETI), Phase 1B, Final Report*. RETI-1000-2008-003-F. January 5, 2009 (updated March 4, 2009), at <http://www.energy.ca.gov/2008publications/RETI-1000-2008-003/RETI-1000-2008-003-F.PDF>.
72. California State Auditor (2009). *High Risk: The California State Auditor's Updated Assessment of High Risk Issues the State and Select State Agencies Face*. Report 2008 601. Sacramento, CA: California State Auditor. June 2009, at <http://www.bsa.ca.gov/pdfs/reports/2008-601.pdf>.
73. Cape Wind, at <http://www.capewind.org>.
74. CapX (2009). "CapX2020 Granted Certificate of Need for 345-kilovolt Projects in Minnesota." St. Paul, MN: CapX2020. April 16, 2009, at http://www.capx2020.com/Regulatory/State/Minnesota/pdf/PUC_Decision_on_345_CON_press_release_4-16-2009_final.pdf.
75. Center for Energy, Economic, and Environmental Policy (CEEP) (2006). "Current Data Collection (Conventional Energy Supply) NJ Energy Master Plan." New Brunswick, NJ: Rutgers. December 18, 2006, at <http://policy.rutgers.edu/ceep/publications/2006/currentdatacollection.xls>.
76. Chadalavada, V. (2009a) "NEPOOL Participants Committee Meeting, COO Report." Presentation at NEPOOL Participants Committee Meeting. May 1, 2009, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/prtcpnts/mtrls/2009/may12009/coo_npc_report_may_1_2009.pdf.
77. ____ (2009b). "Roadmap to Renewable and Demand Resource Integration in New England." Presented at the New England Conference of Public Utilities Commissioners Symposium, Newport, RI. May 4-5, 2009, at http://www.iso-ne.com/pubs/pubcomm/pres_spchs/index.html.
78. City of Pittsburg (2006). "Draft Environmental Impact Statement for the Proposed Transbay Cable Project." SCH # 2004082096. Prepared by URS Corporation. Pittsburg, CA: City of Pittsburg, at <http://www.ci.pittsburg.ca.us/pittsburg/pdf/tbc/0-TOC.htm>.
79. City of Seattle (no date). *Energy: Affected Environment*. Seattle, WA: City of Seattle, at http://www.seattle.gov/dpd/static/CHAP%20THREE%2012%20Energy_LatestReleased_DPDP_020574.pdf.
80. CleanTech Group (2008). "Comverge in Arizona demand response contract." *CleanTech Group*. September 17, 2008, at <http://cleantech.com/news/3454/comverge-arizona-demand-response-contract>.
81. ColumbiaGrid (2009a). *2009 Biennial Transmission Expansion Plan*. Portland, OR: ColumbiaGrid. February 2009, at <http://www.columbiagrid.org/biennial-transmission-overview.cfm>.
82. ____ (2009b). "Projects Map Overview," at <https://www.columbiagrid.org/areamap-overview.cfm>.
83. ____ (2009c). "West of McNary Regional Planning Study Team Overview," at <http://www.columbiagrid.org/WMRP-overview.cfm>.
84. Connecticut Energy Advisory Board (CEAB) (2007). *2007 Energy Plan for Connecticut*. Rocky Hill, CT: CEAB. Approved February 6, 2007, at http://www.ctenergy.org/pdf/2007_Energy_Plan.pdf.
85. Corrigan, H. (2009). "Utility Dynamic Pricing Case Starts with Questions on Costs, Timing." *California Energy Markets*. April 24, 2009.

86. Cusick, D (2008). "Project that could Boost Midwest 'Wind Belt' Faces Enviro Opposition." *Greenwire*. December 1, 2008.
87. Database of State Incentives for Renewables & Efficiency (DSIRE) (2009a). *Rules, Regulations and Policies for Renewable Energy*. Raleigh, NC: NC Solar Center, NC State University, at <http://www.dsireusa.org/summarytables/rrpre.cfm>.
88. _____ (2009b). Arizona Incentives for Renewable Energy, at <http://www.dsireusa.org/library/includes/map2.cfm?CurrentPageID=1&State=AZ&RE=1&EE=0>.
89. Denholm, P. and R. Margolis (2007). *The Regional Per-Capita Solar Electric Footprint for the United States*. Technical Report NREL/TP-670-42463. Golden, CO: National Renewable Energy Laboratory. December 2007, at <http://www.nrel.gov/docs/fy08osti/42463.pdf>.
90. District of Columbia (2008). *The Clean and Affordable Energy Act of 2008*. Washington, DC: West Group Publisher, at http://www.green.dc.gov/green/lib/green/seu_legislation.pdf.
91. Edison Electric Institute (2009). *Transmission Projects Supporting Renewable Resources*. February 2009, at http://www.eei.org/ourissues/ElectricityTransmission/Documents/TransprojRenew_web.pdf.
92. Edwards, J. (2009). "Edison Calls Off Pursuit of Devers-Palo Verde No. 2 Line." *California Energy Markets*. May 22, 2009.
93. Ehrlich, D. (2009). "RSP09, 2008 Historical Market Data: Locational Margin Prices – Interfaces, MW Flows." Draft. Holyoke, MA: ISO-NE. January 21, 2009, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/pac/mtrls/2009/jan212009/a_imp_interface.pdf.
94. Eldridge, M., M. Neubauer, D. York, S. Vaidyanathan, A. Chittum, and S. Nadel. *The 2008 State Energy Efficiency Scorecard*. ACEEE Report Number E086. Washington, DC: American Council for an Energy-Efficient Economy. October 2008, at http://www.aceee.org/pubs/e086_es.pdf.
95. *Electric Transmission Week*. 2006, 2007 and 2008.
96. Elsinore Valley Municipal Water District (EVMWD) (2008). "The EVMWD Lake Elsinore Advanced Pump Storage (LEAPS) Update." Special LEAPS Edition. 2. Lake Elsinore, CA: EVMWD, at <http://www.evmwd.com/civica/filebank/blobload.asp?BlobID=4430>.
97. Energy Information Administration (EIA) (2007a). "Form EIA-860 Database Annual Electric Generator Report." Washington DC: EIA, at <http://www.eia.doe.gov/cneaf/electricity/page/eia860.html>.
98. _____ (2007b). "Table 3.10: Shipments of Photovoltaic Cells and Modules by Destination, 2006 and 2007," *Solar Photovoltaic Cell/Module Manufacturing Activities, 2007*. Washington DC: EIA, at http://www.eia.doe.gov/cneaf/solar.renewables/page/solarreport/table3_10.pdf.
99. _____ (2009). "Noncoincident Peak Load, Actual and Projected by North American Electric Reliability Council Region, 2003 through 2012 (Megawatts)," at <http://www.eia.doe.gov/cneaf/electricity/epa/epat3p1.html>.
100. Entergy Corporation (2007). *2007 Annual Report*, at http://www.entergy.com/content/investor_relations/pdfs/2007_Annual_rpt.pdf.
101. _____ (2008). *Final 2008-2010 Entergy Transmission Construction Plan*. Modified March 3, 2008, at [http://oasis.e-terrasolutions.com/documents/EES/2008-10%20ETR%20Construction%20Plan%20\(FINAL%20Modified%20030308\)3.pdf](http://oasis.e-terrasolutions.com/documents/EES/2008-10%20ETR%20Construction%20Plan%20(FINAL%20Modified%20030308)3.pdf).
102. Entergy Louisiana, LLC (2009). "Entergy's Louisiana Utilities Announce Completion of Three Transmission Projects," Entergy Louisiana, LLC and Entergy Gulf States Louisiana, LLC Press release. Kenner, LA: Entergy Louisiana, LLC. June 4, 2009, at http://www.entergy.com/news_room/newsrelease.aspx?NR_ID=1494.
103. Federal Energy Regulatory Commission (FERC) (1996). *FERC Order 889: 18 CFR Part 37 Open Access Same-Time Information System (formerly Real-Time Information Networks) and Standards of Conduct*. Washington, DC: FERC. April 24, 1996, at <http://www.ferc.gov/legal/maj-ord-reg/land-docs/order889.asp>.

104. _____ (2008a). “2008 Summer Market Forecast.” Office of Enforcement. May 15, 2008, at <http://www.ferc.gov/market-oversight/mkt-views/2008/05-15-08.pdf>.
105. _____ (2008b). “Electric Efficiency Resource Standards (EERS) and Goals.” Office of Market Oversight. April 3, 2009, at <http://www.ferc.gov/market-oversight/mkt-electric/overview/elec-ovr-eeeps.pdf>.
106. _____ (2009a). “OE Energy Market Snapshot: Mid-Atlantic States Version – April 2009 Data.” Office of Enforcement. May 2009, at <http://www.ferc.gov/market-oversight/mkt-snp-sht/2009/05-2009-snapshot-ma.pdf>.
107. _____ (2009b). “OE Energy Market Snapshot: Northeast States Version – April 2009 Data.” Office of Enforcement. May 2009, at <http://www.ferc.gov/market-oversight/mkt-snp-sht/2009/06-2009-snapshot-ne.pdf>.
108. Federal Power Act, section 216(h), 16 U.S.C. 824p(h).
109. Florida Public Service Commission (FPSC) (2007). *Review of 2007 Ten-Year Site Plans for Florida’s Electric Utilities*. Tallahassee, FL: FPSC. December 2007, at <http://www.psc.state.fl.us/publications/pdf/electricgas/tysp2007.pdf>.
110. _____ (2008). *Statistics of the Florida Electric Utility Industry 2007*. Tallahassee, FL: FPSC. September 2008, at <http://www.floridapsc.com/utilities/electricgas/statistics/statistics-2007.pdf>.
111. Green Path Project (2007). “Green Path North Project: Preliminary Routing Options.” La Quinta, CA: Green Path Project, July 2, 2007, at <http://www.ladwp.com/ladwp/cms/ladwp009511.pdf>.
112. Gregerson, M. (2008). “Summary of MISO Studies to Help Determine Transmission Needed to Achieve Governors/Premier’s Renewable Electricity Goals.” September 25, 2008, at www.midwesterngovernors.org/MGA%20Energy%20Initiative/Renewable%20Electricity,%20Advanced%20Coal%20with%20Carbon%20Capture/mtg3/Trans_Subgroup_MISO_Transmission_Studies.doc.
113. Grosse, K. (2008). “2008 Electric Transmission Grid Expansion Plan.” Presented March 10, 2008. San Francisco, CA: PG&E, at <http://www.caiso.com/1f83/1f83c352694d0.pdf>.
114. Gustin, C. (2008). “Time for An Energy Reality Check if Region is To Meet Future Needs.” *The Day*. May 4, 2008, at http://www.newenglandenergyalliance.org/downloads/The_London_Day_Op_Ed_050408.pdf.
115. Hauer, J. T. Overbye, J. Dagle and S. Widergren (2002). “Advanced Transmission Technologies.” National Transmission Grid Study: Issue Papers, U.S. Department of Energy. May 2002, at <http://www.oe.energy.gov/transmission.htm>.
116. High Plains Express Transmission Project (2008). “High Plains Express Feasibility Executive Summary.” June 2008, at http://www.rmao.com/wtpp/HPX/HighPlainsExpress%20First%20Stage%20Feasibility%20Report%2006_08.pdf.
117. Hurlbut, D. (2008). *State Clean Energy Practices: Renewable Portfolio Standards*. Technical Report NREL/TP-670-43512. Golden, CO: National Renewable Energy Laboratory. July 2008, at <http://www.nrel.gov/docs/fy08osti/43512.pdf>.
118. IEEE Power and Energy Society. “Workforce Collaborative,” at <http://www.ieee-pes.org/workforce/workforce-collaborative>.
119. ISO New England (ISO-NE) (2005a). *2005-2014 Forecast Report of Capacity, Energy, Loads and Transmission*. Holyoke, MA: ISO-NE. April 2005, at http://www.iso-ne.com/trans/celt/report/2005/2005_celt_report.pdf.
120. _____ (2005b). *October '05 ISO-New England Project Listing Update (Final)*. Holyoke, MA: ISO-NE, at http://www.iso-ne.com/trans/rsp/2005/oct05_isone_project_listing_final_103105.xls.
121. _____ (2005c). *2005 Regional System Plan*. Holyoke, MA: ISO-NE. October 20, 2005, at <http://www.iso-ne.com/trans/rsp/2005/05rsp.pdf>.
122. _____ (2006a). *2006-2015 Forecast Report of Capacity, Energy, Loads and Transmission*. Holyoke, MA: ISO-NE. April 2006, at http://www.iso-ne.com/trans/celt/report/2006/2006_CELT_Report.pdf.

123. ____ (2006b). *October 2006 ISO-New England Project Listing Update (Final)*. Holyoke, MA: ISO-NE.
124. ____ (2006c). *2006 Regional System Plan*. Holyoke, MA: ISO-NE. October 26, 2006, at http://www.iso-ne.com/trans/rsp/2006/rsp06_final_public.pdf.
125. ____ (2008a). *2007 Annual Markets Report*. Holyoke, MA: ISO-NE. June 6, 2008, at http://www.iso-ne.com/markets/mkt_anlys_rpts/annl_mkt_rpts/2007/amr07_final_20080606.pdf.
126. ____ (2008b). *2008-2017 Forecast Report of Capacity, Energy, Loads and Transmission*. Holyoke: MA. April 2008, at http://www.iso-ne.com/trans/celt/report/2008/2008_celt_report_final.pdf.
127. ____ (2008c). *October 2008 ISO-New England Project Listing Update (Final)*. Holyoke, MA: ISO-NE.
128. ____ (2008d). *2008 Regional System Plan*. Holyoke, MA: ISO-NE. October 16, 2008, at http://www.iso-ne.com/trans/rsp/2008/rsp08_final_101608_public_version.pdf.
129. ____ (2009a). *2008 Fourth Quarter Markets Report*. Holyoke, MA: ISO-NE. February 24, 2009, at http://www.iso-ne.com/markets/mkt_anlys_rpts/qtrly_mktops_rpts/2008/2008_q4_quarterly.pdf.
130. ____ (2009b). "ISO New England Forecasts Adequate Resources to Meet Summer Electricity Demand; Economic Conditions Are Expected to Keep Peak Demand Flat." ISO-NE Press release. Holyoke, MA: ISO-NE. April 30, 2009, at <http://www.reuters.com/article/pressRelease/idUS166672+29-Apr-2009+BW20090429>.
131. ____ (2009c). *ISO New England Outlook*. Holyoke, MA: ISO-NE. January 2009, at http://www.iso-ne.com/nwss/nwltrs/outlook/2009/outlook_jan_2009.pdf.
132. ____ (2009d). "Monthly Market Operations Report, April 2009." Market Analysis and Settlements. Holyoke, MA: ISO-NE. May 12, 2009, at http://www.iso-ne.com/markets/mkt_anlys_rpts/mnly_mktops_rpts/2009/2009_04_monthly_market_report.pdf.
133. ISO-NE, NYISO and PJM (2009). *2008 Northeast Coordinated Electric System Plan: ISO New England, New York ISO and PJM*. March 27, 2009, at http://www.interiso.com/public/document/NCSP_2008_20090327.pdf.
134. ITC (2009). "ITC Holdings Corp. Unveils Green Power Express." ITC Press release. Novi, MI: ITC. February 9, 2009, at <http://investor.itc-holdings.com/releasedetail.cfm?ReleaseID=364150>.
135. Jesmer, G. (2009). "The US Utility-scale Solar Picture." *RenewableEnergyWorld.com*, at <http://www.renewableenergyworld.com/rea/news/article/2009/02/the-us-utility-scale-solar-picture>.
136. Joint Coordinated System Plan (JCSP) (2008a). *Joint Coordinated System Plan '08*. Midwest ISO/PJM/SPP/TVA/MAPP, at <http://www.jcspstudy.org/>.
137. ____ (2008b). "JCSP 2008 Transmission Design Workshop – Introduction." Regional Conceptual Transmission Design Workshops (Hartford, CT, Wilmington, DE, St. Louis, MO, and Knoxville, TN), at <http://www.jcspstudy.org/>.
138. ____ (2008c). "JCSP 2008 Transmission Design Workshop – Planning of a Power Transmission System Using Economic Tools." Regional Conceptual Transmission Design Workshops (Hartford, CT, Wilmington, DE, St. Louis, MO, and Knoxville, TN), at <http://www.jcspstudy.org/>.
139. Kondziolka, R. (2009). "Status of Projects in SWAT." Presented at WECC TEPPC Meeting. March 19-20, 2009. Vancouver, Washington, at <http://www.wecc.biz/committees/BOD/TEPPC/031909/Lists/Presentations/1/TEPPC%20SWAT%20Update%203.19.pdf>.
140. Krzykos, P. (2008a). "Arizona Renewable Transmission Task Force." Presented at The Arizona Wind Working Group Meeting. November 7, 2008, at http://wind.nau.edu/azwvg/meeting/documents/presentations110708/The%20Arizona%20Wind%20Working%20Group_Nov_07.pdf.
141. ____ (2008b). "Arizona Renewable Transmission Task Force BTA Response." Presented at the ACC Meeting. October 23, 2008, at http://www.westconnect.com/filestorage/SWAT_JAN13_2009.ppt.

142. ____ (2009). "SWAT Renewable Transmission Task Force." January 13, 2009, at http://www.westconnect.com/filestorage/SWAT_JAN13_2009.ppt.
143. Kushler, M., D. York and P. White (2009). *Meeting Aggressive New State Goals for Utility Sector Energy Efficiency: Examining Key Factors Associated with High Savings*. ACEEE Report Number U091. Washington, DC: American Council for an Energy-Efficient Economy. March 2009, at <http://www.aceee.org/pubs/U091.pdf>.
144. Lake, E., and P. Landreth (2009). "U.S. Supreme Court Rules Cost-Benefit Analysis Permitted Under the Clean Water Act – But Will it Matter in California?" *Holland & Knight LLP Environment Alert*. April 2, 2009, at <http://www.hklaw.com/id24660/PublicationId2613/ReturnId31/contentid54040/>.
145. Lei, W. (2008). "Perspectives on Producing Power in the West." Presented October 28, 2009. Portland, OR: Portland General Electric, at http://www.bigskyco2.org/files/presentations/Lei_BSCSP_08.pdf.
146. Los Angeles Department of Water & Power (LADWP) (no date). "Green Path North Project," at http://www.ladwp.com/ladwp/cms/ladwp007434.jsp#P7_489.
147. ____ (2008a). "L.A.'s Energy Demand Soars Toward All Time High." LADWP Press release. June 20, 2008, at <http://www.ladwpnews.com/go/doc/1475/212546/>.
148. ____ (2008b). "LADWP Recognized as a Leader in Climate Change as the Recipient of 2008 Green California Leadership Award." LADWP Press release. April 15, 2008, at <http://www.ladwpnews.com/go/doc/1475/198670/>.
149. ____ (2009). "LADWP Gives Away 2 Million Compact Fluorescent Light Bulbs to Residential Customers." LADWP Press release. April 1, 2009, at <http://www.ladwpnews.com/go/doc/1475/264244/>.
150. Marshall, L. (2009). *Draft Revised Demand Forecast*. Draft Staff Report. CEC-200-2009-001-SD. Sacramento, CA: CEC. February 2009, at <http://www.energy.ca.gov/2009publications/CEC-200-2009-001/CEC-200-2009-001-SD.PDF>.
151. Maryland Public Service Commission (2007). *Interim Report of the Public Service Commission of Maryland to the Maryland General Assembly, Part I: Options for Re-Regulation and New Generation*. Baltimore, MD: Maryland Public Service Commission. December 3, 2007, at <http://www.pulp.tc/MDPSCInterimReporttotheMDGA12-6-07.pdf>.
152. ____ (2008). *Analysis of Resource and Policy Options for Maryland's Energy Future*. Prepared by Levitan and Associates, Inc., Kay Scholer LLP. December 2008, at http://www.levitan.com/publications/pdf/MD_PSC_Dec2008.pdf.
153. ____ (2009). *Ten-Year Plan (2008-2017) of Electric Companies in Maryland*. Baltimore, MD: Maryland Public Service Commission. Prepared for the Maryland Department of Natural Resources. February 2009, at http://webapp.psc.state.md.us/Intranet/sitesearch/whats_new/Ten%20Year%20Plan%202008%20-%202017.pdf.
154. McBride, S.A., K.S. Myers, R.F. Jeffers, M.M. Plum, R.J. Turk, and L.R. Zirker (2008). *The Cost of Not Building Transmission: Economic Impact of Proposed Transmission Line Projects for the Pacific North West Economic Region*. INL/EXT-08-14264. Revision 2. Idaho Falls, ID: Idaho National Laboratory. July 2008, at <http://www.pnwer.org/Portals/0/Presentations/2008%20summit/Cost%20of%20not%20building%20transmission.pdf>.
155. Mehos, M. (2006). "Analysis of Solar Resource Potential and Siting Opportunities for the State of Arizona." Presented October 6, 2006. Golden, CO: National Renewable Energy Laboratory, at <http://www.azcc.gov/divisions/utilities/electric/environmental.asp>.
156. Metering International (2008). "Arizona Public Service contracts with Elster for 800,000 smart meters." *Metering.com*. June 25, 2008, at <http://www.metering.com/node/12858>.
157. Midwest ISO (2008a). "Midwest ISO Generator Interconnection Queue Reform." ATC LLC Customer Meeting. November 20, 2008.

158. _____ (2008b) “Midwest ISO to Begin Accepting Offers for Ancillary Services Market,” Midwest ISO Press release. Carmel, IN: Midwest ISO. December 22, 2008, at http://www.midwestmarket.org/publish/Document/1d44c3_11e1d03fcc5_-7dc30a48324a/2008-12-22%20Midwest%20ISO%20Begins%20Accepting%20ASM%20Offers.pdf?action=download&_property=Attachment.
159. _____ (2008c). *MTEP 08: The Midwest ISO Transmission Expansion Plan*. November 2008, at http://www.midwestiso.org/publish/Document/279a04_11db4d152b9_-7d8d0a48324a/2008-11_MTEP08_Report.pdf?action=download&_property=Attachment.
160. _____ (2009). *Regional Generation Outlet Study*. In progress, at http://www.midwestiso.org/publish/Folder/2c41ee_1200f54a695_-7f770a48324a?rev=1.
161. Midwest ISO and PJM (2006). *2006 Midwest ISO-PJM Coordinated System Plan (CSP)*. Issued December 5, 2006. Revised December 20, 2006, at <http://www.epjm.net/committees/stakeholders/inter-regional-planning-adv/downloads/20061207-2011-csp-report-final.pdf>.
162. Midwest ISO, PJM, SPP and TVA (2007). “MISO / PJM / SPP / TVA Inter-Regional Planning.” Combined Stakeholder Meeting. Pittsburgh, PA. November 1, 2007, at http://www.spp.org/publications/Microsoft%20PowerPoint%20-%20Nov%201%20JCSP%20meeting_Final.pdf.
163. Miller, J. (2007). “I-5 Corridor Regional Planning Study Team Overview,” at <http://www.columbiagrid.org/I5CRP-overview.cfm>
164. _____ (2008). “Letter to WECC Planning Coordination Committee on I-5 Corridor Reinforcement Project Regional Planning Compliance Report.” January 31, 2008.
165. Monitoring Analytics, LLC (2009a). *2008 State of the Market Report for PJM*. March 11, 2009, at http://www.monitoringanalytics.com/reports/PJM_State_of_the_Market/2008.shtml.
166. _____ (2009b). “State of the PJM Market, Quarter 1, 2009.” Presentation to PJM Members Committee. May 7, 2009, at <http://www.pjm.org/Media/committees-groups/committees/mc/20090507/20090507-item-11-market-monitor-report.pdf>.
167. Mukerji, R. (2007). “Written Remarks for the Eastern Interconnection ISO/RTO Seams Conference before the Federal Energy Regulatory Commission.” Panel #4 – Seams Issues between Northeastern ISO/RTO Markets. Remarks by the Vice President of Market Structures NYISO. March 29, 2007, at <http://www.ferc.gov/EventCalendar/Files/20070328153758-Mukerji,%20New%20York%20ISO.pdf>.
168. National Grid (2008). *The West’s Renewable Energy Future: A Contribution by National Grid*. July 2008, at http://www.nationalgridus.com/non_html/transmission-WestRenewableFuture.pdf.
169. National Renewable Energy Laboratory (NREL) (2009). “United States Wind Resource Map.” Golden, CO: NREL, at http://www.windpoweringamerica.gov/pdfs/wind_maps/us_windmap.pdf.
170. Nevada Hydro Company, Inc. (2008). “Lake Elsinore Advanced Pump Storage (LEAPS) and Talega-Escondido/Valley-Serrano (TE/VS) Transmission Line, FERC PN-11858-002 and ER06-278-005, CPUC Docket 07-10-005.” Presented at Northwest Power and Conservation Council Pumped Hydro Storage Workshop. October 17, 2008. Portland, OR, at <http://www.nwcouncil.org/energy/wind/meetings/2008/10/DavidKates.pdf>.
171. New England Energy Alliance Energy (NEEA) (2007). “Electricity Transmission Infrastructure Development in New England: Value through Reliability, Economic and Environmental Benefits.” Report prepared by Polestar Communications & Strategic Analysis. December 2007, at <http://www.newenglandenergyalliance.org/downloads/New%20England%20Transmission%20Paper.pdf>.

172. _____ (2008). “Perspectives on the Impact of Zero Electricity Demand Growth Strategies on Regional Energy Infrastructure Development.” Transcript from the New England Energy Alliance Energy Roundtable. November 8, 2007, at <http://www.newenglandenergyalliance.org/downloads/Alliance%20Energy%20Roundtable%20Report%20Zero%20Electricity%20Demand%20Growth.pdf>.
173. New England States’ Committee on Electricity (NESCOE) (2009). “New England States’ Committee on Electricity Request for Economic Study.” March 27, 2009, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/pac/mtrls/2009/mar312009/a_nescOE_es_transmittal.pdf.
174. New Mexico Energy, Minerals and Natural Resources Department (2008). *New Mexico Energy Efficiency Strategy: Policy Options*. Prepared by Southwest Energy Efficiency Project, ETC Group, and American Council for an Energy-Efficient Economy. November 2008, at http://www.swenergy.org/pubs/NM_Strategy-November_2008.pdf.
175. New York City Economic Development Corp. (NYCEDC) (2004). *NYC Energy Policy Task Force: 2004 Status Report*, at <http://www.nycedc.com/AboutUs/WhatWeDo/PlanningDevelopmentMaritime/Documents/EPTF2004StatusReport.pdf>.
176. _____ (2006). *NYC Energy Policy Task Force: 2006 Status Report*, at [http://www.nycedc.com/AboutUs/WhatWeDo/PlanningDevelopmentMaritime/Documents/2006StatusReport\(FINAL\)061406.pdf](http://www.nycedc.com/AboutUs/WhatWeDo/PlanningDevelopmentMaritime/Documents/2006StatusReport(FINAL)061406.pdf).
177. New York ISO (NYISO) (2005). *2005 Load and Capacity Data ‘Gold Book’*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/services/planning/planning_data_reference_documents/2005_GoldBook_Redact.pdf.
178. _____ (2006). *The Comprehensive Reliability Plan 2005: A Long-term Reliability Assessment of New York’s Power System*. Rensselaer, NY: NYISO. August 22, 2006, at http://broadwaterenergy.com/pdf/info/ISO_NY_Comprehensive_Reliability_Plan.pdf.
179. _____ (2007). *2007 Load and Capacity Data ‘Gold Book’*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/services/planning/planning_data_reference_documents/2007_GoldBook_PUBLIC.pdf.
180. _____ (2008a). *2008 Comprehensive Reliability Plan: A Long-Term Reliability Assessment of New York’s Bulk Power System*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2008/2008_Comprehensive_Reliability_Plan_Final_Report_07152008.pdf.
181. _____ (2008b). *2008 Load and Capacity Data ‘Gold Book’*. Rensselaer, NY: NYISO. April 2008, at http://www.nyiso.com/public/webdocs/services/planning/planning_data_reference_documents/2008_goldbook.pdf.
182. _____ (2008c). “2008 RNA Results and Review of Inputs.” NYPSC Case 07-E-1507. All Parties Meeting. Albany, NY. January 2008, at http://www.dps.state.ny.us/07E1507_NYISOReportPresentation_Jan-30-08.pdf.
183. _____ (2008d). *Power Trends 2008*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2008/nyiso_ptrendsfinal08.pdf.
184. _____ (2009a). *2009 Load and Capacity Data ‘Gold Book’*. Rensselaer, NY: NYISO. April 2009, at http://www.nyiso.com/public/webdocs/services/planning/planning_data_reference_documents/2009_LoadCapacityData_PUBLIC.pdf.
185. _____ (2009b). *Power Trends 2009*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/newsroom/current_issues/nyiso_powertrends2009_final.pdf.
186. _____ (2009c). *2009 Reliability Needs Assessment: Comprehensive System Planning Process*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/RNA_2009_Final_1_13_09.pdf.

187. _____ (2009d). “2009 Summer Outlook.” Rensselaer, NY: NYISO. May 21, 2009, at [http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_2009_Summer_Outlook_05212009_\(2\).pdf](http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_2009_Summer_Outlook_05212009_(2).pdf).
188. _____ (2009e). *Reliability Summary 2009-2018*. Rensselaer, NY: NYISO, at http://www.nyiso.com/public/webdocs/newsroom/current_issues/rna2009_final.pdf.
189. _____ (2009f). “NYISO Anticipates Sufficient Electricity Supply for Summer 2009,” NYISO Press release. Rensselaer, NY: NYISO. May 21, 2009, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/NYISO_Anticipates_Sufficient_Electricity_Supply_for_Summer_2009_05212009.pdf.
190. _____ (2009g). “Wind Power Growing in New York,” NYISO Press release. Rensselaer, NY: NYISO. April 22, 2009, at http://www.nyiso.com/public/webdocs/newsroom/press_releases/2009/Wind_Power_Growing_In_NY_04222009.pdf.
191. New York State Energy Research and Development Authority (2005). *The Effects of Integrating Wind Power on Transmission System Planning, Reliability and Operations, Report on Phase 2: System Performance Evaluation*. Prepared by GE Energy Consulting. Schenectady, NY: General Electric International, Inc. March 2005, at http://www.nyserda.org/publications/wind_integration_report.pdf.
192. North American Electric Reliability Corporation (NERC) (2008). *2008 Long-Term Reliability Assessment, 2008-2017*. Princeton, NJ: NERC. October 2008, at http://www.nerc.com/files/LTRA2008v1_2.pdf.
193. _____ (2009a). *2009 Summer Reliability Assessment*. Princeton, NJ: NERC. May 2009, at <http://www.nerc.com/files/summer2009.pdf>.
194. _____ (2009b). *Special Report: Accommodating High Levels of Variable Generation*. Princeton, NJ: NERC. April 2009, at http://www.nerc.com/files/IVGTF_Report_041609.pdf.
195. North American SynchroPhasor Initiative (NASPI), at <http://www.naspi.org/>.
196. Northeast Power Coordinating Council, Inc. (NPCC) (2007a). *Northeast Power Coordinating Council Reliability Assessment for Summer 2007*. New York: NPCC, Inc. May 2007, at http://www.npcc.org/viewDoc.aspx?name=NPCC_Reliability_Assessment_2007_Summer_Final_Report.pdf&cat=repSeasonal.
197. _____ (2007b). *Northeast Power Coordinating Council Reliability Assessment for Winter 2007-08*. New York: NPCC, Inc. November 2007, at http://www.npcc.org/viewDoc.aspx?name=NPCC_Reliability_Assessment_2007-08_Winter_Final_Report.pdf&cat=repSeasonal.
198. _____ (2008a). *Multi-Area Probabilistic Reliability Assessment for Summer 2008*. New York: NPCC, Inc. April 30, 2008, at http://www.npcc.org/viewDoc.aspx?name=Final+Summer_2008_CP-8_Report_April+30_.pdf&cat=repSeasonal.
199. _____ (2008b). *Multi-Area Probabilistic Reliability Assessment for Winter 2008/09*. New York: NPCC, Inc. November 19, 2008, at http://www.npcc.org/viewDoc.aspx?name=RCC_Approved_Winter_2008_09_Multi-Area_Probabilistic_Assessment.pdf&cat=repSeasonal.
200. _____ (2008c). *Northeast Power Coordinating Council Reliability Assessment for Summer 2008*. New York: NPCC, Inc. May 2008, at <http://www.npcc.org/viewDoc.aspx?name=NPCC+Reliability+Assessment+for+Summer+2008.pdf&cat=repSeasonal>.
201. _____ (2008d). *Northeast Power Coordinating Council Reliability Assessment for Winter 2008-09*. New York: NPCC, Inc. November 2008, at <http://www.npcc.org/viewDoc.aspx?name=NPCC++Reliability+Assessment+for+Winter+2008-09.pdf&cat=repSeasonal>.

202. Northwest Power & Conservation Council (NPCC) (2008). “Northwest energy conservation hit all time high in 2007.” NPCC Press release. May 14, 2008, at <http://www.nwcouncil.org/library/releases/2008/0514.htm>.
203. _____. (2009a). “Appendix C: Preliminary Draft Demand Forecast.” *Northwest Sixth Power Plan*. Council Document 2009-04. Portland, OR: NPCC. February 13, 2009, at <http://www.nwcouncil.org/library/2009/2009-04.pdf>.
204. _____. (2009b). “Generating Project Development Activity.” Portland, OR: NPCC, at <http://www.nwcouncil.org/energy/powersupply/Default.htm>.
205. Nuclear Energy Institute (2008). “Fact Sheet – New Nuclear Plants Create Opportunities for Expanding U.S. Manufacturing.” August 2008, at <http://www.nei.org/keyissues/newnuclearplants/factsheets>.
206. Nuclear Regulatory Commission (2008). “Location of Proposed New Nuclear Power Reactors.” October 2008, at <http://www.nrc.gov/reactors/new-reactors/col/new-reactor-map.html>.
207. Open Access Technology International, Inc. (OATI) (2003a). “Portland General Electric (PGE) Transmission,” at <http://www.oatioasis.com/pge/index.html>.
208. _____. (2003b). “PSEI Portion of the westTTrans OASIS,” at <http://www.oatioasis.com/psei/>.
209. _____. (2008). “PGE Actual Loads for 11/12/2008 through 11/20/2008,” at [http://www.oatioasis.com/PGE/PGEdocs/Missing_Load_Data_-_ \(12-2-2008\).pdf](http://www.oatioasis.com/PGE/PGEdocs/Missing_Load_Data_-_ (12-2-2008).pdf).
210. _____. (2009a). “PGE Load Data,” at <http://www.oatioasis.com/PGE/PGEdocs/PGEloadData.pdf>.
211. _____. (2009b). *Assessment of Historical Transmission Congestion in the Eastern Interconnection*. Minneapolis, MN: Open Access Technology International, Inc. July 2009, at <http://www.congestion09.anl.gov/documents/docs/EasternInterconnection.pdf>.
212. Ouellette, Jen (2009) “Commission, Barnstable pursue Cape Wind lawsuits,” *Wicked Local Yarmouth*. Yarmouthport, MA: The Register. June 17, 2009, at <http://www.wickedlocal.com/yarmouth/news/x1438501070/Commission-Barnstable-pursue-Cape-Wind-lawsuits>.
213. Pacific Gas and Electric Company (PG&E) (2009). “Canada-Pacific Northwest-Northern California Transmission Project,” at <http://www.pge.com/mybusiness/customerservice/nonpgeutility/electrictransmission/weccplanning>.
214. Patton, D. and P. Lee VanSchaick (2008). *2007 State of the Market Report: New York ISO*. Prepared by Potomac Economics, Ltd., Independent Market Advisor to the New York ISO. Filed on September 4, 2008, at http://www.nyiso.com/public/webdocs/documents/market_advisor_reports/NYISO_2007_SOM_Final.pdf.
215. Patton, D. and P. VanSchaick (2007). *2006 Assessment of the Electricity Markets in New England*. Prepared for Independent Market Monitoring Unit ISO-NE. June 2007.
216. Peabody Energy (2008). “ConocoPhillips and Peabody Energy Select Site in Muhlenberg County, KY, to Develop Coal-to-Gas Facility.” Peabody Energy News release. December 16, 2008, at <http://phx.corporate-ir.net/phoenix.zhtml?c=129849&p=irol-newsArticle&ID=1236657&highlight=#splash>.
217. Pennsylvania Public Utility Commission (2008). *Electric Power Outlook for Pennsylvania 2007-2012*. Harrisburg, PA: Pennsylvania Public Utility Commission. August 2008, at http://www.puc.state.pa.us/General/publications_reports/pdf/EPO_2008.pdf.
218. Perez, A.J. (2008). “Bay Area Municipal Transmission Group (BAMx) Comments on CAISO 2009 Transmission Plan.” March 24, 2008, at <http://www.caiso.com/1faa/1faaca9a55c80.pdf>.
219. PJM (2008a). *2007 Baseline Assessment: For the 2008-2022 Period*. Norristown, PA: PJM. March 2008 at <http://www.pjm.com/~media/planning/rtep-dev/baseline-reports/2007-rtep-baseline-assessment.ashx>.
220. _____. (2008b). *PJM Load Forecast Report*. Norristown, PA: PJM, at <http://www.pjm.com/committees-and-groups/committees/~media/committees-groups/committees/pc/2008-item-08-load-report.ashx>.

221. _____ (2009a). “Demand Response,” at <http://www.pjm.com/markets-and-operations/demand-response.aspx>.
222. _____ (2009b). “Demand Response Capacity Market,” at <http://www.pjm.com/markets-and-operations/demand-response/dr-capacity-market.aspx>.
223. _____ (2009c). “Demand Response Energy Market,” at http://www.pjm.com/markets-and-operations/demand-response/dr-energy-market.aspx?sc_lang=en.
224. _____ (2009d). *PJM Load, Capacity and Transmission Report 411 – Report and Data*. Norristown, PA: PJM. April 14, 2009 at <http://www.pjm.com/~media/documents/reports/2008-pjm-411.ashx>.
225. _____ (2009e). *PJM Load Forecast Report*. Norristown, PA: PJM. January 2009, at <http://www.pjm.com/~media/documents/reports/2009-pjm-load-report.ashx>.
226. _____ (2009f). “Region Ready for Hot Weather Power Demand,” PJM Press release. Valley Forge, PA: PJM. May 6, 2009, at <http://www.pjm.com/media/about-pjm/newsroom/2009-releases/20090506-pre-seasonal-forecast.pdf>.
227. _____ (2009g). “Table 1–RPM Base Residual Auction Resource Clearing Price Results in the RTO,” *2012/2013 RPM Base Residual Auction Results*. PJM Docs #540109. Norristown, PA: PJM. May 2009, at <http://www.pjm.com/~media/markets-ops/rpm/rpm-auction-info/2012-13-base-residual-auction-report-document-pdf.ashx>.
228. _____ (2009h). *2008 Regional Transmission Expansion Plan (RTEP)*. Norristown, PA: PJM. February 27, 2009, at http://www.pjm.com/documents/reports/rtep-report.aspx?sc_lang=en.
229. Portland General Electric (2007). *Form 8-K (Current Report Filing): Filed 5/31/2007 for Period Ending 5/25/2007*. May 31, 2007, at <http://investors.portlandgeneral.com/secfiling.cfm?filingID=784977-07-54>.
230. _____ (2008). *Form 8-K (Current Report Filing): Filed 09/17/08 for the Period Ending 09/16/08.*, September 17, 2008, at <http://investors.portlandgeneral.com/secfiling.cfm?filingID=1193125-08-196887>.
231. Power Markets Week (2008). “MISO, Minnesota PUC and some others express support for CapX 2020 grid plan.” *Power Markets Week*. June 2, 2008.
232. Puget Sound Energy (2008). “2007 Form 10-K Annual Report - Part 1.” February 2008, at <http://www.secinfo.com/d113uv.t9.htm#2c3q>.
233. Raphael, C. (2009). “LADWP, Blooming Late, Reports Big Gains with Efficiency,” *California Energy Markets*. April 3, 2009.
234. Renewable Energy Policy Project. “Renewable Portfolio Standards Map,” at http://www.repp.org/rps_map.html.
235. Renne, D. (2008). “2008 Solar Annual Review Meeting, Solar Resource Characterization.” Golden, CO: National Renewable Energy Laboratory, at http://www1.eere.energy.gov/solar/review_meeting/pdfs/prm2008_renne_nrel.pdf.
236. Roach, C.R., S. Rein, and K. Gottshall (2008). *2007 State of the Market Report: Southwest Power Pool, Inc.* Washington, DC: Boston Pacific Company, Inc. April 24, 2008, at http://www.spp.org/publications/2007_State_of_Market_Report.pdf.
237. _____ (2009). *2008 State of the Market Report: Southwest Power Pool, Inc.* Washington, DC: Boston Pacific Company, Inc. May 5, 2009, at <http://www.spp.org/publications/SPP%202008%20State%20of%20the%20Market%20Report.pdf>.
238. Russell, C. (2006). “Fourth Biennial Transmission Assessment, 2006-2015.” Presented on behalf of Salt River Project at the Arizona Corporation Commission Workshop. Phoenix, AZ. June 6, 2006, at http://www.cc.state.az.us/divisions/utilities/electric/Biennial/SRP_10_YR_Plans.ppt.

239. Russo, C.J., S.W. Niemann, R.B. Stoddard and B. Tsuchida (2009). *A Master Electrical Transmission Plan for New York City*. Draft prepared for the New York City Economic Development Corporation. CRA International Project No. D13536. Cambridge, MA: CRA International. May 28, 2009, at <http://www.crai.com/uploadedFiles/Publications/a-master-electrical-transmission-plan-for-new-york-city.pdf>.
240. San Diego Gas & Electric Company (2009). “Sunrise Powerlink,” at <http://www.sdge.com/sunrisepowerlink/>.
241. San Francisco Baykeeper (2009). “Ending Fish Kills in Bay Area Power Plants,” at <http://www.baykeeper.org/work/oncethroughcooling.html>.
242. Sherwood, L. (2008). *U.S. Solar Market Trends 2007*. Latham, NY: Interstate Renewable Energy Council, August 2008, at http://www.irecusa.org/fileadmin/user_upload/NationalOutreachDocs/SolarTrendsReports/IREC_Solar_Market_Trends_Revision_11_19_08-1.pdf.
243. Silva, J. (2008). “CATS-EHV 2007 Studies – Ten Year Snapshot and N-1-1.” Presented on behalf of Salt River Project at the Arizona Corporation Commission 2008 Biennial Transmission Assessment Workshop I. Phoenix, Arizona. May 22-23, 2008, at http://www.cc.state.az.us/Divisions/Utilities/Electric/Biennial/2008%20BTA/SRP%20ACC_BTA_Workshop-Directed%20Work.ppt.
244. Smart Meters (2008). “Financial crisis could speed up smart grid development.” *Smart Meters*. December 15, 2008, at <http://www.smartmeters.com/the-news/398-financial-crisis-could-speed-up-smart-grid-development.html>.
245. Smith, B. and P. Krzykos (2008). “Transmission and Resource Planning, APS.” Presented on February 15, 2008, at http://www.oatioasis.com/AZPS/AZPSdocs/APS_Transmission_Presentation_for_Feb_15th_.pdf.
246. Solar Energy Industries Association (SEIA) (2009). *U.S. Solar Industry Year in Review 2008*. Washington DC: SEIA, at http://www.seia.org/galleries/pdf/2008_Year_in_Review-small.pdf.
247. Southeast Arizona Transmission Study (SATS) (2008). *Southeast Arizona Transmission Study Report*. December 5, 2008, at http://www.westconnect.com/filestorage/SATS%20ReportFinal%20Report_120508.pdf.
248. Southern California Edison (no date). “Notice: Southern California Edison’s Antelope Transmission Project, Segment 1.” Rosemead, CA: SCE, at http://www.sce.com/NR/rdonlyres/8279E58E-BD7E-40F2-B8A8-A240193635EB/0/2008_0303_TRTPSeg1.pdf.
249. _____ (no date). “Notice: Southern California Edison’s Tehachapi Renewable Transmission Project, Segment 1, Section 2.” Rosemead, CA: SCE, at http://www.sce.com/NR/rdonlyres/9E3421D0-4B2C-430E-AFFB-CB5131D1B488/0/0811_TRTPSeg1_2_AngelosNatlForest.pdf.
250. _____ (2008). “The Tehachapi Renewable Transmission Project.” Rosemead, CA: SCE. March 2008, at http://www.sce.com/NR/rdonlyres/D92D6387-CF9A-4B60-868C-35EF45CE35E3/0/Greening_The_Grid_FINAL_0311.pdf.
251. _____ (2009). “Devers-Palo Verde No. 2 Project Update.” Rosemead, CA: SCE. May 2009, at http://www.sce.com/NR/rdonlyres/0A5F8FEB-5357-4C11-BD93-07387DE4B2C1/0/090515_DP2ProjectUpdate_May2009.pdf.
252. Southwest Energy Efficiency Project (SWEEP) (2009a). “Arizona Utility Announces Plans for Expanding Energy Efficiency Programs.” April 2009, at <http://www.swenergy.org/news/index.html#2009-04-04>.
253. _____ (2009b). “Arizona Utility Energy Efficiency Programs.” January 2009, at <http://www.swenergy.org/programs/arizona/utility.htm>.
254. _____ (2009c). “In the Matter of the Investigation of Regulatory and Rate Incentives for Gas and Electric Utilities.” Before the Arizona Corporation Commission. Docket No. E-00000J-08-0314 and G-00000C-08-0314. Energy Efficiency Workshop. March 5, 2009, at <http://images.edocket.azcc.gov/docketpdf/0000094296.pdf>.

255. _____ (2009d). “Settlement Reached in APS Rate Case, Will Expand Energy Efficiency Programs.” May 2009, at <http://www.swenergy.org/news/index.html#2009-05-01>.
256. SERC Reliability Corporation (2008a). *Regional Electricity Supply & Demand Projections*. Charlotte, NC: SERC. July 2008.
257. _____ (2008b). “Reliability Review Subcommittee’s 2008 Report to the SERC Engineering Committee.” Charlotte, NC: SERC.
258. Sichko, A. (2009). “NY Gov.: State of the state is ‘perilous’.” *The Business Review (Albany)*. January 7, 2009, at <http://www.bizjournals.com/albany/stories/2009/01/05/daily40.html>.
259. Southwest Power Pool, Inc. (SPP) (2007a). *Final Report on the SPP EHV Overlay Project*. Prepared by InfraSource Technology, Little Rock, AR: SPP, Inc. June 27, 2007, at http://www.spp.org/publications/spp_ehv_study_final_report.pdf.
260. _____ (2007b). *SPP ICT 2007-2009 Interim Base Plan*. Little Rock, AR: SPP, Inc. February 2007, at http://oasis.e-terrasolutions.com/documents/EES/base_plan_2007-2009.pdf.
261. _____ (2007c). *ICT Strategic Transmission Expansion Plan (ISTEP) Report*. Little Rock, AR: SPP, Inc. December 2007, at http://oasis.e-terrasolutions.com/documents/EES/Strategic%20Plan%20Report%20Phase%201_Dec_07.pdf.
262. _____ (2008a). *Final Report on the Southwest Power Pool (SPP) Updated EHV Overlay Study*. Prepared by Quanta Technology, LLC. Little Rock, AR: SPP, Inc. March 2008, at http://www.spp.org/publications/Quanta_Technology_March_2_2008_Update_to_the_EHV_Study_Final_Report.pdf.
263. _____ (2008b). *ICT Strategic Transmission Expansion Plan (ISTEP) Phase II Report, Rev. 1*. Little Rock, AR: SPP, Inc. January 23, 2008, at http://www.spp.org/publications/ISTEP_Phase_2_report.pdf.
264. _____ (2008c). “Independent Coordinator of Transmission (ICT) for Entergy – Annual Performance Report, November 17, 2007 to November 17, 2008.” Submitted to FERC on February 11, 2009.
265. _____ (2008d). *Southwest Power Pool 2007 Annual Report – Building for the Future*. Little Rock, AR: SPP, Inc., at <http://www.spp.org/publications/SPP%202007%20Annual%20Report.pdf>.
266. _____ (2008e). *2008 Supplemental Report Summarizing EIS Market Flowgate Congestion*. Little Rock, AR: SPP, Inc., at http://www.spp.org/publications/Supplemental%20Report%20of%20EIS%20Market%20Flowgate%20Congestion_May08.pdf.
267. _____ (2009). *2008 SPP Transmission Expansion Plan*. Little Rock, AR: SPP, Inc. Approved April 29, 2009, at http://www.spp.org/publications/2008_Approved_STEP_Report_Redacted.pdf
268. State of New Jersey (2008). *NJ Energy Master Plan*. Newark, NJ: State of New Jersey, at http://www.state.nj.us/emp/docs/pdf/081022_emp.pdf.
269. State of Washington Community, Trade, and Economic Department (CTED) (2005). *2005 Least Cost Plan*. Olympia, WA: CTED, at <http://www.cted.wa.gov/DesktopModules/CTEDPublications/CTEDPublicationsView.aspx?tabID=0&ItemID=4017&Mid=863&wversion=Staging>.
270. State Water Resources Control Board (2008). *Scoping Document: Water Quality Control Policy on the Use of Coastal and Estuarine Waters for Power Plant Cooling*. Sacramento, CA: California Environmental Protection Agency. March 2008, at <http://www.energy.ca.gov/2008publications/SWRCB-1000-2008-001/SWRCB-1000-2008-001.PDF>.
271. Stohr, G (2009). “Power Plants Win at Top U.S. Court on EPA Water Rule.” *Bloomberg Press*. April 1, 2009, at <http://www.bloomberg.com/apps/news?pid=20601103&sid=a7Jdevrvc86g>.

272. TEPPC Historical Analysis Work Group (2009). *2008 Annual Report of the Western Electricity Coordinating Council's Transmission Expansion Planning Policy Committee – Western Interconnection Transmission Path Utilization Study*. Salt Lake City, UT: WECC. April 2009, at <http://www.wecc.biz/committees/BOD/TEPPC/Shared%20Documents/Forms/AllItems.aspx?RootFolder=%2fcommittees%2fBOD%2fTEPPC%2fShared%20Documents%2fTEPPC%20Annual%20Reports%2f2008&FolderCTID=&View=%7b3FECCB9E%2d172C%2d41C1%2d9880%2da1CF02C537B7%7d>.
273. Thompson, C. (2009). “Letter from Chris Thompson, President of NYRI.” April 9, 2009, at <http://nyri.us/>.
274. Tierney, S. (2008). *A 21st Century “Interstate Electric Highway System” – Connecting Consumers and Domestic Clean Power Supplies*. Boston, MA: Analysis Group. October 31, 2008, at http://www.analysisgroup.com/uploadedFiles/Publishing/Articles/Tierney_21st_Century_Transmission.pdf.
275. Tierney, S. and P. Hibbard (2005). *New England Energy Infrastructure – Adequacy Assessment and Policy Review*. Prepared for The New England Energy Alliance, Boston, MA: Analysis Group. November 2005, at <http://www.newenglandenergyalliance.org/downloads/Tierney-HibbardInfrastructureNovember32005.pdf>.
276. Tita, B. (2009). “Interior Secretary Salazar Expecting Surge in Offshore Wind Farms.” *Wall Street Journal*, May 5, 2009.
277. Tonbridge Power, Inc. (2008). “Tonbridge Power Receives Final DOE Permit to Construct MATL Transmission Line.” Toronto, Ontario: Tonbridge Power, Inc. November 17, 2008, at [http://www.tonbridgepower.com/News/2008%2017%2011%20TBZ%20Receives%20Final%20MATL%20Permit\(1\).pdf](http://www.tonbridgepower.com/News/2008%2017%2011%20TBZ%20Receives%20Final%20MATL%20Permit(1).pdf).
278. *Town of Barnstable v. Mass. Energy Facilities Siting Board*, 25 Mass. L. Rep. 375, 2009 Mass. Super. LEXIS 108.
279. Trans Bay Cable. “The TBC Project,” at <http://www.transbaycable.com/>.
280. TransCanada (2008). “Northern Lights Transmission Project Converging on the Lower Columbia.” Presented October 3, 2008, at <http://www.puc.state.or.us/PUC/meetings/pmemos/2008/100608/NorthernLightsPresentation2.pdf>.
281. Transmission Expansion Planning Policy Committee (TEPPC) (2009). *Transmission Expansion Planning Policy Committee - 2009 Synchronized Study Program*. Draft. Salt Lake City, UT: WECC. April 28, 2009, at http://www.oatioasis.com/SPPC/SPPCdocs/Draft_TEPPC_2009_Study_Plan_05-12-09.pdf
282. Tucson Electric Power (TEP) (2008). “TEP Ranked among Top 10 Solar Electric Utilities in United States.” Tucson Electric Power Press release. July 24, 2008, at <http://www.tucsonelectric.com/Company/News/PressReleases/ReleaseTemplate.asp?idRec=295>.
283. _____ (2009). “Pinal Central Substation to Tortolita Substation 500-kV Transmission Project.” Project Newsletter #3. January 2009, at http://tep.com/Company/News/Tortolita/docs/Pinal_TortolitaProjectNewsletter3_2009_01.pdf.
284. U.S. Census Bureau (2009). “State and County Quick Facts: Arizona,” at <http://quickfacts.census.gov/qfd/states/04000.html>.
285. U.S. Census Bureau, Population Division (2005). “Table A1: Interim Projections of the Total Population for the United States and States: April 1, 2000 to July 1, 2030.” *Interim State Population Projections, 2005*. Release date: April 21, 2005, at <http://www.census.gov/population/projections/SummaryTabA1.pdf>.
286. _____ (2008). “Table 1: Annual Estimates of the Population for Counties of Arizona: April 1, 2000 to July 1, 2007.” CO-EST2007-01-04. Release Date: March 20, 2008, at <http://quickfacts.census.gov/qfd/states/040001k.html>.
287. U.S. Department of Energy (DOE) (2006a). *National Electric Transmission Congestion Study*. Washington DC: DOE. August 2006, at http://www.oe.energy.gov/DocumentsandMedia/Congestion_Study_2006-9MB.pdf.

288. _____ (2006b). *Workforce Trends In The Electric Utility Industry. A Report To Congress Pursuant To Section 1101 Of The Energy Policy Act Of 2005*. Washington, DC: DOE. August 2006, at http://www.oe.energy.gov/DocumentsandMedia/Workforce_Trends_Report_090706_FINAL.pdf.
289. _____ (2007). “National Electric Transmission Congestion Report and Order: Docket No. 2007-OE-01 Mid-Atlantic Area National Interest Electric Transmission Corridor and Docket No. 2007-OE-02 Southwest Area National Interest Electric Transmission Corridor.” *Federal Register* (72 FR 56992). October 5, 2007, at http://nietc.anl.gov/documents/docs/FR_Notice_of_5_Oct_07.pdf.
290. U.S. DOE and FERC (2006). *Steps To Establish A Real-Time Transmission Monitoring System For Transmission Owners and Operators Within the Eastern and Western Interconnects. A Report To Congress Pursuant To Section 1839 Of The Energy Policy Act Of 2005*. Washington, DC: DOE. February 2006, at http://www.oe.energy.gov/DocumentsandMedia/final_1839.pdf.
291. U.S. DOE Office of Electricity Delivery and Energy Reliability (no date). “Visualization and Controls Program,” at <https://events.energetics.com/v&c08/agenda.html>.
292. _____ (no date). “Transmission Reliability,” at <http://oe.energy.gov/transmission.htm>.
293. _____ (2006). “Public Comments: 2006 Congestion Study,” at <http://www.nietc.anl.gov/involve/searchcomment/index.cfm>.
294. _____ (2008). “Materials Submitted & Transcripts: Pre-Congestion Study Regional Workshops,” at <http://www.congestion09.anl.gov/pubschedule/index.cfm>.
295. _____ (2009a). “Presentations and Transcript: Spring 2009 Technical Workshop in Support of DOE 2009 Congestion Study.” March 25, 2009, at <http://congestion09.anl.gov/techws/index.cfm>.
296. _____ (2009b). “Public Comments: 2009 National Electric Transmission Congestion Study,” at <http://www.congestion09.anl.gov/involve/searchcomment/index.cfm>.
297. U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE) (2008). “Rutgers Breaks Ground on the Largest Solar Photovoltaics Power Facility in New Jersey: Solar renewable energy certificates are key to the financing.” Washington, DC: U.S. DOE. October 2008 at http://apps1.eere.energy.gov/state_energy_program/update/project_detail.cfm/pb_id=1339.
298. _____ (2009a). “District of Columbia Offers Rebates for Residential Solar and Wind Installations: The rebate is graduated, based on system capacity.” Washington, DC: U.S. DOE. April 2009, at http://apps1.eere.energy.gov/state_energy_program/update/project_detail.cfm/pb_id=1396.
299. _____ (2009b). “New Jersey Offers Rebates for On-Site Renewable Energy: Solar, wind, and biopower projects may qualify for the rebates.” Washington, DC: U.S. DOE. April 2009, at http://apps1.eere.energy.gov/state_energy_program/update/project_detail.cfm/pb_id=1404.
300. U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Geothermal Technologies Program (2006). “U.S. Geothermal Resource Map.” Washington, DC: EERE, at <http://www1.eere.energy.gov/geothermal/geomap.html>.
301. _____ (2009). *National Geothermal Action Plan: Preliminary Draft*. Washington, DC.
302. U.S. DOE Office of Energy Efficiency and Renewable Energy (EERE), Solar Energy Technologies Program (2009). “Solar America Initiative,” at http://www1.eere.energy.gov/solar/solar_america/.
303. _____ (2008). “Concentrating Solar Power.” DOE/GO-102008-2649. Golden, CO: National Renewable Energy Laboratory. September 2008, at <http://www1.eere.energy.gov/solar/pdfs/43685.pdf>.
304. U.S. Supreme Court (2009). “Entergy Corp. v. Riverkeeper, Inc., et al.” No. 07-588. Washington, DC: U.S. Supreme Court. Decided April 1, 2009, at <http://www.supremecourtus.gov/opinions/08pdf/07-588.pdf>.
305. Utility Consumers’ Action Network (UCAN) (2009). “UCAN Files First (of Many) Appeals to Reverse CPUC’s Sunrise PowerLink Approval,” *UCAN News*. San Diego, CA: UCAN. January 21, 2009, at http://www.ucan.org/energy/electricity/sunrise_powerlink/court_appeal_expected_fight_stop_sunrise_powerlink.

306. VACAR (2002). *Reliability Study of Projected 2007 Summer Peak Conditions*. Prepared by VACAR Power Flow Working Group. February 2002.
307. Valach, W. (2008). “Company Overview. Form 8-K.” Portland, OR: PGE. September 2008, at <http://investors.portlandgeneral.com/secfiling.cfm?filingID=1193125-08-196887>.
308. van Welie, G. (2009). “The Evolution and Expansion of System Planning.” President and CEO. ISO-NE. Presented at NECPUC Symposium. May 2009, at <http://www.necpuc.org/ppt/VanWelie2009.pdf>.
309. Vestel, L.B. (2009). “Grid Operator and San Francisco Tangle Over Fate of Potrero.” *California Energy Markets*. May 15, 2009.
310. Wesolowski, M. (2007). “Resiliency through Winter Storms.” Presented at Washington Association of Contingency Planners Meeting. April 26, 2007. Renton, WA, at <http://www.acp-wa-state.org/meetingsdoc/april2007/ACP%20Presentation%2004-26-07.pdf>.
311. WestConnect (2008). *2007 WestConnect Transmission Plan: A Report Detailing the Electrical Transmission System Expansion Plan Within the WestConnect Planning Area During the 2008-2017 Timeframe*. Prepared by K.R. Saline & Associates, PLC, Mesa, AZ. January 5, 2008, at http://www.westconnect.com/filestorage/WestConnect_Transmission_Plan_FINAL.pdf.
312. _____ (2009a). *2008 WestConnect Transmission Plan: A Report Detailing the Electrical Transmission System Expansion Plan Within the WestConnect Planning Area During the 2009-2018 Timeframe*. Prepared by K.R. Saline & Associates, PLC, Mesa, AZ. January 10, 2009, at http://www.westconnect.com/filestorage/Final_2008_Plan_Complete.pdf.
313. _____ (2009b). *2008 WestConnect Annual Reports – Errata*. Council, ID: WestConnect, at <http://www.westconnect.com/filestorage/%20Annual%20Meeting%20Errata.pdf>.
314. Western Electricity Coordinating Council (WECC) (2006a). *10-Year Coordinated Plan Summary – Planning and Operation for Electric System Reliability*. Salt Lake City, UT: WECC. July 2006, at <http://www.wecc.biz/library/WECC%20Documents/Publications/10-Year%20Coordinated%20Plan%20Summaries/2006-2015%2010-Year%20Coordinated%20Plan%20Summary.pdf>.
315. _____ (2006b). “Information Summary.” Salt Lake City, UT: WECC. October 2006, at <http://www.wecc.biz/library/WECC%20Documents/Publications/Information%20Summaries/2006%20Information%20Summary.pdf>.
316. _____ (2007). *2007 Power Supply Assessment*. Salt Lake City, UT: WECC. December 2007, at <http://www.wecc.biz/library/WECC%20Documents/Publications/Power%20Supply%20Assessments/2007%20December%20Power%20Supply%20Assessment.pdf>.
317. _____ (2008). “WECC Phase 1 Rating Process Coordinated Planning and Technical Studies.” Presented January 24, 2008. Portland, OR, at http://www.oatioasis.com/AVAT/AVATdocs/WECC_Corodinated_PGE_Project.ppt#23.
318. _____ (2009). “Log of Projects Undergoing WECC’s Three-Phase Rating Process – Phase 2 Projects.” Revised July 21, 2009, at http://www.wecc.biz/committees/StandingCommittees/PCC/022602/Lists/Agendas/1/ThreePhaseRating_CurrentLog2_06-02.doc.
319. Western Governors’ Association (WGA) (2006). *2006 Annual Report: Building a Sustainable West*. Denver, CO: WGA, at <http://www.westgov.org/wga/publicat/annrpt06.pdf>.
320. _____ (2007). *2007 Annual Report: Making the West the Best*. Denver, CO: WGA, at <http://www.westgov.org/wga/publicat/annrpt07.pdf>.
321. _____ (2008). *2008 Annual Report*. Denver, CO: WGA, at <http://www.westgov.org/wga/publicat/WGA08.pdf>.
322. Western Governors’ Association Clean and Diversified Energy Initiative. (2006). *Energy Efficiency Task Force Report*. Denver, CO: WGA. January 2006, at <http://www.westgov.org/wga/initiatives/cdeac/Energy%20Efficiency-full.pdf>.

323. Western Governors' Association (WGA) and U.S. Department of Energy (DOE) (2009). "Western Renewable Energy Zones." Denver, CO: WGA, at <http://www.westgov.org/wga/initiatives/wrez/>.
324. Whieldon, E. (2009). "Interstate power line siting is no problem for states, utility commissioner contends." *Inside FERC*.
325. Williams, M. (2009). "Nuclear plants face major funding crisis." *Seattle Daily Journal of Commerce*. Associated Press. April 29, 2009, at <http://www.nwbuildingpermits.com/news/co/12005472.html?cgi=yes>.
326. Wong, P. (2009). "New England Regional System Plan (RSP09) System Overview." Manager, Resource Adequacy. ISO-NE. Presented at PAC Meeting. Rensselaer, NY: NYISO. March 31, 2009, at http://www.iso-ne.com/committees/comm_wkgrps/prtcpnts_comm/pac/mtrls/2009/mar312009/a_system_overview.pdf.
327. Woodall, L. (2008). "Regional Renewable Energy Transmission Initiatives." Presented on behalf of K.R. Saline & Associates, PLC, at the ACC BTA Workshop. May 22-23, 2008, at <http://www.cc.state.az.us/Divisions/Utilities/Electric/Biennial/2008%20BTA/BTA%20Rgn%20Renewables.ppt>.
328. Wright, S. J. (2009a). "2008 Network Open Season Administrator's Decision Letter, including Attachment C: 2008 NOS Project Descriptions." February 16, 2009. Portland, OR: BPA, at http://www.transmission.bpa.gov/customer_forums/open_season/default.cfm.
329. _____ (2009b). "McNary-John Day Public Letter." Portland, OR: BPA. February 19, 2009, at http://www.transmission.bpa.gov/customer%5Fforums/open%5Fseason/docs/McNary-John_Day_Public_Letter_02_19_2009.pdf.

